



BUILDING CODE NOTES:

1. THE CONSTRUCTION SHALL NOT RESTRICT A FIVE-FOOT CLEAR AND UNOBSTRUCTED ACCESS TO ANY WATER OR POWER DISTRIBUTION FACILITIES (POWER POLES, PULL-BOXES, TRANSFORMERS, VALVES, PUMPS, VALVES, METERS, APPURTENANCES, ETC.) OR TO THE LOCATION OF THE HOOKUP. THE CONSTRUCTION SHALL NOT BE WITHIN TEN FEET OF ANY POWER LINES-WHETHER OR NOT THE LINES ARE LOCATED ON THE PROPERTY. FAILURE TO COMPLY MAY CAUSE CONSTRUCTION DELAYS AND/OR ADDITIONAL EXPENSES.
2. AN APPROVED SEISMIC GAS SHUTOFF VALVE WILL BE INSTALLED ON THE FUEL GAS LINE ON THE DOWNSTREAM SIDE OF THE UTILITY METER AND BE RIGIDLY CONNECTED TO THE EXTERIOR OF THE BUILDING OR STRUCTURE CONTAINING THE FUEL GAS PIPING. (PER ORDINANCE 170,169) (SEPARATE PLUMBING PERMIT IS REQUIRED).
3. PLUMBING FIXTURES ARE REQUIRED TO BE CONNECTED TO A SANITARY SEWER OR TO AN APPROVED SEWAGE DISPOSAL SYSTEM (R308.3).
4. KITCHEN SINKS, LAVATORIES, BATHTUBS, SHOWERS, BIDETS, LAUNDRY TUBS AND WASHING MACHINE OUTLETS SHALL BE PROVIDED WITH HOT AND COLD WATER AND CONNECTED TO AN APPROVED WATER SUPPLY. (R308.4).
5. BATHTUB AND SHOWER FLOORS, WALLS ABOVE BATHTUBS WITH A SHOWERHEAD, AND SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NONABSORBENT SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 8 FEET ABOVE THE FLOOR (R307.2).
6. PROVIDE ULTRA-LOW FLUSH WATER CLOSETS FOR ALL NEW CONSTRUCTION. EXISTING SHOWER HEADS AND TOILETS MUST BE ADAPTED FOR LOW WATER CONSUMPTION. UNIT SKYLIGHTS SHALL BE LABELED BY A LA CITY APPROVED LABELING AGENCY. SUCH LABEL SHALL STATE THE APPROVED LABELING AGENCY NAME, PRODUCT DESIGNATION AND PERFORMANCE GRADE (RESEARCH REPORT NOT REQUIRED). (R308.6.9).
7. WATER HEATER MUST BE STRAPPED TO WALL. (SEC. 507.3 LAPC)
- FOR EXISTING POOL ON SITE, PROVIDE AN ALARM FOR DOORS TO THE DWELLING THAT FORM A PART OF THE POOL ENCLOSURE. THE ALARM SHALL SOUND CONTINUOUSLY FOR A MIN. OF 30 SECONDS WHEN THE DOOR IS OPENED. IT SHALL AUTOMATICALLY RESET AND BE EQUIPPED WITH A MANUAL MEANS TO DEACTIVATE FOR 15 SECS. MAX. FOR A SINGLE OPENING. THE DEACTIVATION SWITCH SHALL BE AT LEAST 5'4" ABOVE THE FLOOR. (6109 OF LABC)
9. FOR EXISTING POOL ON SITE, PROVIDE AN ENTICEMENT COVER MEETING THE CURRENT ASTM OR ASME FOR THE SUCTION OUTLETS OF THE SWIMMING POOL. TOOTH ROP POOL AND SPA FOR SINGLE FAMILY DWELLINGS PER ASSEMBLY BILL (AB) NO. 2977. (3162B)
10. AUTOMATIC GARAGE DOOR OPENERS, IF PROVIDED, SHALL BE LISTED IN ACCORDANCE WITH UL 325. (R309.4)
11. SMOKE DETECTORS SHALL BE PROVIDED FOR ALL DWELLING UNITS INTENDED FOR HUMAN OCCUPANCY. UPON THE OWNER'S APPLICATION FOR A PERMIT FOR ALTERATIONS, REPAIRS, OR ADDITIONS EXCEEDING ONE THOUSAND DOLLARS (\$1,000). (R314.6.2)
12. WHERE A PERMIT IS REQUIRED FOR ALTERATIONS, REPAIRS OR ADDITIONS EXCEEDING ONE THOUSAND DOLLARS (\$1,000), EXISTING DWELLINGS OR SLEEPING UNITS THAT HAVE ATTACHED GARAGES OR FUEL-BURNING APPLIANCES SHALL BE PROVIDED WITH A CARBON MONOXIDE ALARM IN ACCORDANCE WITH SECTION R315.2. CARBON MONOXIDE ALARMS SHALL ONLY BE REQUIRED IN THE SPECIFIC DWELLING UNIT OR SLEEPING UNIT FOR WHICH THE PERMIT WAS OBTAINED. (R315.2.2)
13. EVERY SPACE INTENDED FOR HUMAN OCCUPANCY SHALL BE PROVIDED WITH NATURAL LIGHT BY MEANS OF EXTERIOR GLAZED OPENINGS IN ACCORDANCE WITH SECTION R303.1 OR SHALL BE PROVIDED WITH ARTIFICIAL LIGHT THAT IS ADEQUATE TO PROVIDE AN AVERAGE ILLUMINATION OF 6 FOOT-CANDLES OVER THE AREA OF THE ROOM AT A HEIGHT OF 30 INCHES ABOVE THE FLOOR LEVEL. (R303.1)
14. A COPY OF THE EVALUATION REPORT AND/OR CONDITIONS OF LISTING SHALL BE MADE AVAILABLE AT THE JOB SITE

VICINITY MAP



TRANSIT BUS



SHEET INDEX:

- 0.1 SAMPLE SITE PLAN
- 0.2 GENERAL NOTES, ROOF SPECIFICATIONS
- 0.3 MECHANICAL EQUIPMENT SPECIFICATIONS
- 0.4 GREEN BUILDING REQUIREMENTS
- 0.5 GREEN BUILDING REQUIREMENTS
- T24.1 TITLE 24
- T24.2 TITLE 24
- 1.0 PROPOSED ADU FLOOR PLAN
- 2.0 PROPOSED ADU ROOF PLANS
- 3.0 PROPOSED ADU ELEVATIONS, SECTION A-A (OPTION 1)
- 4.0 PROPOSED ADU ELEVATIONS, SECTION A-A (OPTION 2)
- 5.0 DETAILS
- S-0.1 GENERAL NOTES
- S-0.2 GENERAL NOTES
- S-0.3 TYPICAL DETAILS
- S-0.4 TYPICAL DETAILS
- S-1.0 FOUNDATION PLAN AND FRAMING PLANS, DETAILS

AREA SUMMARY:

LOT AREA:	
BUILDING CODE FLOOR AREA:	
- NEW ADU:	684.6 S.F.
ZONING CODE FLOOR AREA:	
- NEW ADU:	684.6 S.F.
SCOOOL FEES FLOOR AREA:	
- NEW ADU:	740.0 S.F.
FLOOR AREA RATIO:	
LOT COVERAGE:	
LANDSCAPING:	

APPLICABLE CODES:

- 2022 CALIFORNIA RESIDENTIAL CODE
- 2022 CALIFORNIA MECHANICAL CODE
- 2022 CALIFORNIA ELECTRICAL CODE
- 2022 CALIFORNIA PLUMBING CODE
- 2022 CALIFORNIA ENERGY CODE
- 2022 CALIFORNIA GREEN BUILDING STANDARDS CODE
- 2022 CALIFORNIA BUILDING CODE
- 2022 CALIFORNIA FIRE CODE

PROJECT DESCRIPTION

NEW DETACHED ADU

LOT/PARCEL INFORMATION:

- ADDRESS:**
- (E) HOUSE ADDRESS
 - (N) ADU ADDRESS
- APN:**
- LEGAL DESCRIPTION:**
- TYPE OF CONSTRUCTION:** TYPE VB
- ZONE:**
- LOT:**
- PARKING INFORMATION:**
- FIRE SPRINKLERS (ADU):**

EXISTING STRUCTURE INFORMATION:

- USE
- FLOOR AREA
- TYPE OF CONSTRUCTION
- FIRE SPRINKLERS (EXISTING)

OWNER INFO **APPLICANT INFO**

NAME: ADDRESS:	NAME: YAKOV DESIGN ADDRESS: 8055 W MANCHESTER AVE #510, PLAYA DEL REY, CA 90293
PHONE: E-MAIL:	PHONE: (323)922-2211 E-MAIL: INFO@YAKOVDESIGN.COM

SITE PLAN NOTES:

1. ALL PORTIONS OF REQUIRED FRONT YARD NOT USED FOR NECESSARY DRIVEWAYS AND WALKWAYS, INCLUDING DECORATIVE WALKWAYS SHALL BE USED FOR PLANTING AND SHALL NOT BE PAVED.
2. AUTOMATIC IRRIGATION SYSTEM CONTROLLERS TO BE WEATHER- OR SOIL-BASED CONTROLLERS.
3. CONTROLLERS FOR PROJECTS THAT INCLUDE LANDSCAPE WORK, THE LANDSCAPE CERTIFICATION, FORM GRN12, SHALL BE COMPLETED PRIOR TO FINAL INSPECTION APPROVAL.
4. ANNULAR SPACES AROUND PIPES, ELECTRIC CABLES, CONDUITS, OR OTHER OPENINGS IN THE BUILDING'S ENVELOPE AT EXTERIOR WALLS SHALL BE PROTECTED AGAINST THE PASSAGE OF RODENTS BY CLOSING SUCH OPENINGS WITH CEMENT MORTAR, CONCRETE MASONRY OR METAL PIPING PRONE TO CORROSION SHALL BE PROTECTED IN ACCORDANCE WITH SECTION 313.0 OF THE LOS ANGELES PLUMBING CODE.
5. MATERIALS DELIVERED TO THE CONSTRUCTION SITE SHALL BE PROTECTED FROM RAIN OR OTHER SOURCES OF MOISTURE.
6. CONSTRUCTION WASTE SHALL BE REDUCED BY 50%. CONSTRUCTION WASTE SHALL BE HANDLED BY CITY OF LOS ANGELES CERTIFIED HAULER.
7. AN OPERATION AND MAINTENANCE MANUAL, INCLUDING, AT A MINIMUM, THE ITEMS LISTED IN SECTION 4.410.1 SHALL BE COMPLETED AND PLACED IN THE BUILDING AT THE TIME OF FINAL INSPECTION. FORM GRN 6
8. LOT SHALL BE GRADED TO DRAIN SURFACE WATER AWAY FROM FOUNDATION WALLS WITH A MINIMUM FALL OF 6" WITHIN THE FIRST 10 FEET
9. ALL DUCT AND OTHER RELATED AIR DISTRIBUTION COMPONENT OPENINGS SHALL BE COVERED WITH TAPE, PLASTIC, OR SHEET METAL UNTIL THE FINAL STARTUP OF THE HEATING, COOLING AND VENTILATING EQUIPMENT.
10. THE VOC CONTENT VERIFICATION CHECKLIST, FORM GRN 2, SHALL BE COMPLETED AND VERIFIED PRIOR TO FINAL INSPECTION APPROVAL. THE MANUFACTURER'S SPECIFICATIONS SHOWING VOC CONTENT FOR ALL APPLICABLE PRODUCTS SHALL BE READILY AVAILABLE AT THE JOB SITE AND BE PROVIDED TO THE FIELD INSPECTOR FOR VERIFICATION. (4.504.2.4, 9.504.2.4)
11. ARCHITECTURAL PAINTS AND COATINGS, ADHESIVES, CAULKS AND SEALANTS SHALL COMPLY WITH THE VOLATILE ORGANIC COMPOUND (VOC) LIMITS.
12. ALL NEW CARPET INSTALLED IN THE BUILDING INTERIOR SHALL MEET THE TESTING AND PRODUCT REQUIREMENTS OF ONE OF THE FOLLOWING:
 - A. CARPET AND RUG INSTITUTE GREEN LABEL PLUS PROGRAM
 - B. CALIFORNIA DEPARTMENT OF PUBLIC HEALTH'S SPECIFICATION 01350
 - C. NSF/ANSI 140 AT THE GOLD LEVEL
 - D. SCIENTIFIC CERTIFICATIONS SYSTEMS INDOOR ADVANTAGE™ GOLD
13. ALL NEW CARPET CUSHION INSTALLED IN THE BUILDING INTERIOR SHALL MEET THE REQUIREMENTS OF THE CARPET AND RUG INSTITUTE GREEN LABEL PROGRAM.
14. 80% OF THE TOTAL AREA RECEIVING RESILIENT FLOORING SHALL COMPLY WITH ONE OR MORE OF THE FOLLOWING:
 - A. VOC EMISSION LIMITS DEFINED IN THE CHPS HIGH PERFORMANCE PRODUCTS DATABASE
 - B. PRODUCTS COMPLIANT WITH THE CHPS CRITERIA CERTIFIED UNDER THE GREENGUARD CHILDREN & SCHOOLS PROGRAM
 - C. CERTIFICATION UNDER THE RESILIENT FLOOR COVERING INSTITUTE (RFCI) FLOORSORE PROGRAM
 - D. MEET THE CALIFORNIA DEPARTMENT OF PUBLIC HEALTH'S SPECIFICATION
15. NEW HARDWOOD PLYWOOD, PARTICLE BOARD, AND MEDIUM DENSITY FIBERBOARD COMPOSITE WOOD PRODUCTS USED IN THE INTERIOR OR EXTERIOR OF THE BUILDING SHALL MEET THE FORMALDEHYDE LIMITS LISTED IN TABLE 4.504.5, TABLE 9.504.5, 9.504.5.
16. THE FORMALDEHYDE EMISSIONS VERIFICATION CHECKLIST, FORM GRN 3, SHALL BE COMPLETED PRIOR TO FINAL INSPECTION APPROVAL. THE MANUFACTURER'S SPECIFICATIONS SHOWING FORMALDEHYDE CONTENT FOR ALL APPLICABLE WOOD PRODUCTS SHALL BE READILY AVAILABLE AT THE JOB SITE AND BE PROVIDED TO THE FIELD INSPECTOR FOR VERIFICATION. (4.504.5.1, 9.504.5.1)
17. BUILDING MATERIALS WITH VISIBLE SIGNS OF WATER DAMAGE SHALL NOT BE INSTALLED. THE BUILDING INSPECTOR SHALL NOT ENCLOSE WALL AND FLOOR FRAMING UNTIL IT IS INSPECTED AND FOUND TO BE SATISFACTORY.
18. THE HEATING AND AIR-CONDITIONING SYSTEMS SHALL BE SIZED AND DESIGNED USING ANSI/ACCA MANUAL J-2004, ANSI/ACCA 28-2009 OR ASHRAE HANDBOOKS AND HAVE THEIR EQUIPMENT SELECTED IN ACCORDANCE WITH ANSI/ACCA 36-S MANUAL S.
19. PROVIDE MINIMUM 1" (INSIDE DIAMETER) LISTED RACEWAY INSTALLED FOR EACH UNIT TO ACCOMMODATE A DEDICATED 300/240 VOLT BRANCH CIRCUIT. THE RACEWAY SHALL ORIGINATE AT THE MAIN SERVICE OR A SUBPANEL AND TERMINATE IN CLOSE PROXIMITY TO THE PROPOSED LOCATION OF THE CHARGING SYSTEM INTO A LISTED CABINET, BOX OR ENCLOSURE. SUFFICIENT CONDUCTOR SIZING AND SERVICE CAPACITY TO INSTALL LEVEL 2 EVSE SHALL BE PROVIDED. A LABEL STATING EV CAPABLE SHALL BE POSTED IN CONSPICUOUS PLACE AT THE SERVICE PANEL OR SUBPANEL AND NEXT TO THE RACEWAY TERMINATION POINT.
20. THE MAIN ELECTRICAL SERVICE PANEL SHALL HAVE A RESERVED SPACE TO ALLOW FOR INSTALLATION OF A DOUBLE POLE CIRCUIT BREAKER FOR A FUTURE SOLAR ELECTRICAL INSTALLATION. THE RESERVED SPACE SHALL BE POSITIONED AT THE OPPOSITE (LOAD) END FROM THE INPUT FEEDER LOCATION OR MAIN CIRCUIT LOCATION AND SHALL BE PERMANENTLY MARKED AS "FOR FUTURE SOLAR ELECTRIC"
21. BUILDINGS SHALL HAVE APPROVED ADDRESS NUMBERS, BUILDING NUMBERS OR APPROVED BUILDING IDENTIFICATION PLACE IN A POSITION THAT IS PLAINLY LEGIBLE AND VISIBLE FROM THE STREET OR ROAD FRONTING THE PROPERTY.
22. PROTECTION OF WOOD AND WOOD BASED PRODUCTS FROM DECAY SHALL BE PROVIDED IN THE LOCATIONS SPECIFIED PER SECTION R317.1 BY THE USE OF NATURALLY DURABLE WOOD OR WOOD THAT IS PRESERVATIVE-TREATED IN ACCORDANCE WITH AWPA U1 FOR THE SPECIES, PRODUCE, PRESERVATIVE AND END USE. PRESERVATIVES SHALL BE LISTED IN SECTION 4 OF AWPA U1
23. PROVIDE ANTI-GRAFFITI FINISH WITHIN THE FIRST 9 FEET, MEASURED FROM GRADE, AT EXTERIOR WALLS AND DOORS.
24. APPLICATIONS FOR WHICH NO PERMIT IS ISSUED WITHIN 180 DAYS FOLLOWING THE DATE OF APPLICATION SHALL AUTOMATICALLY EXPIRE. (R105.3.2 CRC)
25. EVERY PERMIT ISSUED SHALL BECOME INVALID UNLESS WORK AUTHORIZED IS COMMENCED WITHIN 180 DAYS OR IF THE WORK AUTHORIZED IS SUSPENDED OR ABANDON FOR A PERIOD OF 180 A SUCCESSFUL INSPECTION MUST BE OBTAINED WITHIN 180 DAYS. A PERMIT MAY BE EXTENDED IF A WRITTEN REQUEST STATING JUSTIFICATION FOR EXTENSION AND AN EXTENSION FEE IS RECEIVED PRIOR TO EXPIRATION OF THE PERMIT AND GRANTED BY THE BUILDING OFFICIAL. NO MORE THAN ONE (1) EXTENSION MAY BE GRANTED. PERMITS WHICH HAVE BECOME INVALID SHALL PAY A REACTIVATION FEE OF APPROXIMATELY 50% OF THE ORIGINAL PERMIT FEE AMOUNT WHEN THE PERMIT HAS BEEN EXPIRED FOR UP TO SIX (6) MONTHS. WHEN A PERMIT HAS BEEN EXPIRED FOR A PERIOD IN EXCESS OF ONE (1) YEAR, THE REACTIVATION FEE SHALL BE APPROXIMATELY 100% OF THE ORIGINAL PERMIT FEE. (R105.5 CRC).
26. EFFECTIVE JAN 1, 2014, SB 407 REQUIRES REPLACEMENT OF ALL NONCOMPLIANT PLUMBING FIXTURES IN PROPERTIES BUILT ON OR BEFORE JAN 1, 1994 WITH WATER-CONSERVING PLUMBING FIXTURES.
27. THE PANEL OR SUBPANEL SHALL PROVIDE CAPACITY TO INSTALL A 40-AMPERE MINIMUM DEDICATED BRANCH CIRCUIT AND SPACE(S) RESERVED TO PERMIT INSTALLATION OF A BRANCH CIRCUIT OVERCURRENT PROTECTIVE DEVICE.
28. THE SERVICE PANEL OR SUBPANEL CIRCUIT DIRECTORY SHALL IDENTIFY THE OVERCURRENT PROTECTIVE DEVICE SPACE(S) RESERVED FOR FUTURE EV CHARGING AS EV CAPABLE. THE RACEWAY TERMINATION LOCATION SHALL BE PERMANENT AND VISIBLY MARKED EV CAPABLE.
29. EARTH IMPORT AND EXPORT ACTIVITIES MAY TAKE PLACE ONLY BETWEEN THE HOURS OF 9:00 A.M. AND 3:00 P.M., MONDAY THROUGH FRIDAY
30. MIN. 1" (INSIDE DIAMETER) LISTED RACEWAY IS INSTALLED FOR EACH UNIT TO ACCOMMODATE A DEDICATED 108/240 VOLT BRANCH CIRCUIT. THE RACEWAY SHALL ORIGINATE AT THE MAIN SERVICE OR A SUBPANEL AND TERMINATE IN CLOSE PROXIMITY TO THE PROPOSED LOCATION OF THE CHARGING SYSTEM INTO A LISTED CABINET, BOX OR ENCLOSURE.
31. THE PANEL OR SUBPANEL SHALL PROVIDE CAPACITY TO INSTALL A 40-AMPERE MIN. DEDICATED BRANCH CIRCUIT AND SPACE(S) RESERVED TO PERMIT INSTALLATION OF BRANCH CIRCUIT OVERCURRENT PROTECTIVE DEVICE.
32. THE SERVICE PANEL OR SUBPANEL CIRCUIT DIRECTORY SHALL IDENTIFY THE OVERCURRENT PROTECTIVE DEVICE SPACE(S) RESERVED FOR FUTURE EV CHARGING AS EV CAPABLE. THE RACEWAY TERMINATION LOCATION SHALL BE PERMANENT AND VISIBLY MARKED EV CAPABLE.


ADU DESIGN VARIATIONS:

OPTION 1 (T)
TRADITIONAL STYLE, GABLE ROOF, SHINGLES, SMOOTH STUCCO, SIDING COMBINATION

OPTION 1 (S)
SPANISH COLONIAL STYLE, GABLE TILE ROOF, STUCCO

OPTION 2 (S)
SPANISH COLONIAL STYLE, FLAT ROOF WITH PARAPET, STUCCO

LAYOUT OF EACH OPTION CAN BE REVERSED/MIRRORED ON THE LOT

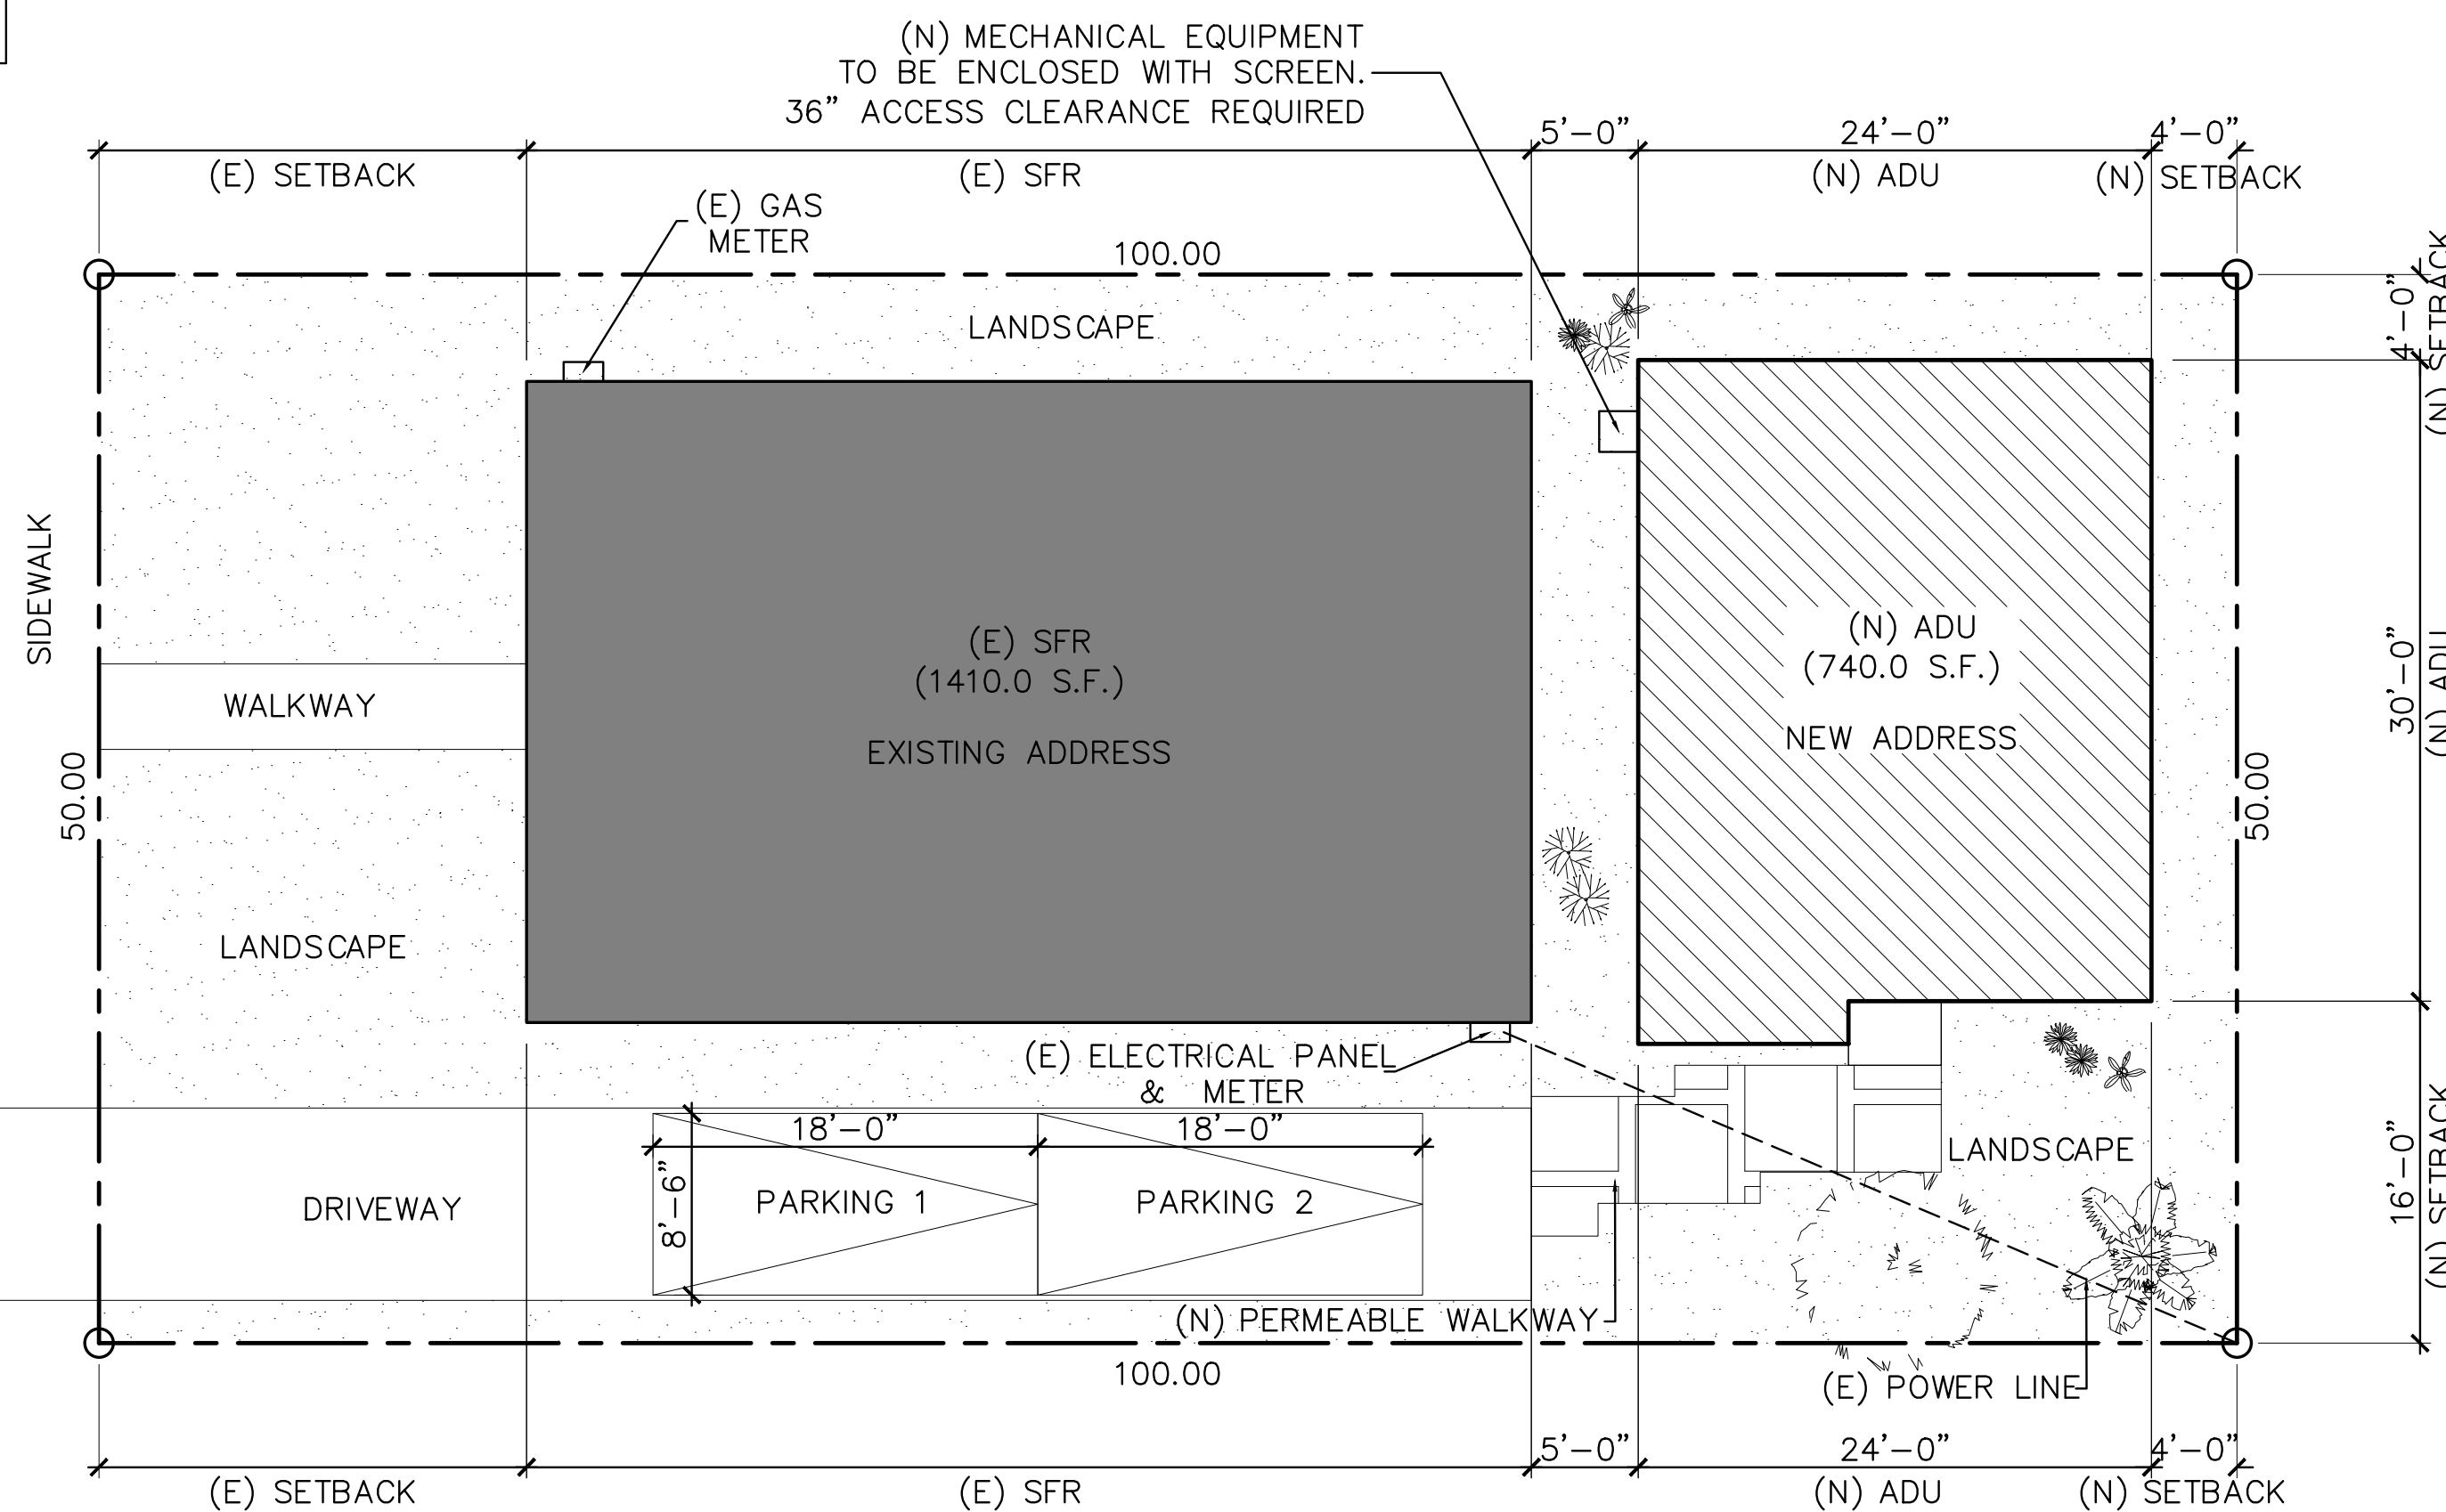


SAMPLE SITE PLAN

LEGEND

- NEW WALLS/CONSTRUCTIONS
- EXISTING WALLS/CONSTRUCTIONS
- SLOPE

Yakov Design
Drafting service
(323)922-2211
info@yakovdesign.com

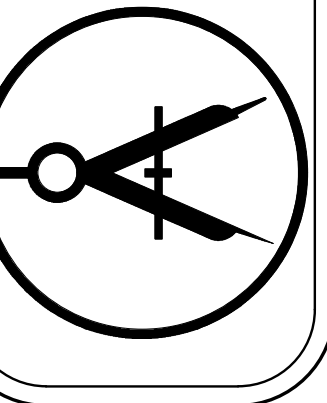

ADDRESS

SAMPLE SITE PLAN

SCALE: 1/8"=1'-0"
DATE: 04.22.2024

0.1

GENERAL NOTES:

The construction shall not restrict a five-foot clear and unobstructed access to any water or power distribution facilities (power poles, pull-boxes, transformers, vaults, pumps, valves, meters, appurtenances, etc.) or to the location of the hook-up. The construction shall not be within ten feet of any power lines-whether or not the lines are located on the property. Failure to comply may cause construction delays and /or additional expenses.

An approved Seismic Gas Shut Off Valve or Excess Flow Shut Off Valve will be installed on the fuel gas line on the down-stream side of the utility meter and be rigidly connected to the exterior of the building or structure containing the fuel gas piping. (Per Ordinance 170,158 and 180,670) Separate plumbing permit is required.

Plumbing fixtures are required to be connected to a sanitary sewer or to an (approved sewage disposal system (R306.3).

Kitchen sinks, lavatories, bathtubs, showers, bidets, laundry tubs and washing machine outlets shall be provided with hot and cold water and connected to an approved water supply (R306.4).

Bathtub and shower floors, walls above bathtubs with a showerhead, and shower compartments shall be finished with a nonabsorbent surface. Such wall surfaces shall extend to a height of not less than 6 feet above the floor (R307.2).

Provide ultra-low flush water closets for all new construction. Existing shower heads and toilets must be adapted for low water consumption.

Provide (70) (72) inch high non-absorbent wall adjacent to shower and approved shatter-resistant materials for shower enclosure. (1210.2.3, 2406.4.5, R307.2, R308.4)

Water heater must be strapped to wall. (507.3 & LAPC)

Smoke detectors shall be provided for all dwelling units intended for human occupancy, upon the owner's application for a permit for alterations, repairs, or additions, exceeding one thousand dollars (\$1,000). (R314.6.2)

Every space intended for human occupancy shall be provided with natural light by means of exterior glazed openings in accordance with Section R303.1 or shall be provided with artificial light that is adequate to provide an average illumination of 6 foot-candles over the area of the room at a height of 30 inches above the floor level. (R303.1)

A copy of the evaluation report and/or conditions of listing shall be made available at the job site

Lots shall be graded to drain surface water away from foundation walls with a minimum fall of 6 inches within the first 10 feet (R401.3)

Ducts penetrating the walls or ceilings separating the dwelling from the garage shall be constructed of a minimum No. 26 gage sheet steel or other approved material and shall not have openings into L ' the garage (R302.5.2).

Other penetrations of garage/dwelling ceilings and walls shall be protected as required by Section R302.11, Item 4 (R302.5.3).

Through penetrations of fire-resistance-rated wall or floor assemblies shall comply with Section R302.4.1.1 or R302.4.1.2.

Membrane penetrations shall comply with Section R302.4.1 Where walls are required to have a fire-resistance rating, recessed fixtures shall be installed so that the required fire-resistance rating will not be reduced.

In combustible construction, fire blocking shall be provided to cut off all concealed draft openings (both vertical and horizontal) and to form an effective fire barrier between stories, and between a top story and the roof space. (R302.1 1)

In combustible construction where there is usable space both above and below the concealed space of a floor/ceiling assembly, draftstops shall be installed so that the area of the concealed space does not exceed 1,000 square feet. Draftstopping shall divide the concealed space into approximately equal areas. (R302.12)

Sprinkler system must be approved by the Mechanical Division prior to installation.

The building shall be equipped with an automatic ' residential fire sprinkler system in accordance with section R313.3 or NFPA13D. (R313, 12.21A17(d))

A fire alarm (visual and audible) system is required. The alarm system must be approved by the Fire Department and Electrical Plan Check prior to installation. (LAMC 57.122)

Carbon monoxide alarm is required per (420.6, R315)

Heater shall be capable of maintaining a minimum room temperature of 68°F at a point 3 feet above the floor and 2 feet from exterior walls in all habitable rooms at the design temperature. (R303.9)

Buildings shall have approved address numbers, building numbers or approved building identification placed in a position that is plainly legible and visible from the street or road fronting the property. (R319.1)

Protection of wood and wood based products from decay shall be provided in the locations specified per Section R317.1 by the use of naturally durable wood or wood that is preservative-treated in accordance with AWWA U1 for the species, product, preservative and end use. Preservatives shall be listed in Section 4 of AWWA U1.

Provide anti-Graffiti finish within the first 9 feet, measured from grade, at exterior walls and doors. Exception: Maintenance of building affidavit is recorded by the owner to covenant and agree with the City of Los Angeles to remove any graffiti within 7-days of the graffiti being applied. (6306)

Glazing in hazardous locations shall be tempered (2406.4, R308.4): a. Ingress and egress doors

- Panels in sliding or swinging doors
- Doors and enclosure for hot tub, bathtub, showers (Also glazing in wall enclosing these compartments within 5' of standing surface)
- If within 2' of vertical edge of closed door and within 5' of standing surface
- In wall enclosing stairway landing
- Guards and handrails

USTile
Clay Roofing Products

PRODUCT INFORMATION



Cool Rated Product

Reflectivity: **0.31**
Aged Ref. (3 yr): **Pending**
Emmissivity: **0.86**
Aged Em. (3 yr): **Pending**
SRI: **32**
Aged SRI (3 yr): **Pending**
CRRC ID#: **0224**
Seller ID#: **0942**

Product Name: **2-Piece Mission - Red**
SKU Number: **1UADU7025-1UBDU7025**
Product Type: **Standard Weight**
Color: **Red**
Available Regions:
Nationwide

Tile Specifications:

Size: **18 x 7-8.5 in**
Coverage: **172**
Approx. Installed Weight: **1000 lbs**
Pieces per Pallet: **360**
Squares per Pallet: **2.09**
Approx. Weight per Pallet: **2150 lbs**


*Calculated Aged Value
The printed color shown here may vary from actual available tile color and should not be used to color match. Please contact your local Sales Representative for actual tile samples.
1.800.669.TILE (8453)
www.WestlakeRoyalRoofing.com

	Solar Reflectance	Initial 0.31	Weathered Pending
	Thermal Emittance	0.86	Pending
	Rated Product ID Number	0224	
	Licensed Seller ID Number	0942	
	Classification	Production Line	

Cool Roof Rating Council ratings are determined for a fixed set of conditions, and may not be appropriate for determining seasonal energy performance. The actual effect of solar reflectance and thermal emittance on building performance may vary. Manufacturer of product stipulates that these ratings were determined in accordance with the applicable Cool Roof Rating Council procedures.

GAF TRI-PLY[®] APP Granule Membrane

(Formerly Tri-Ply[®] TP-4G)

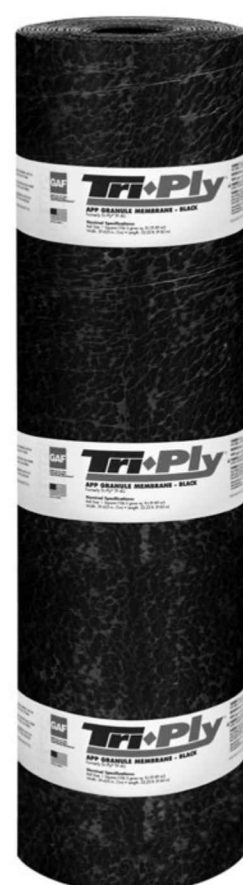

Description
Tri-Ply[®] APP Granule Membrane is a granule-surfaced modified bitumen membrane manufactured to stringent GAF specifications. Its core is a strong, resilient, non-woven polyester mat that is coated with weather-resistant APP polymer-modified asphalt.

Uses
Tri-Ply[®] APP Granule Membrane is designed for new roofing and reroofing applications, as well as flashings. It is also ideal for repair of built-up roofing membranes or other modified bitumen systems.

Advantages

- Lightweight... installed roof designs weigh less than 2 pounds per square foot (9.8 kg per square meter).

Advantages (Continued)

- Resilient... polyester mat core allows it to resist splits and tears due to its pliability and elongation characteristics.
- Durable... specially formulated modified asphalt for lasting performance.

Applicable Standards

- Meets ASTM D6222, Type I, Grade G
- FM Approved
- Miami-Dade County Product Control Approved
- UL Listed

Nominal Specifications

Roll Size	1 square roll
	136.4 gross sq. ft. (9.89 m ²)
Roll Length	32.25' (9.83 m)
Roll Width	39.6" (1 m)
Roll Weight	99 lb. (44.9 kg)

©2016 GAF 5/16

gaf.com • 1-800-ROOF-411

Westlake
Royal Roofing Solutions[™]


CertainTeed
SAINT-GOBAIN

Technical Data Sheet

Landmark Solaris[®]

PRODUCT INFORMATION

Landmark Solaris[®] innovative technology produces a shingle that reflects solar energy in a traditional color palette. All colors are rated by Cool Roof Rating Council (CRRC) and meet California's Title 24 requirements for cool steep slope roofing. Landmark Solaris shingles are manufactured using the same high standards as all CertainTeed roofing products and are covered by the same superior warranty protection. These shingles are available in "Metric" dimensions 13 1/4" x 38 3/4". This product also features CertainTeed's NailTrak[®] that offers a wider nailing area.

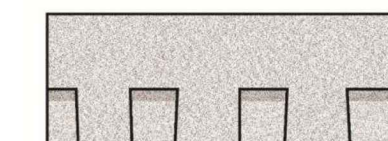

Landmark Solaris algae-resistant (AR) shingles have the additional attribute of resisting the growth of algae especially in damp regions. AR shingles are not available in all regions.

Colors: Please refer to product brochure or CertainTeed website for the colors available in your region.

Color	CRRC Product ID#	Solar Radiative Properties						Energy Star Certified?
		Solar Reflectance		Thermal Emittance		Solar Reflective Index		
		Initial	Aged	Initial	Aged	Initial	Aged	
Aged Cedar **	0668-0055	0.26	0.24	0.92	0.90	28	24	Yes
Birchwood	0668-0084	0.21	0.21	0.92	0.83	21	17	No
Burnt Sienna **	0668-0153	0.20	Pending	0.92	Pending	20	20 *	No
Crystal Gray **	0668-0058	0.27	0.26	0.93	0.90	29	27	Yes
Georgetown Gray **	0668-0116	0.20	0.20	0.91	0.92	19	20	No
Graphite **	0668-0155	0.21	Pending	0.91	Pending	21	21 *	No
Heather Blend **	0668-0117	0.20	0.20	0.91	0.92	19	20	No
Mist White **	0668-0071	0.26	0.26	0.92	0.90	28	29	Yes
Moiré Black	0668-0129	0.19	0.18	0.91	0.92	18	17	No
Mojave Tan	0668-0115	0.19	0.20	0.88	0.90	17	19	No
Resawn Shake **	0668-0118	0.19	0.20	0.92	0.93	19	20	No
Silver Birch **	0668-0072	0.26	0.27	0.90	0.89	27	28	Yes
Weathered Wood **	0668-0119	0.20	0.21	0.91	0.91	19	21	No

** Aged SRI is calculated using the California Energy Commission's Solar Reflective Index (SRI) Calculation Worksheet.
** Product meets the cool roofing requirements of Green Building Standards Code of Los Angeles County for residential buildings.

Limitations: Use on roofs with slopes greater than 2" per foot. Low-slope applications (2:12 to < 4:12) require additional underlayment. In areas prone to snow and ice, apply CertainTeed WinterGuard[®] Waterproofing Shingle Underlayment, or its equivalent along the eaves, according to application instructions provided with the product and on the shingle package.

Product Composition: Landmark Solaris shingles are composed of a fiber glass mat base. Ceramic-coated mineral granules with high solar reflectance are tightly embedded in carefully refined, water-resistant asphalt. Two pieces of the shingle are firmly laminated together in special tough asphaltic cement. All Landmark Solaris shingles have self-sealing adhesive strips.

Technical Data Sheet

Landmark Solaris

Page 2 of 2

Applicable Standards:

ASTM E108 Class A Fire Resistance	ASTM D7158 Class H Wind Resistance
UL 790 Class A Fire Resistance	CSA Standard A123.5
ASTM D3462	ICC-ES ESR-1389 & ESR-3537
ASTM D3018 Type I	Florida Product Approval # FL5444
ASTM D3161 Class F Wind Resistance	Can be used to comply with California Title 24, Part 6 (Steep Slope)
Miami-Dade County Product Control Approved	
Meets TDI Windstorm Requirements	

Technical Data:

Weight/Square (approx.)	216 lb
Shingles/Square (approx.)	66 *
Dimensions (overall)	13 1/4" x 38 3/4"
Weather Exposure	5 5/8"

*Based on 100 sq. ft. of exposed area.

INSTALLATION

Detailed installation instructions are supplied on each bundle of shingles and must be followed. Separate application sheets may also be obtained from CertainTeed.

Hips and Ridges: Use CertainTeed Shadow Ridge[®] or Mountain Ridge[®] shingles of a like color for capping hips and ridges.

MAINTENANCE

These shingles do not require maintenance when installed according to manufacturer's application instructions. However, to protect the investment, any roof should be routinely inspected at least once a year. Older roofs should be looked at more frequently.

WARRANTY

Landmark Solaris shingles carry a Lifetime Limited Warranty and 10-year SureStart[™] protection when applied to stated CertainTeed application instructions for this product. Landmark Solaris AR shingles carry a 10-year algae resistance warranty. For specific warranty details and limitations, refer to the warranty itself (available from the local supplier, roofing contractor or on-line at www.certainteed.com).

FOR MORE INFORMATION


Sales Support Group: 800-233-8990
Web site: www.certainteed.com

CertainTeed
20 Moores Road
Malvern, PA 19355

© 12/20 CertainTeed

CertainTeed
SAINT-GOBAIN

Yakov Design
Drafting service
(323)922-2211
info@yakovdesign.com

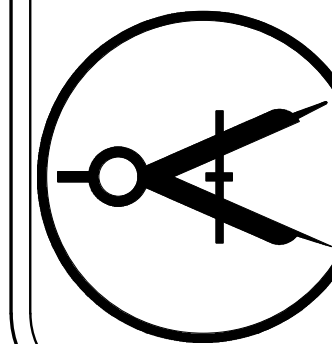

ADDRESS

GENERAL NOTES,
ROOF SPECIFICATIONS

SCALE:

DATE: 04.22.2024

0.2

Job Name: _____
Tag# _____



Submittal Data Sheet FTXB18AXVJU / RXB18AXVJU
1.5-Ton Wall Mounted Heat Pump System



10 YEAR PARTS LIMITED WARRANTY

Complete warranty details available from your local dealer or at www.daikincomfort.com. To receive the 10-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Online registration is not required in California or Quebec. If product is installed in a commercial application, limited warranty period is 5 years.

Indoor Specifications				
Airflow Rate (cfm)	Cooling		Heating	
	H	M	H	M
	430	374	435	374
	L		L	
	318		318	
Sound (dBA) H / M / L	40 / 37 / 35		40 / 37 / 35	
Dimensions (H x W x D) (in)	12-5/8 x 46-1/8 x 9-1/2			
Weight (lbs)	31			

Outdoor Specifications				
Compressor	Hermetically Sealed Swing Type			
Refrigerant	R-410A			
Factory Charge (lbs)	2.75			
Refrigerant Oil	PVE (FVCSOK)			
Airflow Rate (cfm)	Cooling		Heating	
	H	M	H	M
	1690	1690	1690	1690
Sound Pressure Level (dBA) H / M / L	53			
Dimensions (H x W x D) (in)	25-11/16 x 33-11/16 x 12-15/16			
Weight (lbs)	82			

DAIKIN North America LLC San Felipe, Suite 500 Houston, TX 77056
 (Daikin's products are subject to continuous improvements. Daikin reserves the right to modify product design, specifications and information in this data sheet without notice and without incurring any obligations.)
 Submittal Revision Date: March 2021 Page 1 of 4

FTXB18AXVJU / RXB18AXVJU Performance Tables

AFR (CFM)	EER	SEER	Outdoor Temperature																							
			66.2°F						77.0°F						88.0°F						98.0°F					
			TC	SC	PI	TC	SC	PI	TC	SC	PI	TC	SC	PI	TC	SC	PI	TC	SC	PI	TC	SC	PI	TC	SC	PI
61.6†	12.6†	12.6†	1.27	1.27	1.27	1.31	1.31	1.31	1.35	1.35	1.35	1.39	1.39	1.39	1.43	1.43	1.43	1.47	1.47	1.47	1.51	1.51	1.51	1.55	1.55	1.55
318	87.0†	87.0†	1.27	1.27	1.27	1.31	1.31	1.31	1.35	1.35	1.35	1.39	1.39	1.39	1.43	1.43	1.43	1.47	1.47	1.47	1.51	1.51	1.51	1.55	1.55	1.55
374	87.0†	87.0†	1.27	1.27	1.27	1.31	1.31	1.31	1.35	1.35	1.35	1.39	1.39	1.39	1.43	1.43	1.43	1.47	1.47	1.47	1.51	1.51	1.51	1.55	1.55	1.55
430	87.0†	87.0†	1.27	1.27	1.27	1.31	1.31	1.31	1.35	1.35	1.35	1.39	1.39	1.39	1.43	1.43	1.43	1.47	1.47	1.47	1.51	1.51	1.51	1.55	1.55	1.55

Indoor DB°F	Outdoor WB°F															
	5.0				14.0				23.0				32.0			
	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
60.8	89.1	1.14	1.1141	1.23	1.3002	1.30	1.3493	1.38	1.4086	1.48	1.5814	1.54				
68.4	89.8	1.20	1.1049	1.28	1.3340	1.35	1.3460	1.44	1.3953	1.53	1.4771	1.50				
68.0	87.96	1.25	1.0956	1.34	1.3148	1.41	1.3300	1.50	1.3900	1.59	1.3629	1.66				
69.8	87.65	1.28	1.0925	1.37	1.3086	1.44	1.3246	1.52	1.3720	1.62	1.3558	1.68				
71.6	87.03	1.31	1.0895	1.39	1.3055	1.47	1.3215	1.55	1.3688	1.65	1.3536	1.71				
75.2	86.11	1.37	1.0860	1.45	1.2982	1.53	1.3132	1.61	1.3715	1.70	1.3444	1.77				

Remark:
 AFR: Air flow rate (CFM)
 EWB: Entering Wet Bulb Temp. (°F)
 EDB: Entering Dry Bulb Temp. (°F)
 TC: Total Cooling Capacity (Btu/hr)
 SC: Sensible Cooling Capacity (Btu/hr)
 PI: Power input (kW)

Notes:
 1. Ratings shown are net capacities.
 2. Shows nominal capacities.
 3. Direct interpolation is permissible. Do not extrapolate.

DAIKIN North America LLC San Felipe, Suite 500 Houston, TX 77056
 (Daikin's products are subject to continuous improvements. Daikin reserves the right to modify product design, specifications and information in this data sheet without notice and without incurring any obligations.)
 Submittal Revision Date: March 2021 Page 4 of 4

PERFORMANCE PLATINUM™ High Efficiency Condensing Tankless Gas Water Heaters are designed to provide continuous hot water

Efficiency
 • 93 UEF with stainless steel condensing heat exchanger
 • **Easy Installation and Service**
 • NEW! 2" venting connections
 • NEW! Vent up to 150 ft with 3" PVC and 80 ft with 2" PVC
 • Built-in condensate neutralizer
 • 1/2" Gas line compatibility up to 24 ft.
 • NEW! Includes easy to install hanging bracket for time savings (indoor models only)
 • **Exclusive Maintenance Notice Setting** - Alerts homeowner after 500 hours of use, to call for service (optional)
 • Self-diagnostic system for easy installation and service
 • High-altitude capability - up to 8,400 ft. elevation above sea level¹
 • Digital remote control now pre-wired!
 • 10 ft. of thermostat wire included - shows temperature setting and service codes
 • Requires 120V power supply

Environmentally Friendly
 • **Low Emissions** - Ultra low NOx burner meets SCAGMD rule 1146.2 requirements
 • **Exclusive Water Savings Setting** - Saves up to 1,100 gallons water/year by reducing flow at the tap until set temperature is achieved (optional)
 • **Safety**
 • **Exclusive Overheat film wrap** - prevents dangerous temperatures and provides industry best side-to-side clearance of 1/2 inch
 • Maximum water temperature is 140°F. For higher temperature applications, upgrade kits are available
 • **Warranty**
 • 12-Year heat exchanger - residential, 5-year parts and 1-year labor
 • See Warranty Certificate for complete information

Performance
 • **Industry Leading! Low Flow Activation** - Minimum flow rate of .26 GPM and minimum activation flow rate of .40 GPM ensures hot water even in low demand situations
 • **Recirculation Pump Kit-Ready** - Providing faster hot water at the tap and savings of up to 12,000 gallons water/year²
 • **Exclusive Hot Start Programming** - Minimizes cold water bursts by staying in ready-fire state for back-to-back hot water requests
 • **Technology**
 • **EcoNet® Enabled** - all Tankless products from 2010 to present can connect to EcoNet mobile app via Tankless EcoNet Accessory Kit (REWRAG30TVH)
 • For higher demand applications, easily link multiple tankless units to operate as one system (20 units max. additional accessories required)



Indoor Direct Vent Outdoor
PERFORMANCE PLATINUM™ High Efficiency Condensing Tankless
 11,000-199,900 BTU/h

EcoNet™ PERFORMANCE PLATINUM Tankless Water Heater with EcoNet™ WiFi Included

Shares all efficiency, performance, technology, warranty and safety values as standard models, with added WiFi capability.

Smart Home Features
 • Water leak detection alert and system shut off (indoor models only) - may qualify for insurance discounts
 • Mobile alerts for notifications/maintenance reminders
 • Mobile gas and water usage reports
 • Integration with NEST & WINK smart home systems

Product Includes
 • Factory-installed translator
 • Leak detection cable (for indoor models)
 • Wi-Fi Module, connection cable and power cord

ECH200DVLN-2 Indoor Direct Vent with EcoNet™
 11,000-199,900 BTU/h Only (Outdoor model also available)

Available on the Google play App Store

1202 FORM NO. THD-2019 Rev. 2

PERFORMANCE PLATINUM™ Hybrid Electric is the most efficient water heater available

Efficiency
 • High 3.75 - 4.07 UEF reduces operating cost
 • ENERGY STAR® rated
 • **Performance**
 • Delivers hot water faster than most standard electric water heaters - 60-87 gallons first-hour delivery, depending on model
 • Ambient operating range: 37-145° F is widest in class, offering more days of HP operation annually, designed to meet Northern Climate Spec (Tier 4)
 • **Easy Installation**
 • Easy access side connections
 • Quick access to electrical junction box
 • Easily replaces a standard electric water heater
 • **Integration**
 • Electronic control for easy temperature adjustment and mode management
 • Audible alarm for service alerts

Operation Modes
 • Energy Saver
 • Heat Pump
 • High Demand
 • Electric
 • Vacation/Away: 2-28 days (or placed on hold indefinitely)
 • Premium grade anode rod with sacrificial extends the life of the tank
 • 3/4" NPT water inlet and outlet;
 • 3/4" condensate drain connections
 • Incoloy stainless steel resistor elements
 • Dry-fire protection
 • Easy access, top mounted washable air filter
 • 2" Non-CFC foam insulation
 • Enhanced flow brass drain valve
 • Temperature and pressure relief valve installed
 • Design certified to NSF/ANSI 372 (Lead Contention)
 • **Warranty**
 • 10-Year limited warranty for tank and parts, 1-year full in-home labor warranty
 • See Residential Warranty Certificate for complete information
 • Units meet or exceed ANSI requirements and have been tested according to D.O.E. procedures. Units meet or exceed the energy efficiency requirements of NAECA, ASHRAE standard 90, ICC Code and all state energy efficiency performance criteria.
 • *WiFi broadband internet connection required




PERFORMANCE PLATINUM™ Hybrid
 40, 50, 65 and 80-Gallon Capacities
 208-240 Volt / 1 PH Electric

See specifications chart on back.

1202 FORM NO. THD-FHE-2019 Rev. 3

PERFORMANCE PLATINUM™ Condensing Tankless Specifications


MODEL NUMBER	DESCRIPTION	TYPE	TEMP. RANGE	FEATURES				ROUGH-IN DIMENSIONS (SHOWN IN INCHES)										ENERGY INFO.
				MIN. FLOW ACT. GPM	GPM FREE MAX.	GPM MAX. MAC.	GPM MAX. WTR.	CONNECTION GAS	HEIGHT	WIDTH	DEPTH	VENT DIAM.	RIP WEIGHT (LBS.)	UNIFORM FACTOR				
ECH200DVLN-2	11,000-199,900	Indoor	80° to 140° F	0.26/0.40	5.7	8.5	9.5	3/4	3/4	27-1/2	18-1/2	9-3/4	2" or 2" PVC 2-Pipe	82	0.93			
ECH200DVLN-2 EcoNet® Enabled	11,000-199,900	Indoor	80° to 140° F	0.26/0.40	5.7	8.5	9.5	3/4	3/4	27-1/2	18-1/2	9-3/4	2" or 2" PVC 2-Pipe	82	0.93			
ECH200DLN-2	11,000-199,900	Outdoor	80° to 140° F	0.26/0.40	5.6	8.5	9.5	3/4	3/4	27-1/2	18-1/2	9-3/4	N/A	82	0.93			
ECH200DLN-2 EcoNet® Enabled	11,000-199,900	Outdoor	80° to 140° F	0.26/0.40	5.6	8.5	9.5	3/4	3/4	27-1/2	18-1/2	9-3/4	N/A	82	0.93			
ECH180DVLN-2	11,000-199,900	Indoor	80° to 140° F	0.26/0.40	5.2	7.7	9.0	3/4	3/4	27-1/2	18-1/2	9-3/4	2" or 2" PVC 2-Pipe	82	0.93			
ECH180DLN-2	11,000-199,900	Outdoor	80° to 140° F	0.26/0.40	5.2	7.7	9.0	3/4	3/4	27-1/2	18-1/2	9-3/4	N/A	82	0.93			
ECH180DLN-2 EcoNet® Enabled	11,000-199,900	Outdoor	80° to 140° F	0.26/0.40	5.2	7.7	9.0	3/4	3/4	27-1/2	18-1/2	9-3/4	N/A	82	0.93			
ECH140DLN-2	11,000-199,900	Outdoor	80° to 140° F	0.26/0.40	4.6	6.7	8.4	3/4	3/4	27-1/2	18-1/2	9-3/4	2" or 2" PVC 2-Pipe	82	0.93			
ECH140DLN-2 EcoNet® Enabled	11,000-199,900	Outdoor	80° to 140° F	0.26/0.40	4.6	6.7	8.4	3/4	3/4	27-1/2	18-1/2	9-3/4	N/A	82	0.93			

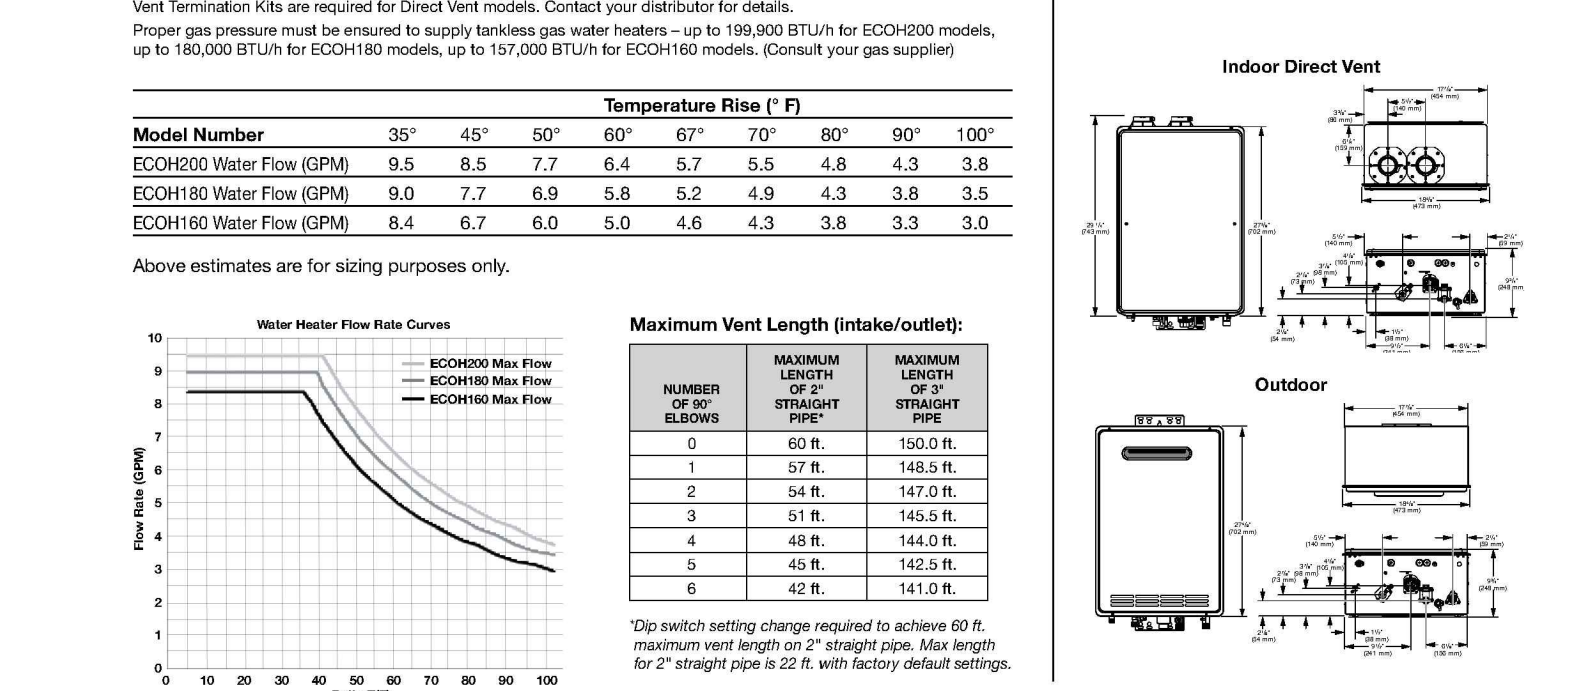

Parts and Accessories
 Venting & terminations - 2" or 3" PVC, recess boxes, pipe covers, extra remote controls, EZ-Link™ cable, manifolds and cables, service valve kits, service parts, flush kits, recirculation pump kits and AiCirc™ water treatment system. For more information on Tankless parts and accessories, see the Parts and Accessories Catalog or call 866-720-2076.

In keeping with its policy of continuous progress and product improvement, Rheem reserves the right to make changes without notice.
 Rheem Water Heating • 1115 Northmeadow Parkway, Suite 100
 Roswell, Georgia 30076 • www.rheem.com
 1202 FORM NO. THD-30 Rev. 2

Yakov Design
 Drafting service
 (323)922-2211
 info@yakovdesign.com

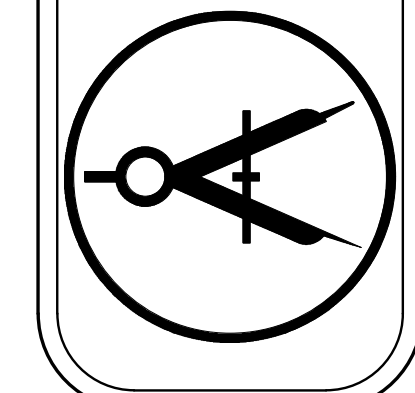

ADDRESS

MECHANICAL EQUIPMENT SPECIFICATIONS

SCALE:
 DATE: 04.22.2024

0.3

CERTIFICATE OF COMPLIANCE
 Project Name: Proposed ADU for Standard Plan
 Calculation Description: Title 24 Analysis
 Calculation Date/Time: 2021-04-01T15:35:09-07:00
 Input File Name: 21-0006-Standard ADU.rbd19x
 CF1R-PRF-01E (Page 1 of 8)

GENERAL INFORMATION	01	02	03	04	05	06	07	08	09	10	11	12	13	14	15	16	17	18	19	20	21	22
Project Name	Proposed ADU for Standard Plan																					
Run Title	Title 24 Analysis																					
Project Location																						
City	05	Standards Version																				
Zip code	07	Software Version																				
Climate Zone	09	Front Orientation (deg/ Cardinal)																				
Building Type	11	Number of Dwelling Units																				
Project Scope	13	Number of Bedrooms																				
Addition Cond. Floor Area (ft²)	15	Number of Stories																				
Existing Cond. Floor Area (ft²)	17	Fenestration Average U-factor																				
Total Cond. Floor Area (ft²)	19	Glazing Percentage (%)																				
ADU Bedroom Count	n/a	ADU Conditioned Floor Area																				
Is Natural Gas Available?	Yes																					

COMPLIANCE RESULTS

01	Building Complies with Computer Performance
02	This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.
03	This building incorporates one or more Special Features shown below

Registration Number: 421-P010045938A-000-000-0000000-0000
 Registration Date/Time: 04/01/2021 15:33
 HERS Provider: CHEERS
 NOTE: This document has been generated by Control Home Energy Efficiency Rating System Services, Inc. (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
 CA Building Energy Efficiency Standards - 2019 Residential Compliance
 Report Version: 2019.1.300
 Report Generated: 2021-04-01 15:35:36
 Schema Version: rev 20200901

CERTIFICATE OF COMPLIANCE
 Project Name: Proposed ADU for Standard Plan
 Calculation Description: Title 24 Analysis
 Calculation Date/Time: 2021-04-01T15:35:09-07:00
 Input File Name: 21-0006-Standard ADU.rbd19x
 CF1R-PRF-01E (Page 2 of 8)

ENERGY DESIGN RATINGS		Compliance Margins		
	Efficiency (EDR)	Total (EDR)	Efficiency (EDR)	Total (EDR)
Standard Design	50.3	22.4		
Proposed Design	50	22.1	0.3	0.3

RESULT: 3 COMPLIES

- Efficiency EDR includes improvements to the building envelope and more efficient equipment
- Total EDR includes efficiency and demand response measures such as photovoltaic (PV) systems and batteries
- Building complies when efficiency and total compliance margins are greater than or equal to zero

- Standard Design PV Capacity: 1.60 kWdc
- PV System resized to 1.60 kWdc (a factor of 1.597) to achieve Standard Design PV PV scaling

ENERGY USE SUMMARY				
Energy Use (kWh/ft²-yr)	Standard Design	Proposed Design	Compliance Margin	Percent Improvement
Space Heating	3.14	3.58	-0.44	-14
Space Cooling	16.74	17.7	-0.96	-5.7
IAQ Ventilation	2.92	2.92	0	0
Water Heating	24.12	21.74	2.38	9.9
Self Utilization/Flexibility Credit	n/a	0	0	n/a
Compliance Energy Total	46.92	45.94	0.98	2.1

REQUIRED PV SYSTEMS - SIMPLIFIED											
01	02	03	04	05	06	07	08	09	10	11	12
DC System Size (kWdc)	Exception	Module Type	Array Type	Power Electronics	CFI	Azimuth (deg)	Tilt Input	Array Angle (deg)	Tilt: (x in 12)	Inverter Eff. (%)	Annual Solar Access (%)
1.6	NA	Standard	Fixed	none	true	150-270	n/a	n/a	<=7.12	96	100

Registration Number: 421-P010045938A-000-000-0000000-0000
 Registration Date/Time: 04/01/2021 15:33
 HERS Provider: CHEERS
 NOTE: This document has been generated by Control Home Energy Efficiency Rating System Services, Inc. (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
 CA Building Energy Efficiency Standards - 2019 Residential Compliance
 Report Version: 2019.1.300
 Report Generated: 2021-04-01 15:35:36
 Schema Version: rev 20200901

CERTIFICATE OF COMPLIANCE
 Project Name: Proposed ADU for Standard Plan
 Calculation Description: Title 24 Analysis
 Calculation Date/Time: 2021-04-01T15:35:09-07:00
 Input File Name: 21-0006-Standard ADU.rbd19x
 CF1R-PRF-01E (Page 3 of 8)

REQUIRED SPECIAL FEATURES

The following are features that must be installed as condition for meeting the modeled energy performance for this computer analysis.

- Insulation below roof deck
- Variable capacity heat pump compliance option (verification details from VCHP Staff report, Appendix B, and RA3)

HERS FEATURE SUMMARY

The following is a summary of the features that must be field-verified by a certified HERS Rater as a condition for meeting the modeled energy performance for this computer analysis. Additional detail is provided in the building tables below. Registered CF2Rs and CF3Rs are required to be completed in the HERS Registry

Building Level Verifications:

- Indoor air quality ventilation
- Kitchen range hood

Cooling System Verifications:

- Verified EER
- Verified SEER
- Verified Refrigerant Charge
- Airflow in habitable rooms (SC3.1.4.1.7)

Heating System Verifications:

- Verified HSPF
- Verified heat pump rated heating capacity
- Wall-mounted thermostat in zones greater than 150 ft² (SC3.4.5)
- Ductless indoor units located entirely in conditioned space (SC3.1.4.1.8)

HVAC Distribution System Verifications:

- None

Domestic Hot Water System Verifications:

- None

BUILDING - FEATURES INFORMATION						
01	02	03	04	05	06	07
Project Name	Conditioned Floor Area (ft²)	Number of Dwelling Units	Number of Bedrooms	Number of Zones	Number of Ventilation Cooling Systems	Number of Water Heating Systems
Proposed ADU for Standard Plan	740	1	1	1	0	1

Registration Number: 421-P010045938A-000-000-0000000-0000
 Registration Date/Time: 04/01/2021 15:33
 HERS Provider: CHEERS
 NOTE: This document has been generated by Control Home Energy Efficiency Rating System Services, Inc. (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
 CA Building Energy Efficiency Standards - 2019 Residential Compliance
 Report Version: 2019.1.300
 Report Generated: 2021-04-01 15:35:36
 Schema Version: rev 20200901

CERTIFICATE OF COMPLIANCE
 Project Name: Proposed ADU for Standard Plan
 Calculation Description: Title 24 Analysis
 Calculation Date/Time: 2021-04-01T15:35:09-07:00
 Input File Name: 21-0006-Standard ADU.rbd19x
 CF1R-PRF-01E (Page 4 of 8)

ZONE INFORMATION						
01	02	03	04	05	06	07
Zone Name	Zone Type	HVAC System Name	Zone Floor Area (ft²)	Avg. Ceiling Height	Water Heating System 1	Water Heating System 2
Proposed ADU	Conditioned	ADU Mini Split1	740	8	DHW Sys 1	N/A

OPAQUE SURFACES							
01	02	03	04	05	06	07	08
Name	Zone	Construction	Azimuth	Orientation	Gross Area (ft²)	Window and Door Area (ft²)	Tilt (deg)
North Wall	Proposed ADU	R-15 Wall	270	Front	200	16	90
West Wall	Proposed ADU	R-15 Wall	180	Right	266.66	5.25	90
South Wall	Proposed ADU	R-15 Wall	90	Back	200	60	90
East Wall	Proposed ADU	R-15 Wall	0	Left	266.66	0	90
Roof	Proposed ADU	R-30 Roof Attic	n/a	n/a	740	n/a	n/a

ATTIC							
01	02	03	04	05	06	07	08
Name	Construction	Type	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof
Attic Proposed ADU	Attic RoofProposed ADU	Ventilated	4	0.1	0.85	No	No

FENESTRATION / GLAZING													
01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
48 x 48 Window	Window	North Wall	Front	270	1	16	0.3	NFRC	0.23	NFRC	0.23	NFRC	Bug Screen
42 x 18 Window	Window	West Wall	Right	180	1	5.25	0.3	NFRC	0.23	NFRC	0.23	NFRC	Bug Screen
72 x 60 Window	Window	South Wall	Back	90	1	30	0.3	NFRC	0.23	NFRC	0.23	NFRC	Bug Screen
72 x 60 Window 2	Window	South Wall	Back	90	1	30	0.3	NFRC	0.23	NFRC	0.23	NFRC	Bug Screen

Registration Number: 421-P010045938A-000-000-0000000-0000
 Registration Date/Time: 04/01/2021 15:33
 HERS Provider: CHEERS
 NOTE: This document has been generated by Control Home Energy Efficiency Rating System Services, Inc. (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
 CA Building Energy Efficiency Standards - 2019 Residential Compliance
 Report Version: 2019.1.300
 Report Generated: 2021-04-01 15:35:36
 Schema Version: rev 20200901

CERTIFICATE OF COMPLIANCE
 Project Name: Proposed ADU for Standard Plan
 Calculation Description: Title 24 Analysis
 Calculation Date/Time: 2021-04-01T15:35:09-07:00
 Input File Name: 21-0006-Standard ADU.rbd19x
 CF1R-PRF-01E (Page 5 of 8)

SLAB FLOORS							
01	02	03	04	05	06	07	08
Name	Zone	Area (ft²)	Perimeter (ft)	Edge Insul. R-value and Depth	Edge Insul. R-value and Depth	Carpeted Fraction	Heated
Slab-on-Grade	Proposed ADU	740	112	none	0	80%	No

OPAQUE SURFACE CONSTRUCTIONS							
01	02	03	04	05	06	07	08
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous R-value	U-factor	Assembly Layers
R-15 Wall	Exterior Walls	Wood Framed Wall	2x4 @ 16 in. O. C.	R-15	R-8 / None	0.05	Inside Finish: Gypsum Board Sheathing / Insulation: R-8 Sheathing Cavity / Frame: R-15 / 2x4 Exterior Finish: 3 Coat Stucco
Attic RoofProposed ADU	Attic Roofs	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-15	None / None	0.07	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Siding/Sheathing/decking Cavity / Frame: R-13.0 / 2x4 Around Roof Joists: R-2.0 Insul.
R-30 Roof Attic	Ceilings (below attic)	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-30	None / None	0.032	Over Ceiling Joists: R-20.9 Insul. Cavity / Frame: R-9.1 / 2x4 Inside Finish: Gypsum Board

BUILDING ENVELOPE - HERS VERIFICATION			
01	02	03	04
Quality Insulation Installation (QII)	High R-value Spray Foam Insulation	Building Envelope Air Leakage	CFM50
Not Required	Not Required	Not Required	n/a

Registration Number: 421-P010045938A-000-000-0000000-0000
 Registration Date/Time: 04/01/2021 15:33
 HERS Provider: CHEERS
 NOTE: This document has been generated by Control Home Energy Efficiency Rating System Services, Inc. (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
 CA Building Energy Efficiency Standards - 2019 Residential Compliance
 Report Version: 2019.1.300
 Report Generated: 2021-04-01 15:35:36
 Schema Version: rev 20200901

CERTIFICATE OF COMPLIANCE
 Project Name: Proposed ADU for Standard Plan
 Calculation Description: Title 24 Analysis
 Calculation Date/Time: 2021-04-01T15:35:09-07:00
 Input File Name: 21-0006-Standard ADU.rbd19x
 CF1R-PRF-01E (Page 6 of 8)

WATER HEATING SYSTEMS						
01	02	03	04	05	06	07
Name	System Type	Distribution Type	Water Heater Name (#)	Solar Heating System	Compact Distribution	HERS Verification
DHW Sys 1	Domestic Hot Water (DHW)	Standard Distribution System	DHW Heater 1 (1)	n/a	None	n/a

WATER HEATERS											
01	02	03	04	05	06	07	08	09	10	11	12
Name	Heating Element Type	Tank Type	# of Units	Tank Vol. (gal)	Energy Factor or Efficiency	Input Rating or Pilot	Tank Insulation R-value (Int/Ext)	Standby Loss or Recovery Eff	1st Hr. Rating or Flow Rate	NEEA Heat Pump Brand or Model	Tank Location or Ambient Condition
DHW Heater 1	Gas	Consumer Instantaneous	1	0	0.94-UEF	200000-Btu/Hr	0	n/a	n/a	n/a	n/a

WATER HEATING - HERS VERIFICATION							
01	02	03	04	05	06	07	08
Name	Pipe Insulation	Parallel Piping	Compact Distribution	Compact Distribution Type	Recirculation Control	Central DHW Distribution	Shower Drain Water Heat Recovery
DHW Sys 1 -1/1	Not Required	Not Required	Not Required	None	Not Required	Not Required	Not Required

SPACE CONDITIONING SYSTEMS										
01	02	03	04	05	06	07	08	09	10	11
Name	System Type	Heating Unit Name	Cooling Unit Name	Fan Name	Distribution Name	Required Thermostat Type	Status	Verified Existing Condition	Heating Equipment Count	Cooling Equipment Count
ADU Mini Split1	Heat pump heating cooling	Heat Pump System 1	Heat Pump System 1	n/a	n/a	Setback	New	NA	1	1

Registration Number: 421-P010045938A-000-000-0000000-0000
 Registration Date/Time: 04/01/2021 15:33
 HERS Provider: CHEERS
 NOTE: This document has been generated by Control Home Energy Efficiency Rating System Services, Inc. (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
 CA Building Energy Efficiency Standards - 2019 Residential Compliance
 Report Version: 2019.1.300
 Report Generated: 2021-04-01 15:35:36
 Schema Version: rev 20200901

CERTIFICATE OF COMPLIANCE
 Project Name: Proposed ADU for Standard Plan
 Calculation Description: Title 24 Analysis
 Calculation Date/Time: 2021-04-01T15:35:09-07:00
 Input File Name: 21-0006-Standard ADU.rbd19x
 CF1R-PRF-01E (Page 7 of 8)

HVAC - HEAT PUMPS										
01	02	03	04	05	06	07	08	09	10	11
Name	System Type	Number of Units	Heating		Cooling		Zonality Controlled	Compressor Type	HERS Verification	
Heat Pump System 1	VCHP-ductless	1	HSPF/COP	Cap 47	Cap 17	SEER	EER/CEER	Single Speed	Heat Pump System 1-HERS-hpump	

HVAC HEAT PUMPS - HERS VERIFICATION								
01	02	03	04	05	06	07	08	09
Name	Verified Airflow	Airflow Target	Verified EER	Verified SEER	Verified Refrigerant Charge	Verified HSPF	Verified Heating Cap 47	Verified Heating Cap 17
Heat Pump System 1-HERS-hpump	Not Required	0	Required	Required	Yes	Yes	Yes	Yes

VARIABLE CAPACITY HEAT PUMP COMPLIANCE OPTION - HERS VERIFICATION									
01	02	03	04	05	06	07	08	09	10
Name	Certified Low-Static VCHP System	Airflow to Habitable Rooms	Ductless Units in Conditioned Space	Wall Mount Thermostat	Air Filter/Static Damp: Pressure Drop Rating	Low Leakage Ducts in Conditioned Space	Minimum Airflow per RA3.3 and SC3.3.4.1	Certified non-continuous Fan	Indoor fan not Running Continuously
Heat Pump System 1	Not required	Required	Required	Required	Not required	Not required	Not required	Not required	Not required

IAQ (INDOOR AIR QUALITY) FANS					
01	02	03	04	05	06
Dwelling Unit	IAQ CFM	IAQ Watts/CFM	IAQ Fan Type	IAQ Recovery Effectiveness (%)	IAQ Recovery Effectiveness -SRE
5Fam IAQVentRgt	37	0.25	Default	0	n/a

Registration Number: 421-P010045938A-000-000-0000000-0000
 Registration Date/Time: 04/01/2021 15:33
 HERS Provider: CHEERS
 NOTE: This document has been generated by Control Home Energy Efficiency Rating System Services, Inc. (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
 CA Building Energy Efficiency Standards - 2019 Residential Compliance
 Report Version: 2019.1.300
 Report Generated: 2021-04-01 15:35:36
 Schema Version: rev 20200901

CERTIFICATE OF COMPLIANCE
 Project Name: Proposed ADU for Standard Plan
 Calculation Description: Title 24 Analysis
 Calculation Date/Time: 2021-04-01T15:35:09-07:00
 Input File Name: 21-0006-Standard ADU.rbd19x
 CF1R-PRF-01E (Page 8 of 8)

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT

I, I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: Martin Blas
 Signature: *Martin Blas*
 Date Signed: 04/01/2021
 Address: 5535 Westlawn Ave #376
 City/State/Zip: Los Angeles, CA 90066
 Phone: 5623228070

RESPONSIBLE PERSON'S DECLARATION STATEMENT

I certify the following under penalty of perjury, under the laws of the State of California:

- I am eligible under Division 9 of the Business and Professions Code to accept responsibility for the building design identified on this Certificate of Compliance.
- I certify that the energy features and performance specifications identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
- The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.

Responsible Designer Name: Martin Blas
 Signature: *Martin Blas*
 Date Signed: 04/01/2021
 Address: 5535 Westlawn Ave #376
 City/State/Zip: Los Angeles, CA 90066
 Phone: 5623228070

Digitally signed by Control Home Energy Efficiency Rating System Services, Inc. (CHEERS). This digital signature is provided in order to secure the content of this registered document, and it is not a way to transfer registration responsibility for the accuracy of the information.

Registration Number: 421-P010045938A-000-000-0000000-0000
 Registration Date/Time: 04/01/2021 15:33
 HERS Provider: CHEERS
 NOTE: This document has been generated by Control Home Energy Efficiency Rating System Services, Inc. (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
 CA Building Energy Efficiency Standards - 2019 Residential Compliance
 Report Version: 2019.1.300
 Report Generated: 2021-04-01 15:35:36
 Schema Version: rev 20200901

NOTE:
 TITLE 24 CALCULATIONS WAS PROVIDED FOR ALL ORIENTATIONS,
 AND THE WORST-CASE SCENARIO IS PRESENTED.



2019 Low-Rise Residential Mandatory Measures Summary

NOTE: Low-rise residential buildings subject to the Energy Standards must comply with all applicable mandatory measures, regardless of the compliance approach used. Review the respective section for more information. *Exceptions may apply. (01/20/20)

Table with 2 columns: Measure ID and Description. Includes sections for Building Envelope Measures, Fireplaces, Space Conditioning, and Water Heating.



2019 Low-Rise Residential Mandatory Measures Summary

Table with 2 columns: Measure ID and Description. Includes sections for Clearances, Liquid Line Drier, Storage Tank Insulation, Water Piping, Insulation Protection, Gas or Propane Water Heating Systems, Recirculating Loops, Ducts and Fans Measures, and Factory-Fabricated Duct Systems.



2019 Low-Rise Residential Mandatory Measures Summary


Table with 2 columns: Measure ID and Description. Includes sections for Requirements for Ventilation and Indoor Air Quality, Pool and Spa Systems and Equipment Measures, and Lighting Measures.

HVAC SYSTEM HEATING AND COOLING LOADS SUMMARY


Project Name: Proposed ADU for Standard Plan, Date: 4/1/2021, System Name: ADU Mini Split, Floor Area: 740

Table showing Engineering Checks, System Load, HVAC Equipment Selection, and Time of System Peak. Includes columns for Heating System, Cooling System, and Total Room Loads.

HEATING SYSTEM PSYCHROMETRICS (Airstream Temperatures at Time of Heating Peak)

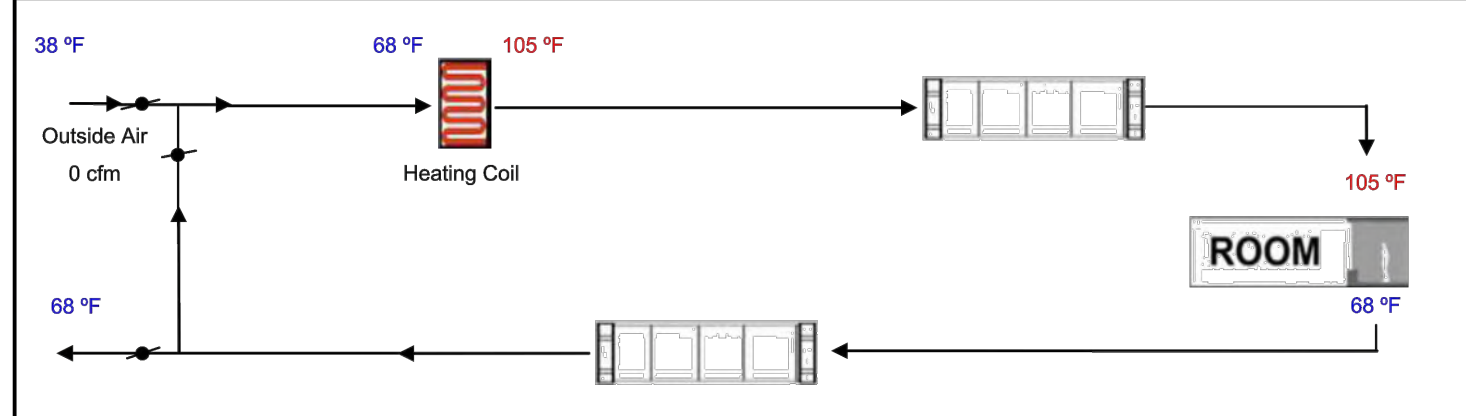


COOLING SYSTEM PSYCHROMETRICS (Airstream Temperatures at Time of Cooling Peak)

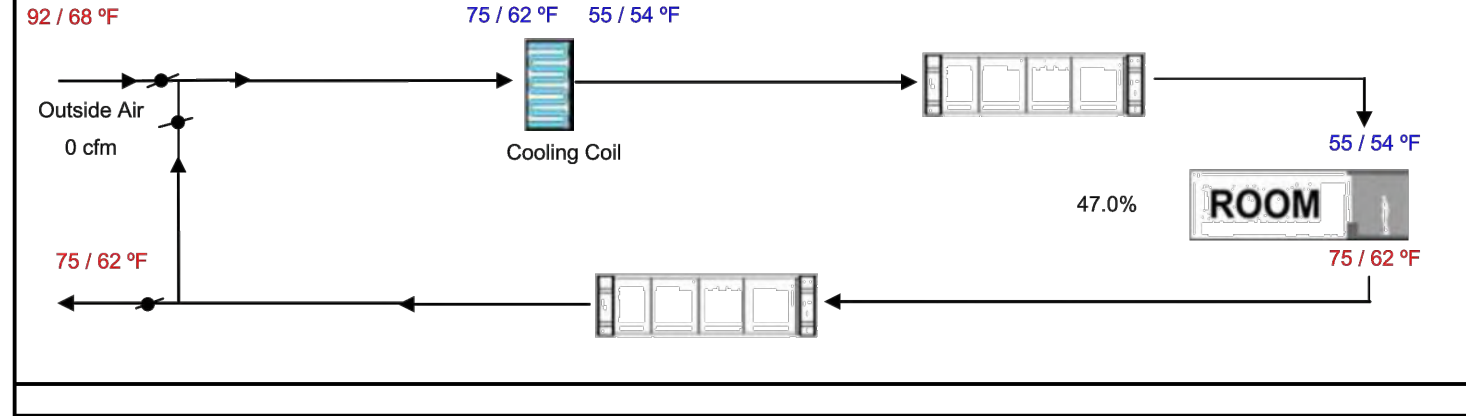

NOTE: TITLE 24 CALCULATIONS WAS PROVIDED FOR ALL ORIENTATIONS, AND THE WORST-CASE SCENARIO IS PRESENTED.

Yakov Design Drafting service (562)322-8070 info@yakovdesign.com

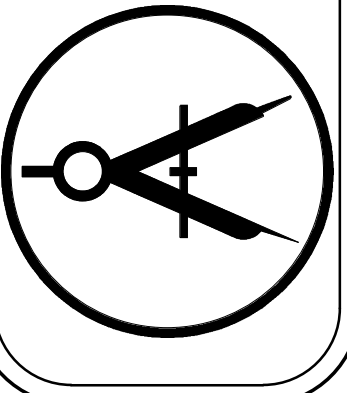

STANDARD PLAN PROGRAM


TITLE 24

NOTES: SCALE: DATE: 03.22.2024

T24.2

FLOOR PLAN NOTES:


- PROVIDE MIN. 24" CLEAR IN FRONT OF THE WATER CLOSET.
- PROVIDE MIN. 30" CLEAR WIDTH FOR THE WATER CLOSET
- HANDRAIL 34"-46" ABOVE THE STAIR NOSING PER APPLICABLE CBC
- 42" HIGH GUARDRAIL, PER APPLICABLE CBC
- DRYER. VENT HORIZONTAL TO OUTSIDE W/ BACKDRAFT DAMPER.
- ROOF ABOVE
- BASEMENT BELOW
- 5/8" TYPE "X" GYP. BD. IN THE GARAGE AND UNDER STAIRS AT ENCLOSED USABLE SPACE W/ 6d COOLER NAILS @7" O.C.
- ULTRA-LOW CONSUMPTION WATER CLOSET (1.28 GAL/FLUSH).
- PROVIDE COPPER WATER LINE FOR ICE MAKER.
- PROVIDE WATER AND WASTE FOR WASHER (RECESSED BOX AT INTERIOR LOCATIONS)
- ELECTRICAL SERVICE PANEL.
- SHOWER DRAIN IN FLOOR BELOW WASHER, CONN. TO 1 1/2" - DIA ABS PIPE W/ 1/4" PER FOOT SLOPED TO EXT.
- 30" WIDE COOK TOP. BUILT-IN HOOD WITH LIGHT AND VENT TO OUTSIDE AIR.
- A. STAIRS SHALL HAVE MIN. 7.75" RISE & MIN. 10" RUN
B. MIN. 6'-8" HEADROOM CLEARANCE.
C. MIN. 30" CLEAR WIDTH
D. HANDRAILS 34" TO 38" HIGH ABOVE TREAD NOSING .
E. HANDGRIPS PORTION OF HANDRAIL SHALL NOT BE LESS THAN 1.25" AND NO MORE THAN 2" CROSS-SECTIONAL DIMENSION HAVING A SMOOTH SURFACE WITH NO SHARP CORNERS.
F. MAX. 4" CLEAR SPADING OPENING BETWEEN RAILS.
- GLAZING IN HAZARDOUS LOCATIONS SHALL BE TEMPERED. (2406.4)
a. PANELS IN SLIDING OR SWINGING DOORS.
b. DOORS AND ENCLOSURE FOR HOT TUB, BATHTUB, SHOWERS (ALSO GLAZING IN WALL ENCLOSING THESE COMPARTMENTS WITHIN 6 FT. OF STANDING SURFACE.
c. GLAZING IN FIXED OR OPERABLE PANELS TO A DOOR WHERE THE NEAREST EXPOSED EDGE OF THE GLAZING IS WITHIN A 24 INCH ARC OF VERTICAL EDGE OF THE DOOR IN A CLOSED POSITION AND WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60 INCHES ABOVE THE WALKING SURFACE.
- PROVIDE SLIDING FLY SCREEN AT OPENABLE PORTIONS OF SLIDING DOORS. PROVIDE STATIONARY FLY SCREENS AT OPENABLE PORTIONS OF WINDOWS.
- EACH WATER CLOSET STOOL SHOULD BE LOCATED IN A CLEAR SPACE NOTE LESS THAN 30" IN WIDTH AND HAVE A MINIMUM CLEAR SPACE IN FRONT OF NOT LESS THAN 24" MAXIMUM 1.6 GALLONS/FLUSH FOR ALL TEH WATER CLOSETS.
- PROVIDE ONLY VENTLESS ON-DEMAND WATER HEATERS.
- FIRE BLOCKING MUST BE PROVIDED IN ACCORDANCE WITH SECTION 717 IN THE FOLLOWING LOCATIONS:
a. IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES, AT THE CEILING AND FLOOR LEVELS..
b. IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES, AT 10 FOOT INTERVALS ALONG THE LENGTH OF THE WALL
c. AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS AND COVERED CEILINGS.
d. IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN AND BETWEEN STUDS ALONG AND IN LINE WITH THE RUN OF STAIRS IF THE WALL UNDER THE STAIRS IS UNFINISHED.
e. IN OPENINGS AROUND VENTS, PIPES, DUCTS, CHIMNEYS, FIREPLACES AND SIMILAR OPENINGS WHICH AFFORD A PASSAGE FOR FIRE AT CEILING AND FLOOR LEVELS, WITH NONCOMBUSTIBLE MATERIALS. SUCH CLEARANCE SHALL BE MEASURED VERTICALLY FROM A PLANE PARALLEL AND TANGENT TO THE STAIRWAY TREAD NOSING TO THE SOFFIT ABOVE ALL POINTS.
- PROVIDE 6" INCH CLEARANCES ON THE SIDES, BACK, FRONT AND CEILING OF THE FURNACE.
- THE CONSTRUCTION SHALL NOT RESTRICT A FIVE-FOOT CLEAR AND UNOBSTRUCTED ACCESS TO ANY WATER OR POWER DISTRIBUTION FACILITIES (POWER POLES, PULL-BOXES, TRANSFORMERS, VAULTS, PUMPS, VALVES, METERS, APPURTENANCES, ETC.) OR TO THE LOCATION OF THE HOOK-UP. THE CONSTRUCTION SHALL NOT BE WITHIN TEN FEET OF ANY POWER LINES-WHETHER OR NOT THE LINES ARE LOCATED ON THE PROPERTY. FAILURE TO COMPLY MAY CAUSE CONSTRUCTION DELAYS AND /OR ADDITIONAL EXPENSES.
- AN APPROVED SEISMIC GAS SHUTOFF VALVE WILL BE INSTALLED ON THE FUEL GAS LINE ON THE DOWN STREAM SIDE OF THE UTILITY METER AND BE RIGIDLY CONNECTED TO THE EXTERIOR OF THE BUILDING OR STRUCTURE CONTAINING THE FUEL GAS PIPING . PER ORDINANCE 170,158 INCLUDES COMMERCIAL ADDITIONS AND TI WORK OVER \$10,000. SEPARATE PLUMBING PERMIT IS REQUIRED.
- PROVIDE ULTRA-LOW FLUSH WATER CLOSETS FOR ALL NEW CONSTRUCTIONS. EXISTING SHOWER HEADS AND TOILETS MUST BE ADAPTED FOR LOW WATER CONSUMPTION.
- PROVIDE 70" HIGH NON-ABSORBENT WALL ADJACENT TO SHOWER AND APPROVED SHATTER-RESISTANT MATERIALS FOR SHOWER ENCLOSURE.
- WATER HEATER MUST BE STRAPPED TO WALL.
- UNDER FLOOR VENTILATION OPENINGS IN THE UNDER FLOOR AREA SHALL COMPLY WITH THE FOLLOWING REQUIREMENTS:
A. THE TOP OF THE OPENING SHALL BE LOCATED NOT MORE THAN 12 INCHES BELOW THE BOTTOM OF THE FLOOR JOIST.
B. THE OPENINGS SHALL BE DISTRIBUTED APPROXIMATELY EQUALLY AND LOCATED TO PROVIDE CROSS VENTILATION, FOR EXAMPLE, BE LOCATING THE OPENING ALONG THE LENGTH OF AT LEAST TWO OPPOSITE SIDES OF THE BUILDING.
C. THE OPENINGS SHALL BE THE LARGER OF: 1.5 SQUARE FEET FOR EACH 25 LINEAR FEET OR FRACTION OF EXTERIOR WALL, OR OPENINGS SHALL BE EQUAL TO 1% OF UNDER FLOOR AREA.
D. THE OPENINGS MAY BE COVERED WITH CORROSION RESISTANT WIRE MESH WITH MESH
- OPENINGS OF GREATER THAN 1.4 INCH AND LESS THAN 1.2 INCH IN DIMENSION. BUILDINGS WITH NATURAL VENTILATION ARE EXEMPTED FROM THE CONSTRUCTION REQUIREMENTS OF TABLE 71 PROVIDED THEY COMPLY WITH THE FOLLOWING:
A. THE UNOBSTRUCTED OPENINGS SHALL EXCHANGE OUTSIDE AIR.
B. THE SIZE OF THE UNOBSTRUCTED OPENINGS SHALL BE THE LARGER OF: 25% OF THE TOTAL PERIMETER WALL AREA OF THE LOWEST LEVEL OF THE BUILDING, OR AT LEAST 25% OF THE FLOOR AREA OF THE LOWEST OF THE BUILDING.
C. THE UNOBSTRUCTED OPENINGS SHALL BE EVENLY DISTRIBUTED AND LOCATED WITHIN THE UPPER PORTION OF AT LEAST TWO OPPOSITE EXTERIOR WALLS OF THE LOWEST LEVEL OF THE BUILDING.
D. THEY ARE PROVIDED WITH TRENCH DAMS AND CABLE OR CONDUIT SEALS.
- PLUMBING FIXTURES ARE REQUIRED TO BE CONNECTED TO A SANITARY SEWER OR TO AN APPROVED SEWAGE DISPOSAL SYSTEM.
- KITCHEN SINKS, LAVATORIES, BATHTUBS, SHOWERS, BIDETS, LAUNDRY TUBS AND WASHING MACHINE OUTLETS SHALL BE PROVIDED WITH HOT AND COLD WATER AND CONNECTED TO AN APPROVED WATER SUPPLY.
- A DOMESTIC CLOTHES DRYER DUCT SHALL BE OF METAL AND A MINIMUM OF 4" IN DIAMETER. THE EXHAUST DUCT SHALL NOT EXCEED A TOTAL COMBINED HORIZONTAL AND VERTICAL LENGTH OF 14', INCLUDING TWO 90 DEGREE ELBOWS. TWO FEET SHALL BE DEDUCTED FOR EACH 90 DEGREE ELBOW IN EXCESS OF TWO. (504.3.2.2 & 504.3.2.2 CMC)

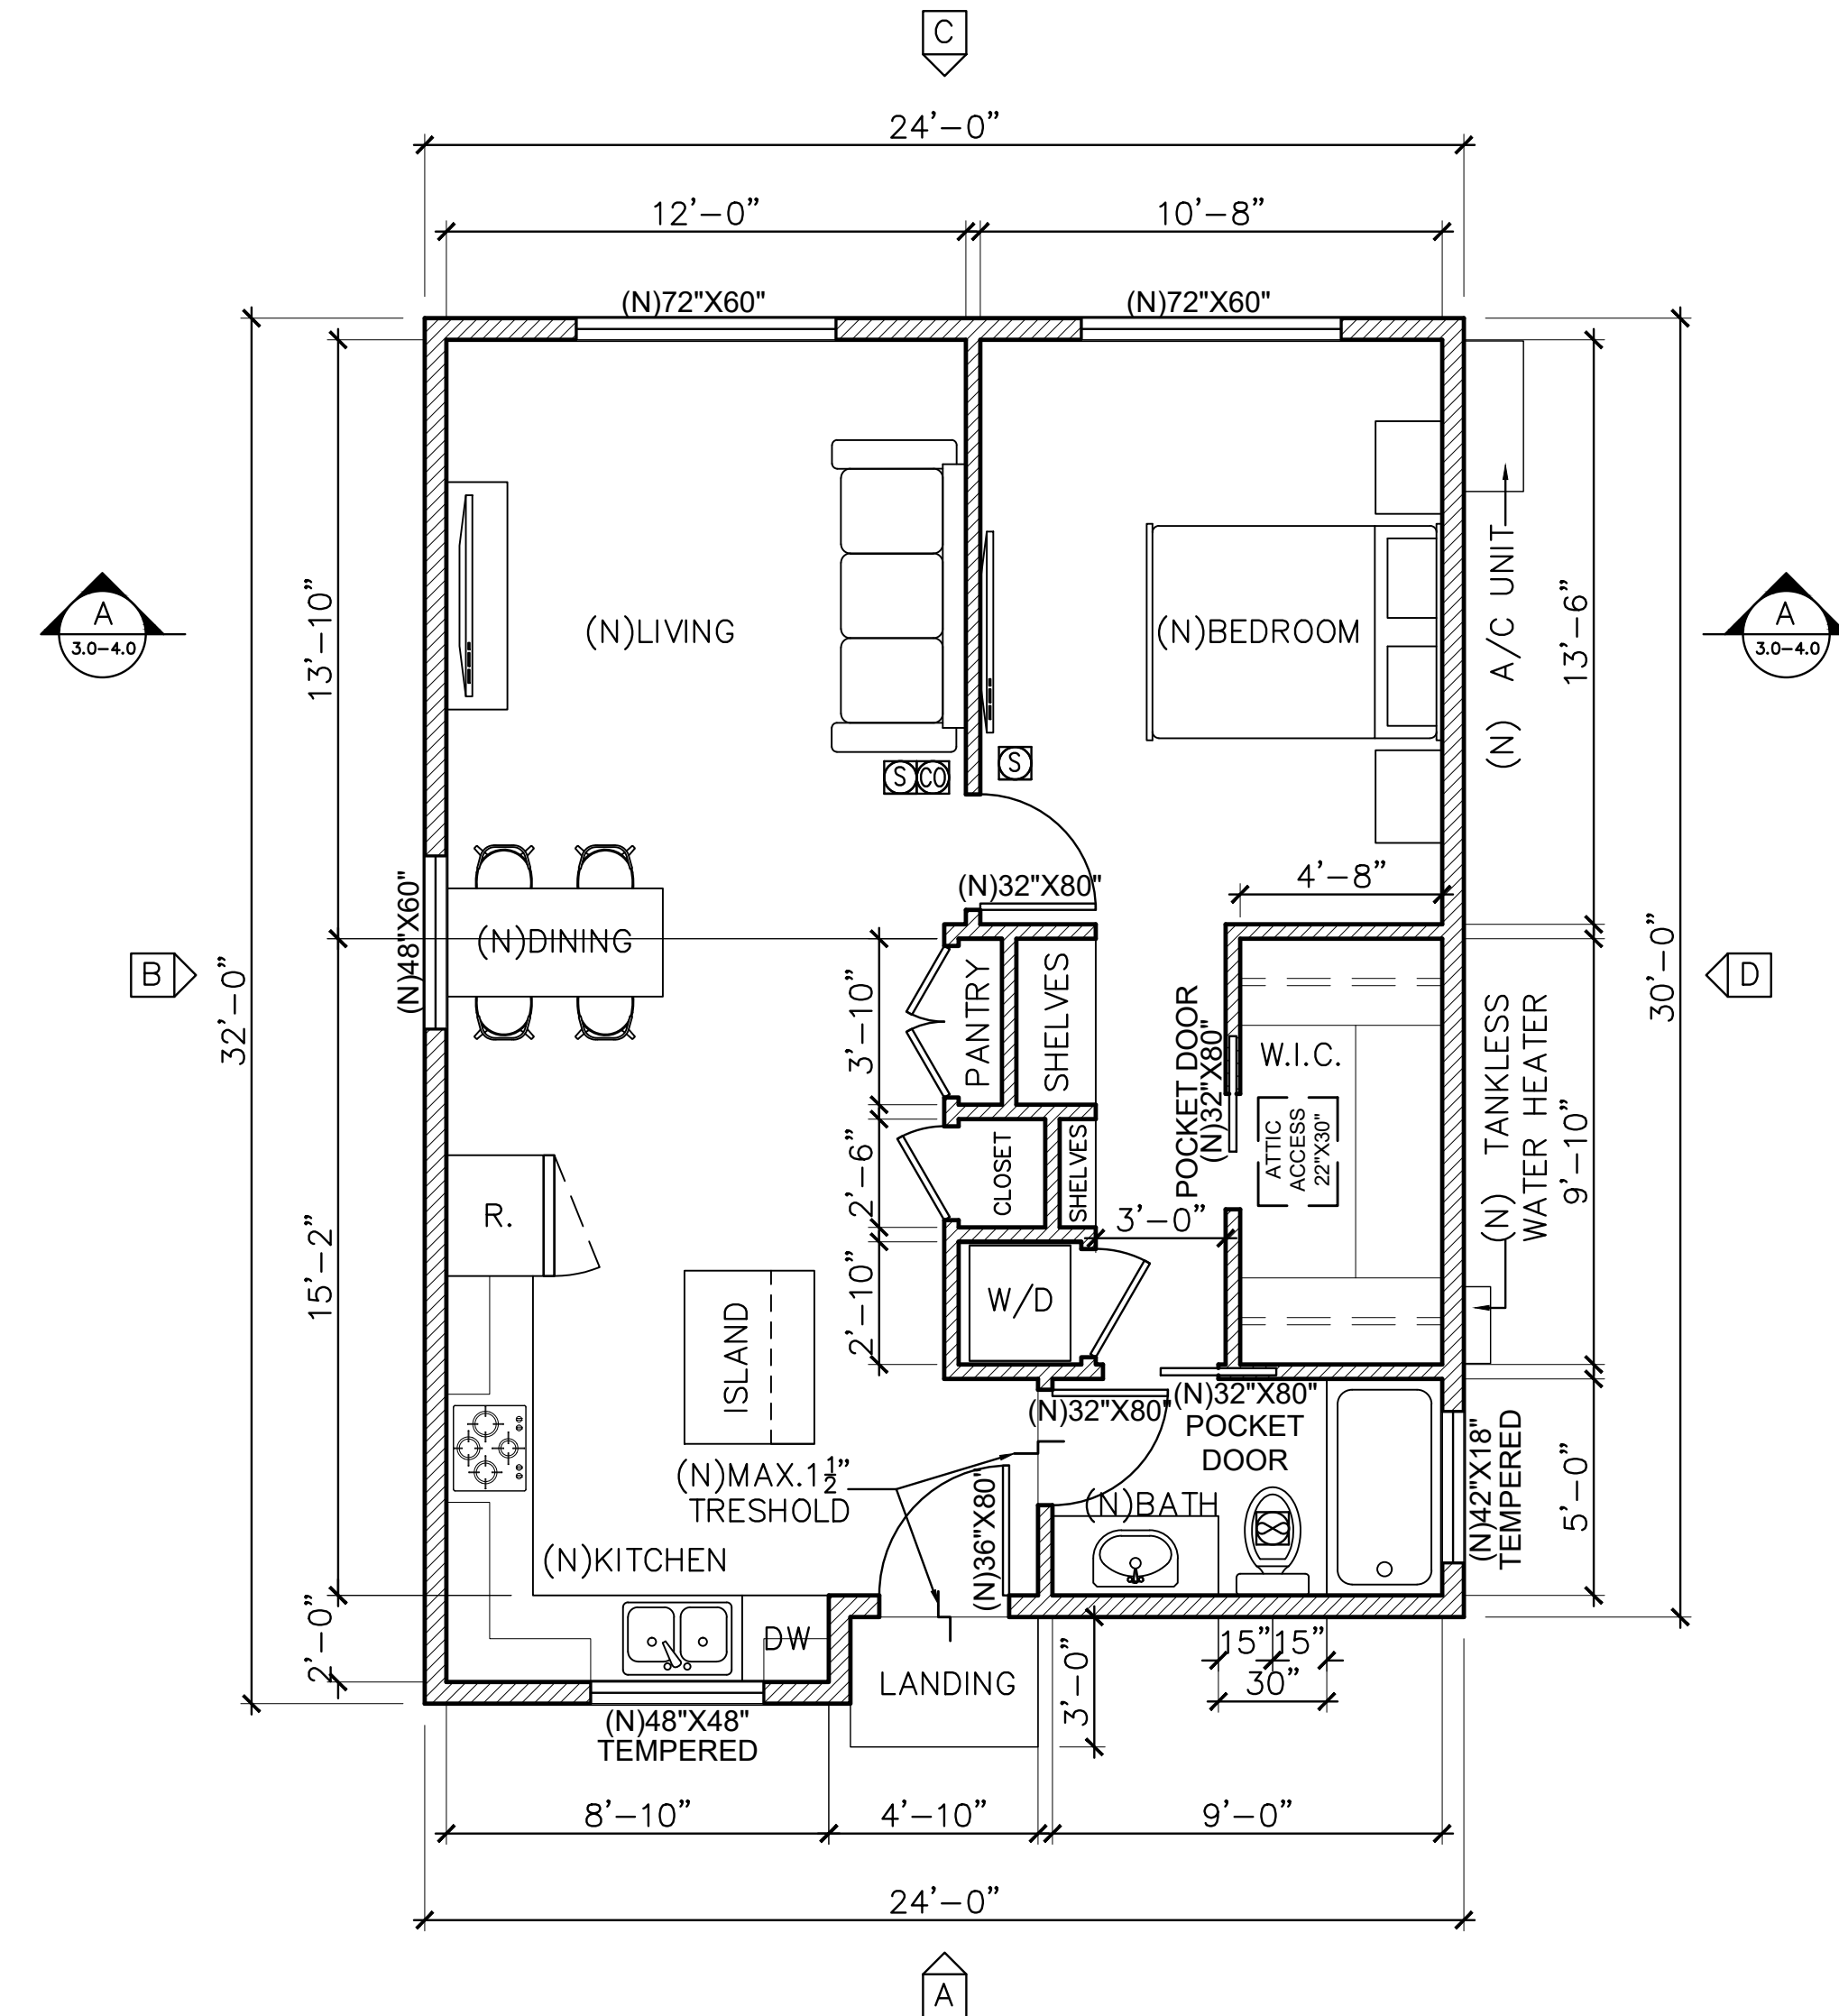

PROPOSED ADU FLOOR PLAN

- LEGEND:**
- NEW WALL
 - 1-HR WALL (REQUIRED IF FIRE SEPARATION DISTANCE IS LESS THAN 5')
 - 120v HARD-WIRED SMOKE DETECTOR WITH BATTERY BACK UP
 - EXHAUST FAN 50 CFM VENTED TO OUTSIDE ENERGY STAR COMPLIANT W/HUMIDISTAT
 - CARBON MONOXIDE SENSOR

Yakov Design
Drafting service
(323)922-2211
info@yakovdesign.com

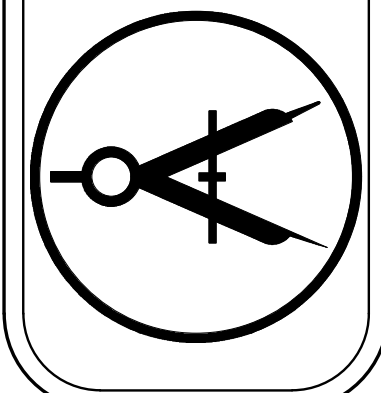


ADDRESS

PROPOSED ADU FLOOR PLAN

SCALE: 1/4"=1'-0"
DATE: 04.22.2024


1.0

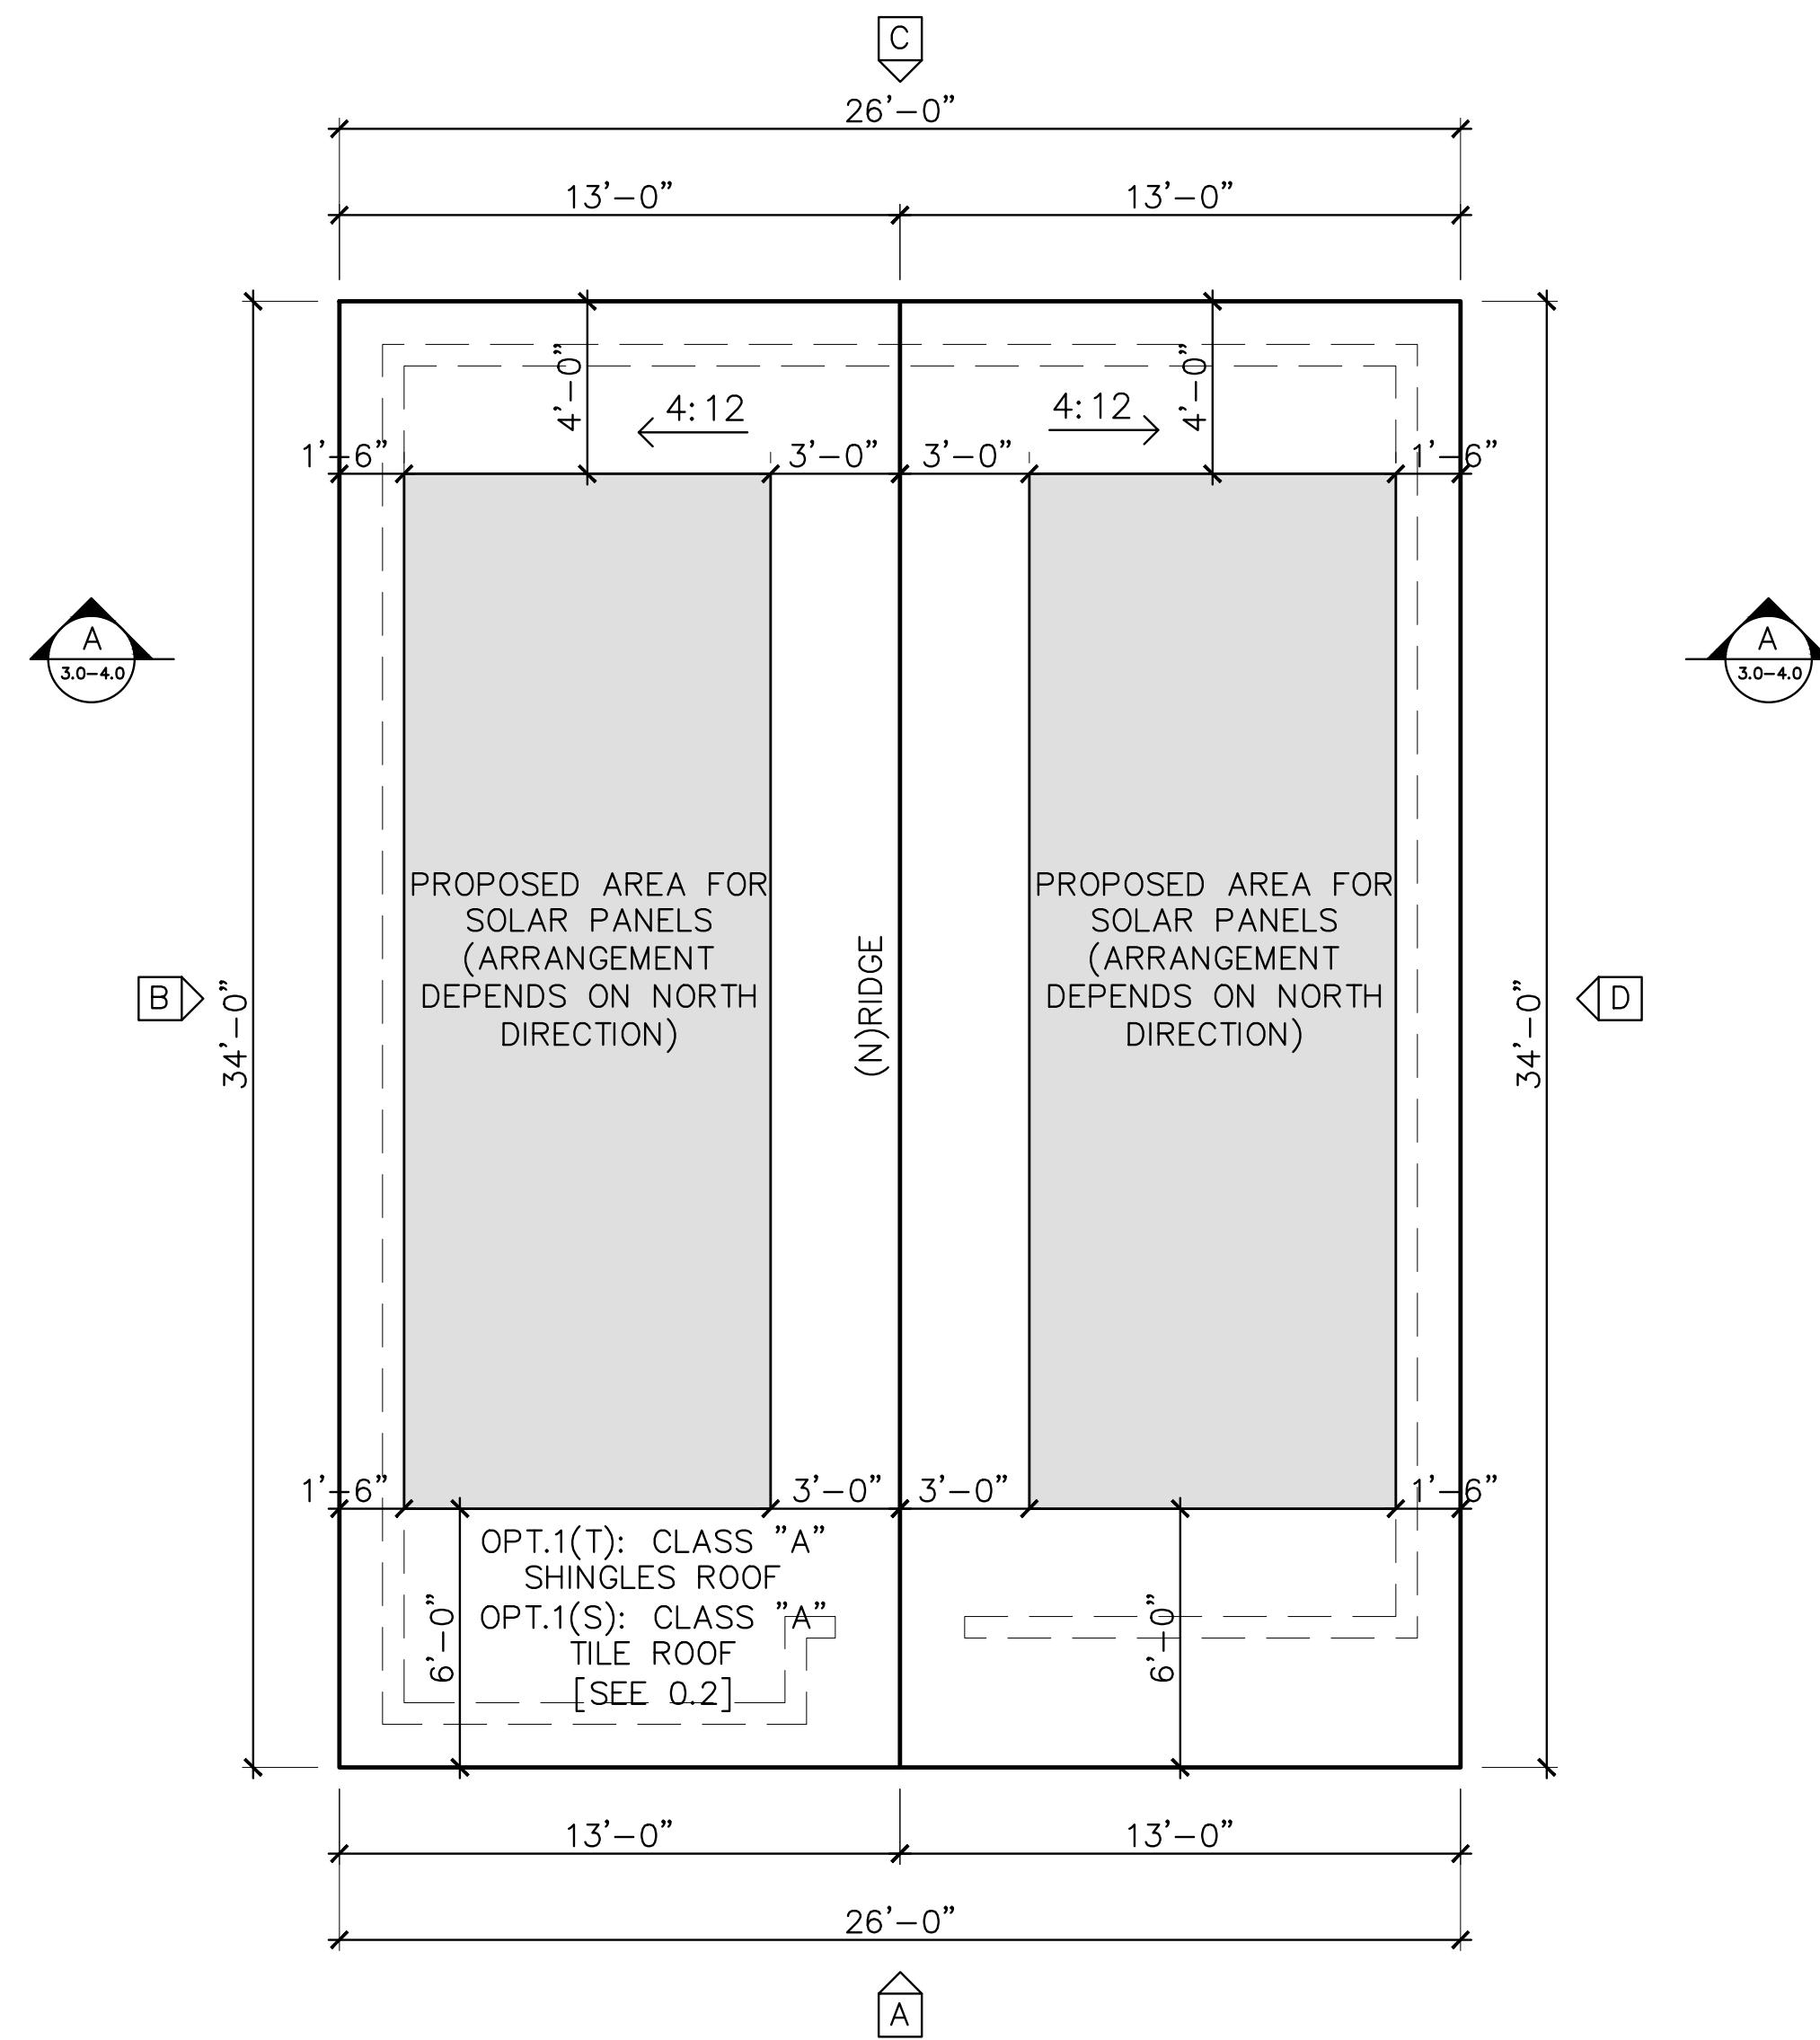


PROPOSED ADU ROOF PLAN (OPTION 1) (N)

ATTIC VENTILATION:

AREA OF THE ROOF TO BE VENTILATED: 740 S.F.
 VENTILATION REQUIRED: $740 / 150 = 4.93$ S.F.
 VENTILATION PROVIDED:
 PROVIDE 1 TRIANGLE VENT (1.56 S.F.)
 PROVIDE 1 TRIANGLE VENT (3.52 S.F.)
 $1.56 \text{ S.F.} + 3.52 \text{ S.F.} = 5.08 \text{ S.F.}$

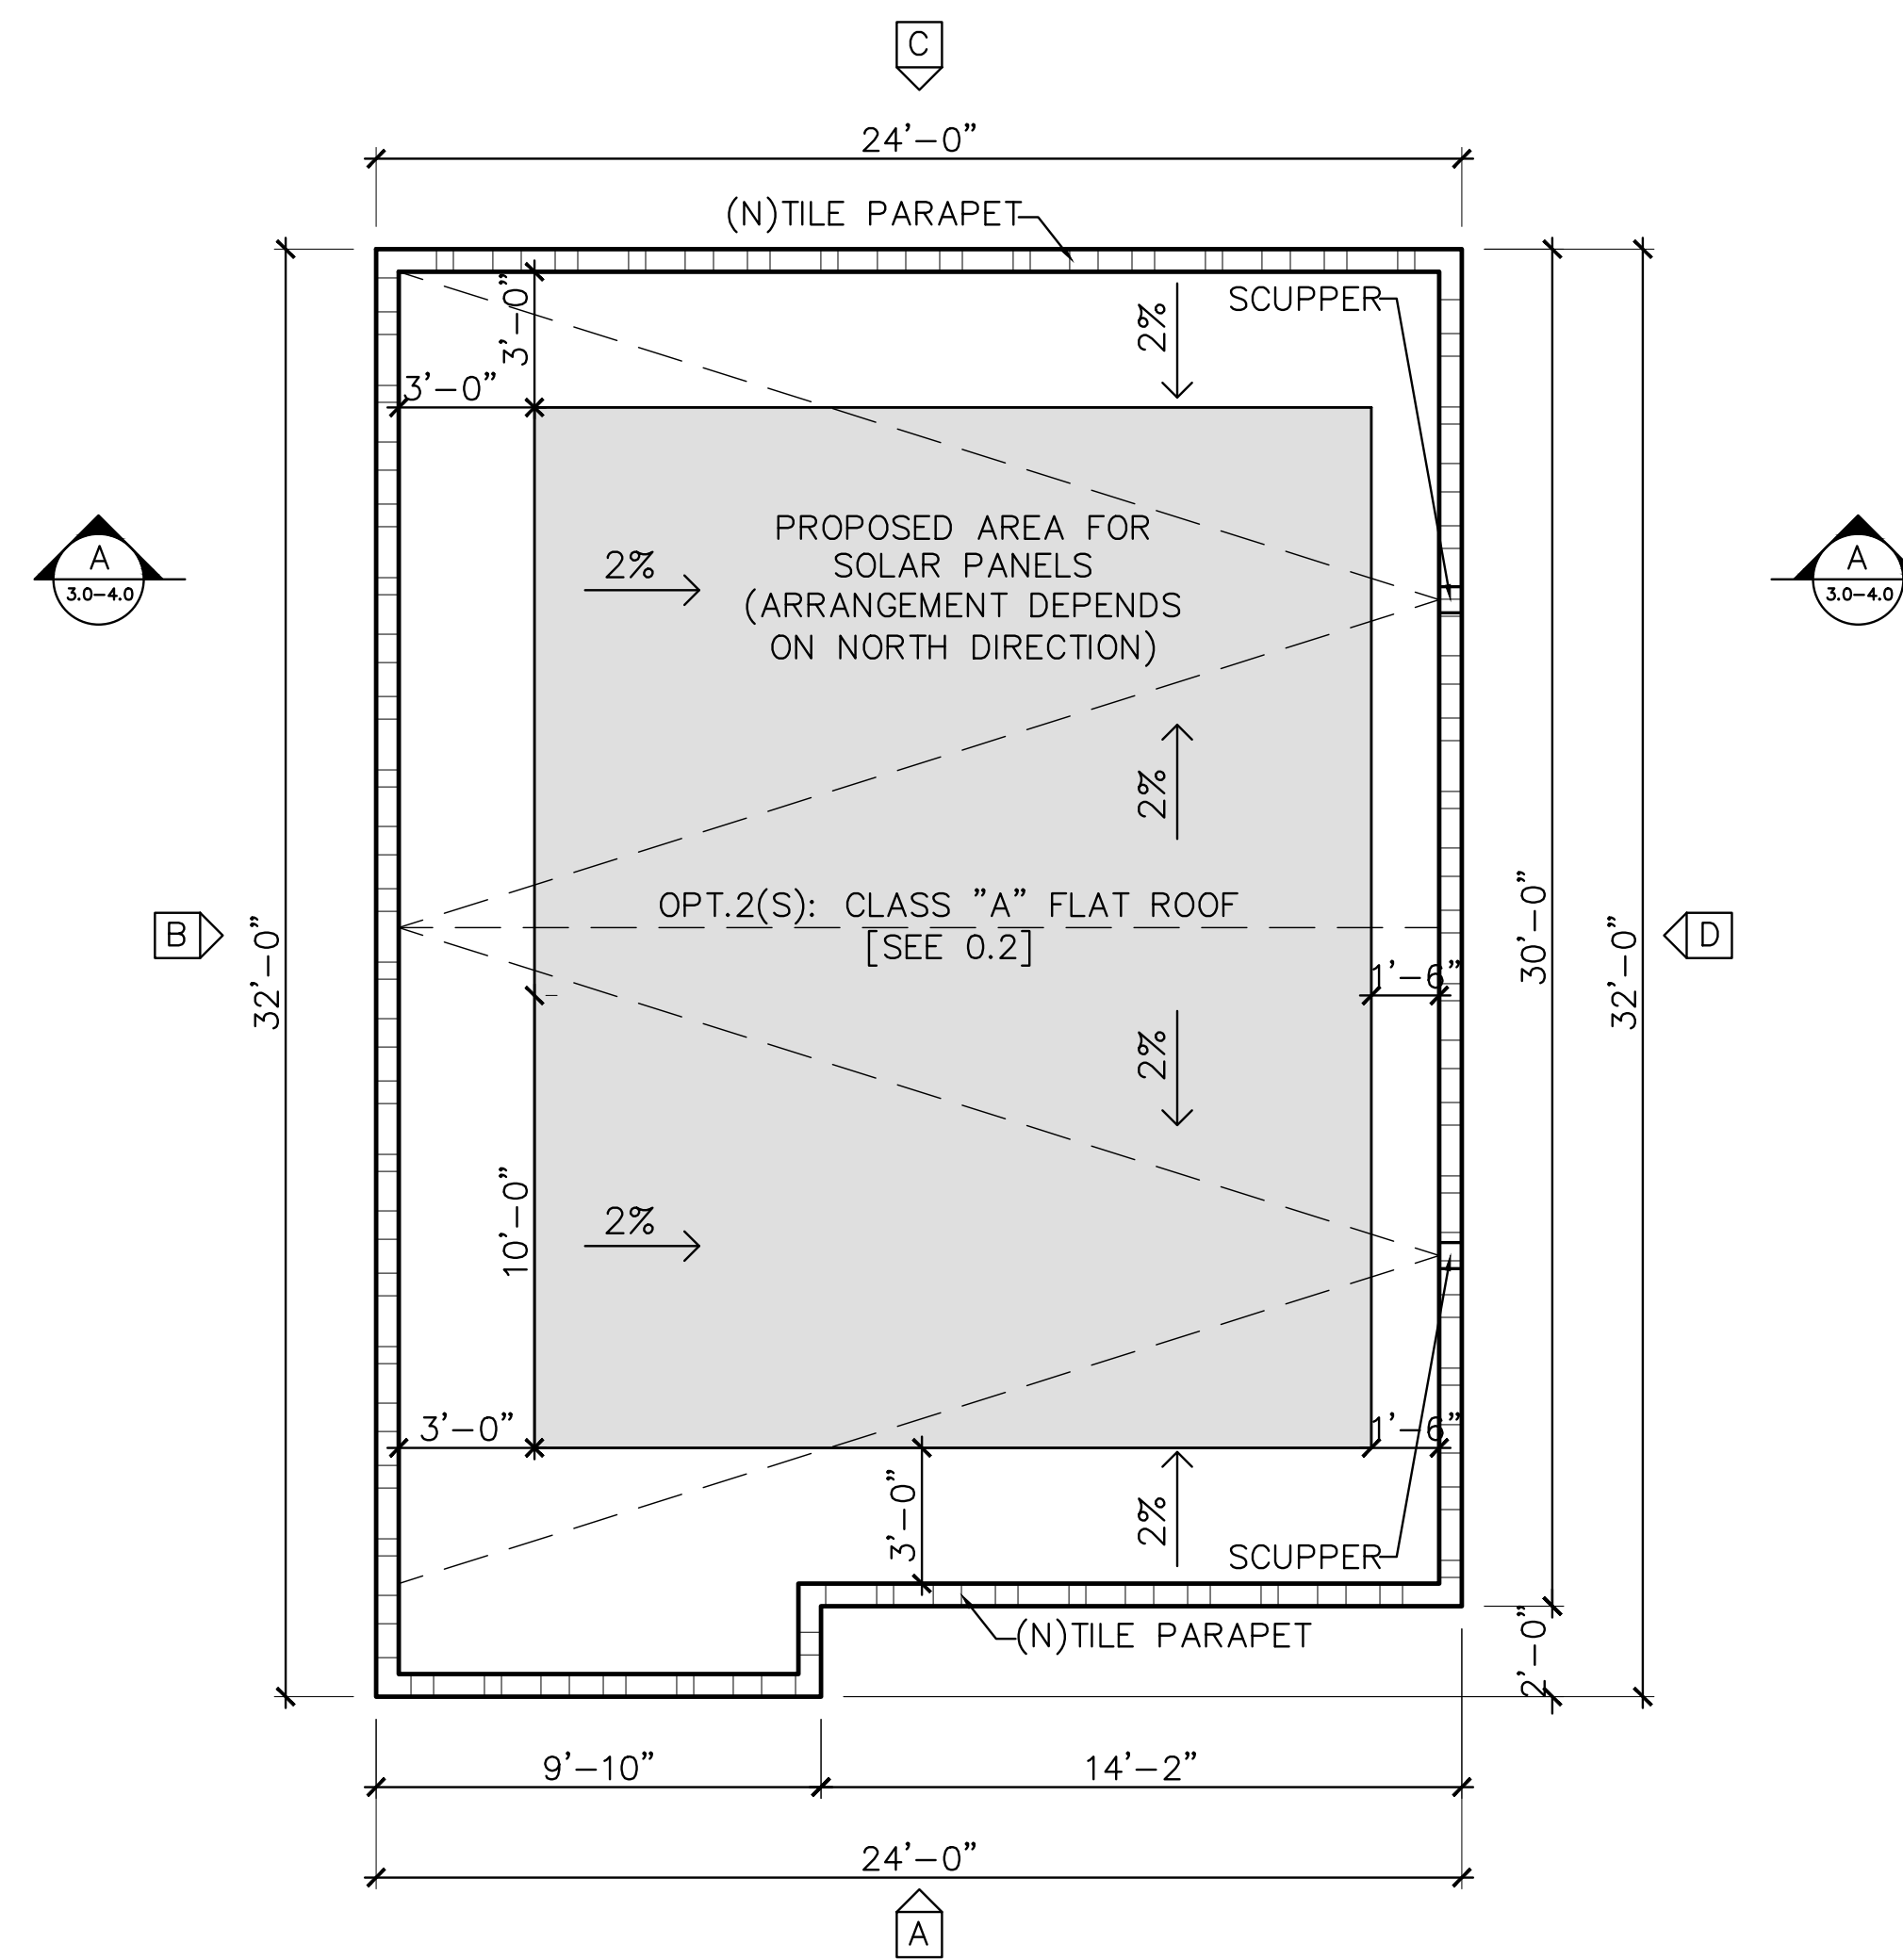


PROPOSED ADU ROOF PLAN (OPTION 2) (N)

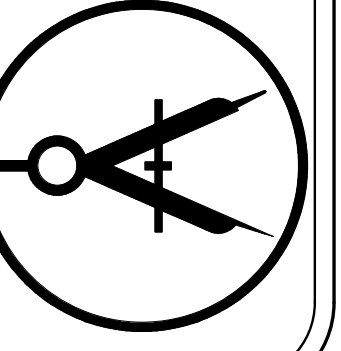


ADDRESS


PROPOSED ADU ROOF PLANS

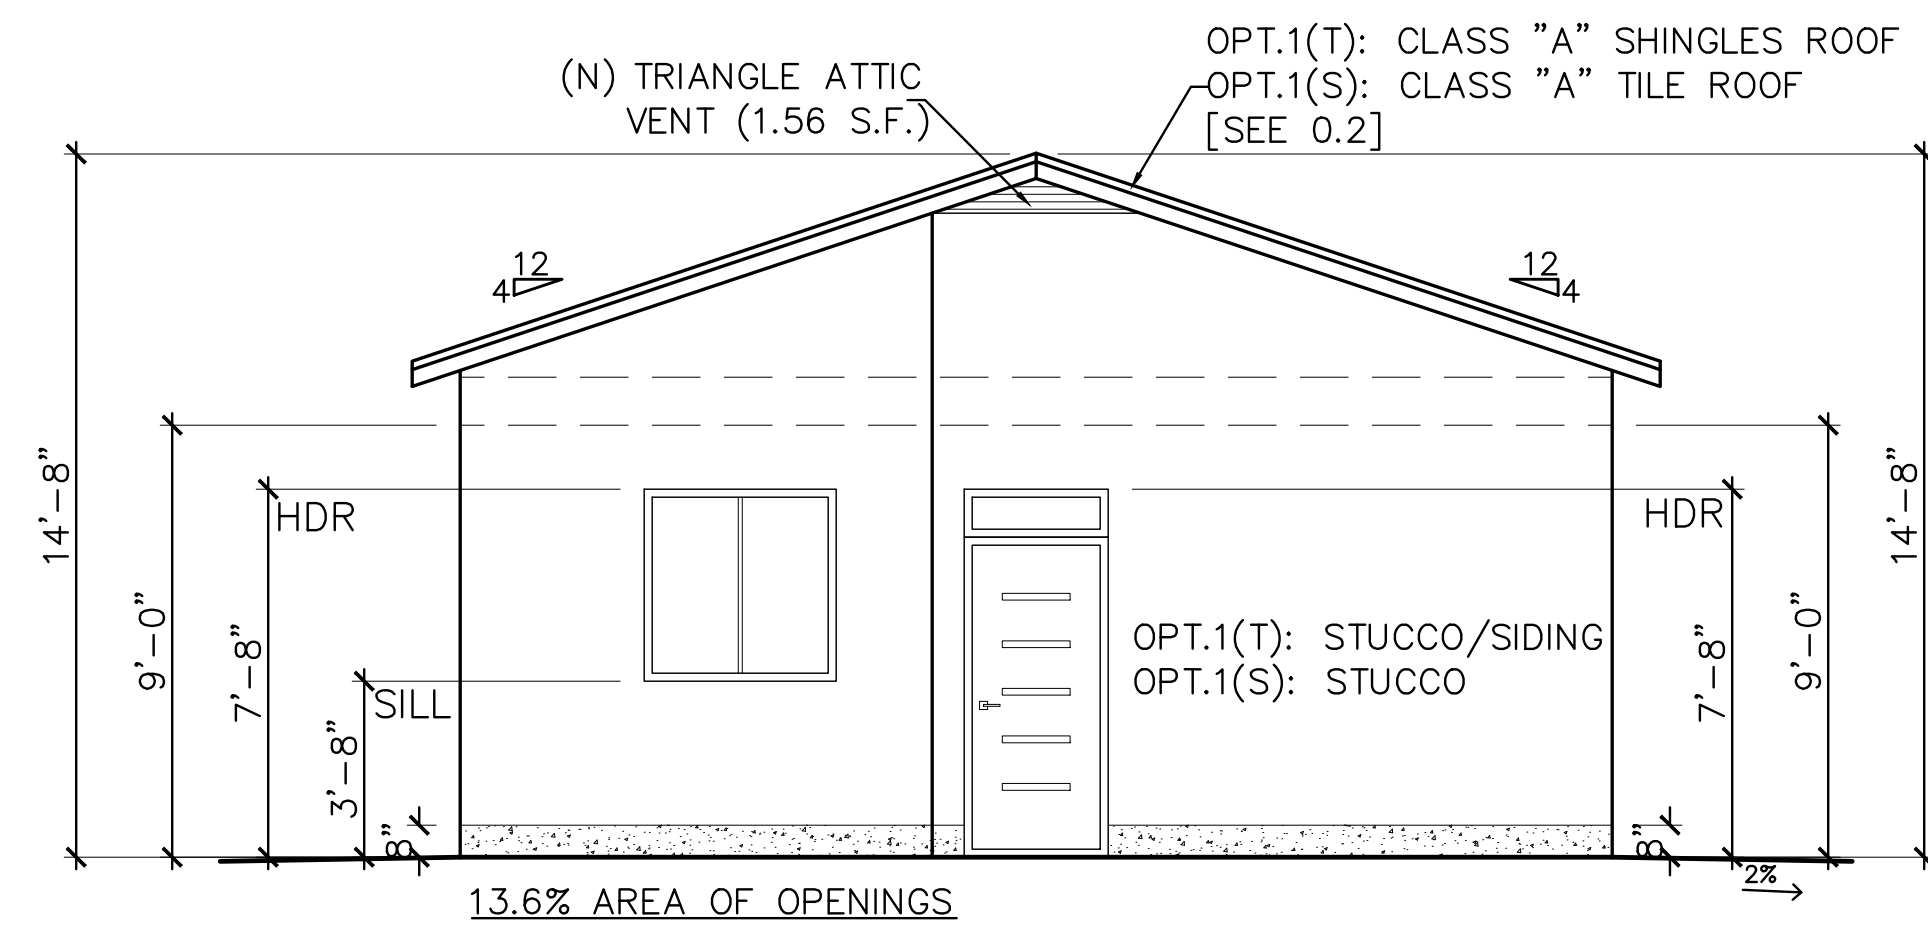


**ELEVATION A
(OPTION 1)**

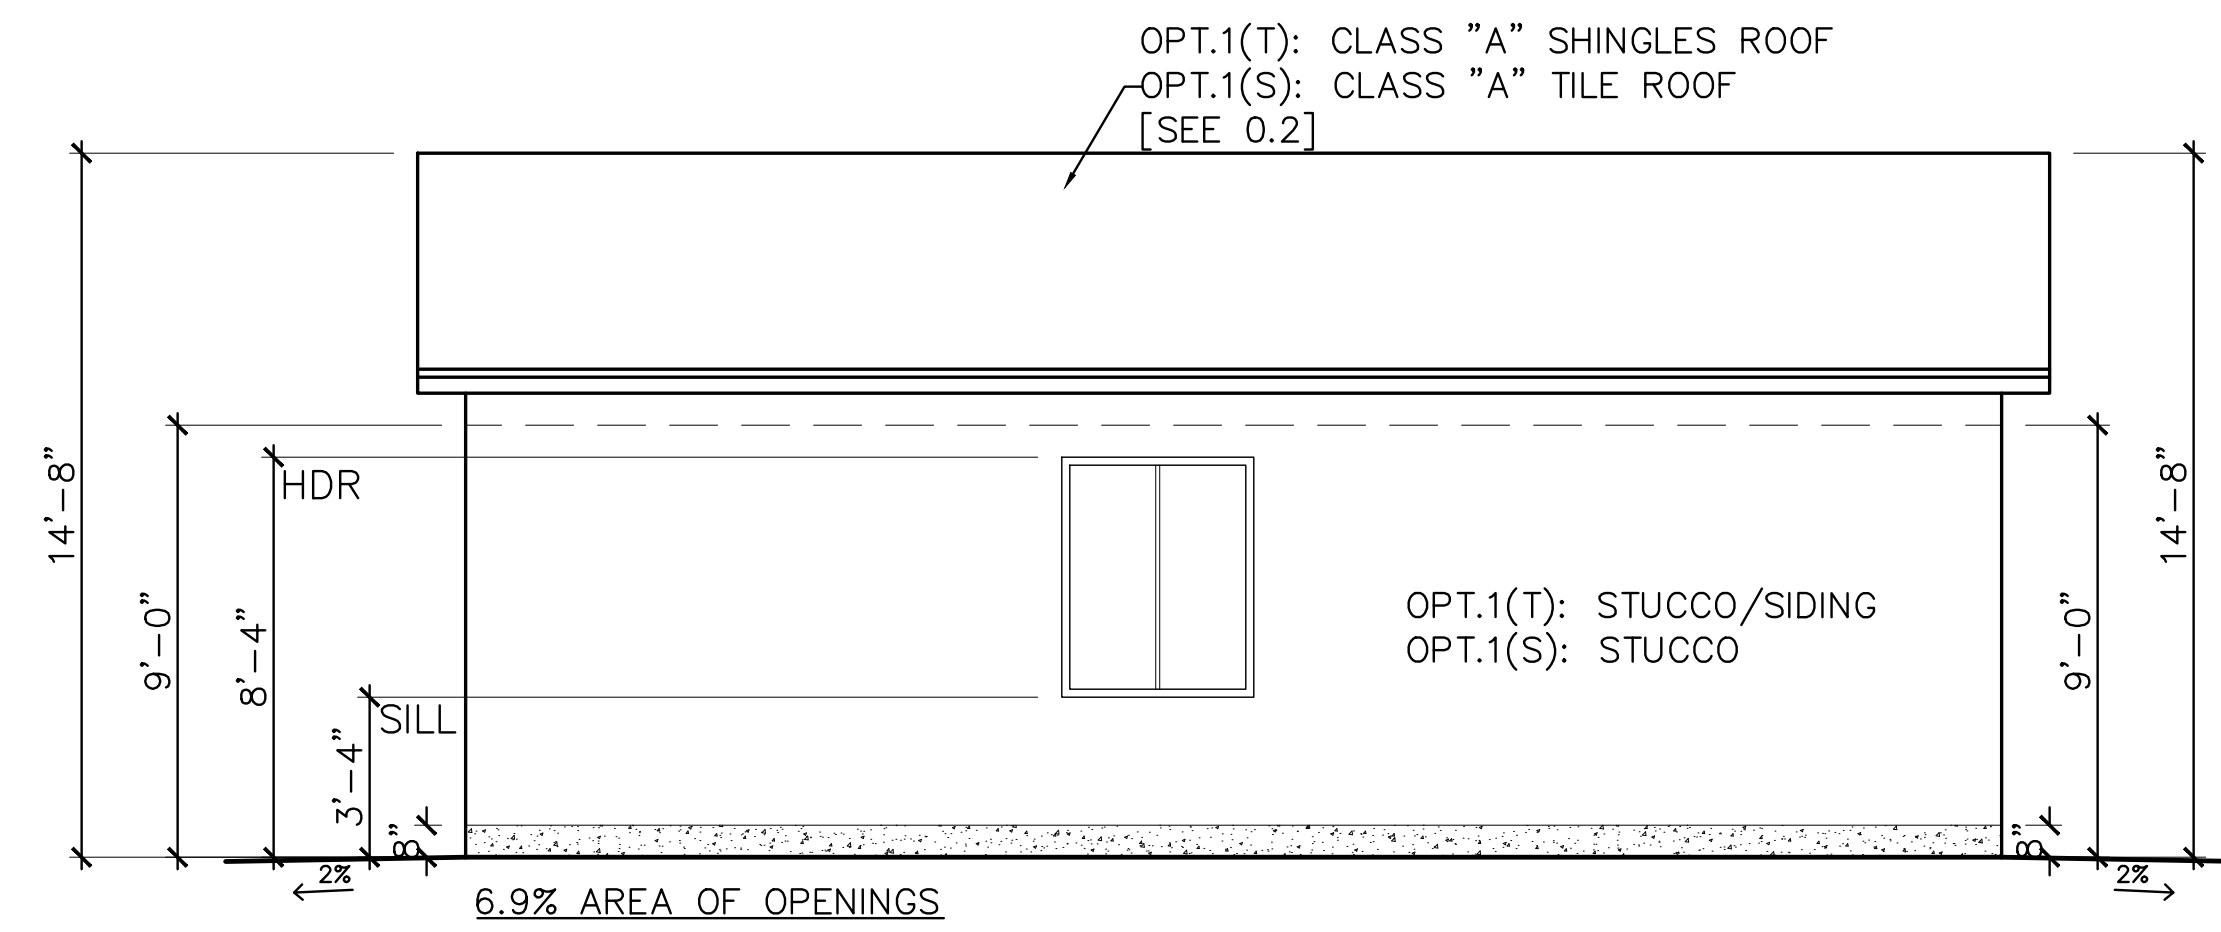


**ELEVATION B
(OPTION 1)**

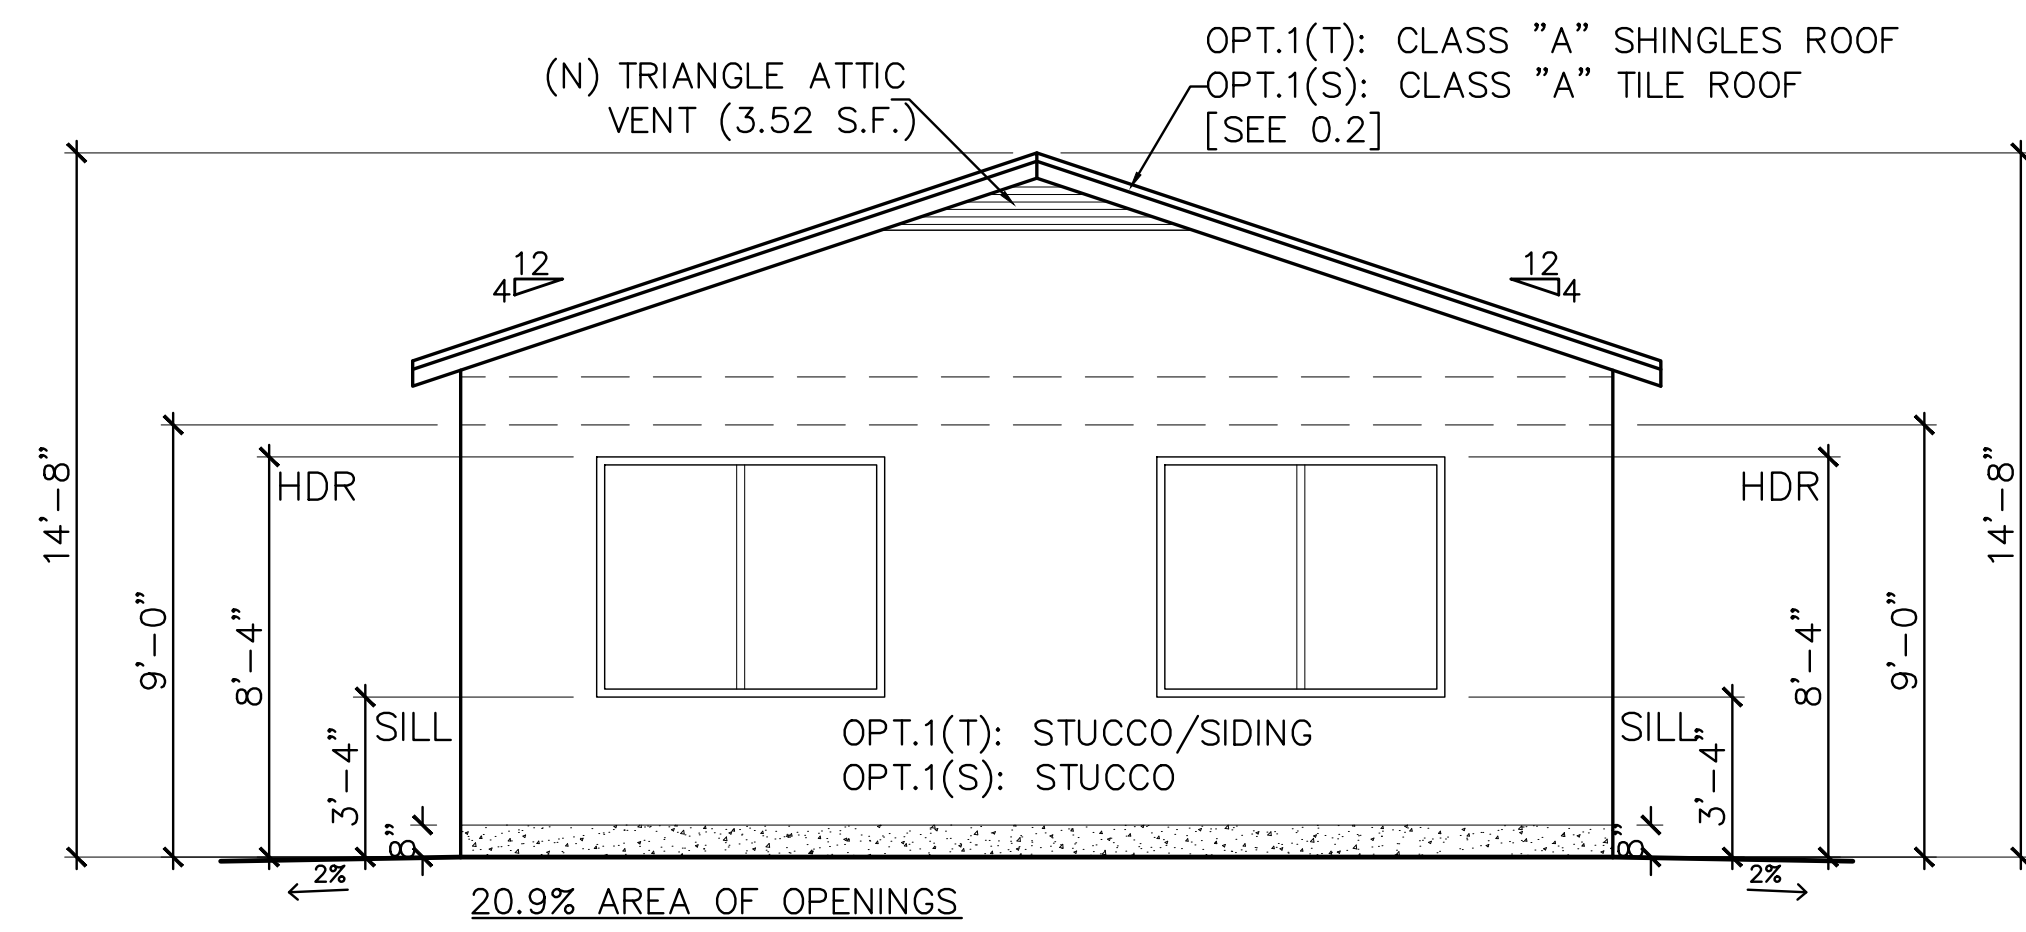


**ELEVATION C
(OPTION 1)**

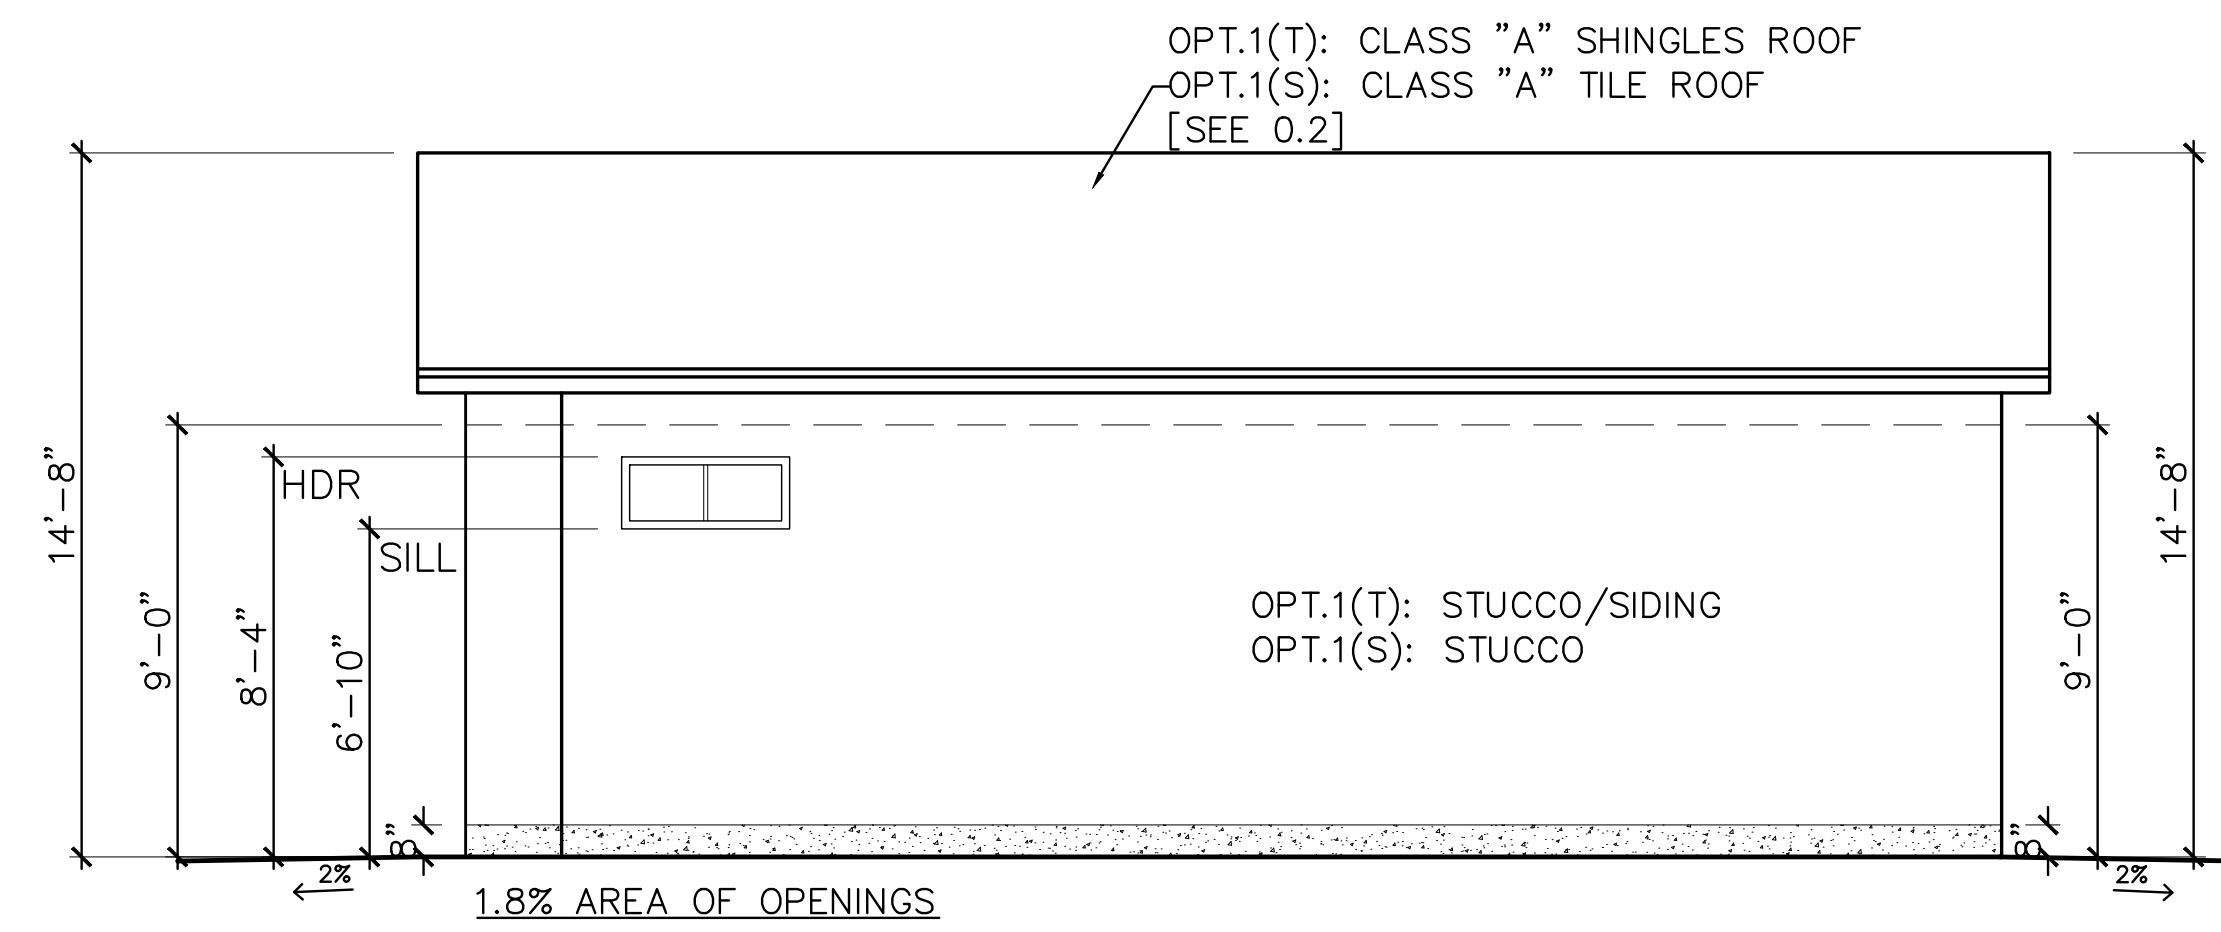

**ELEVATION D
(OPTION 1)**

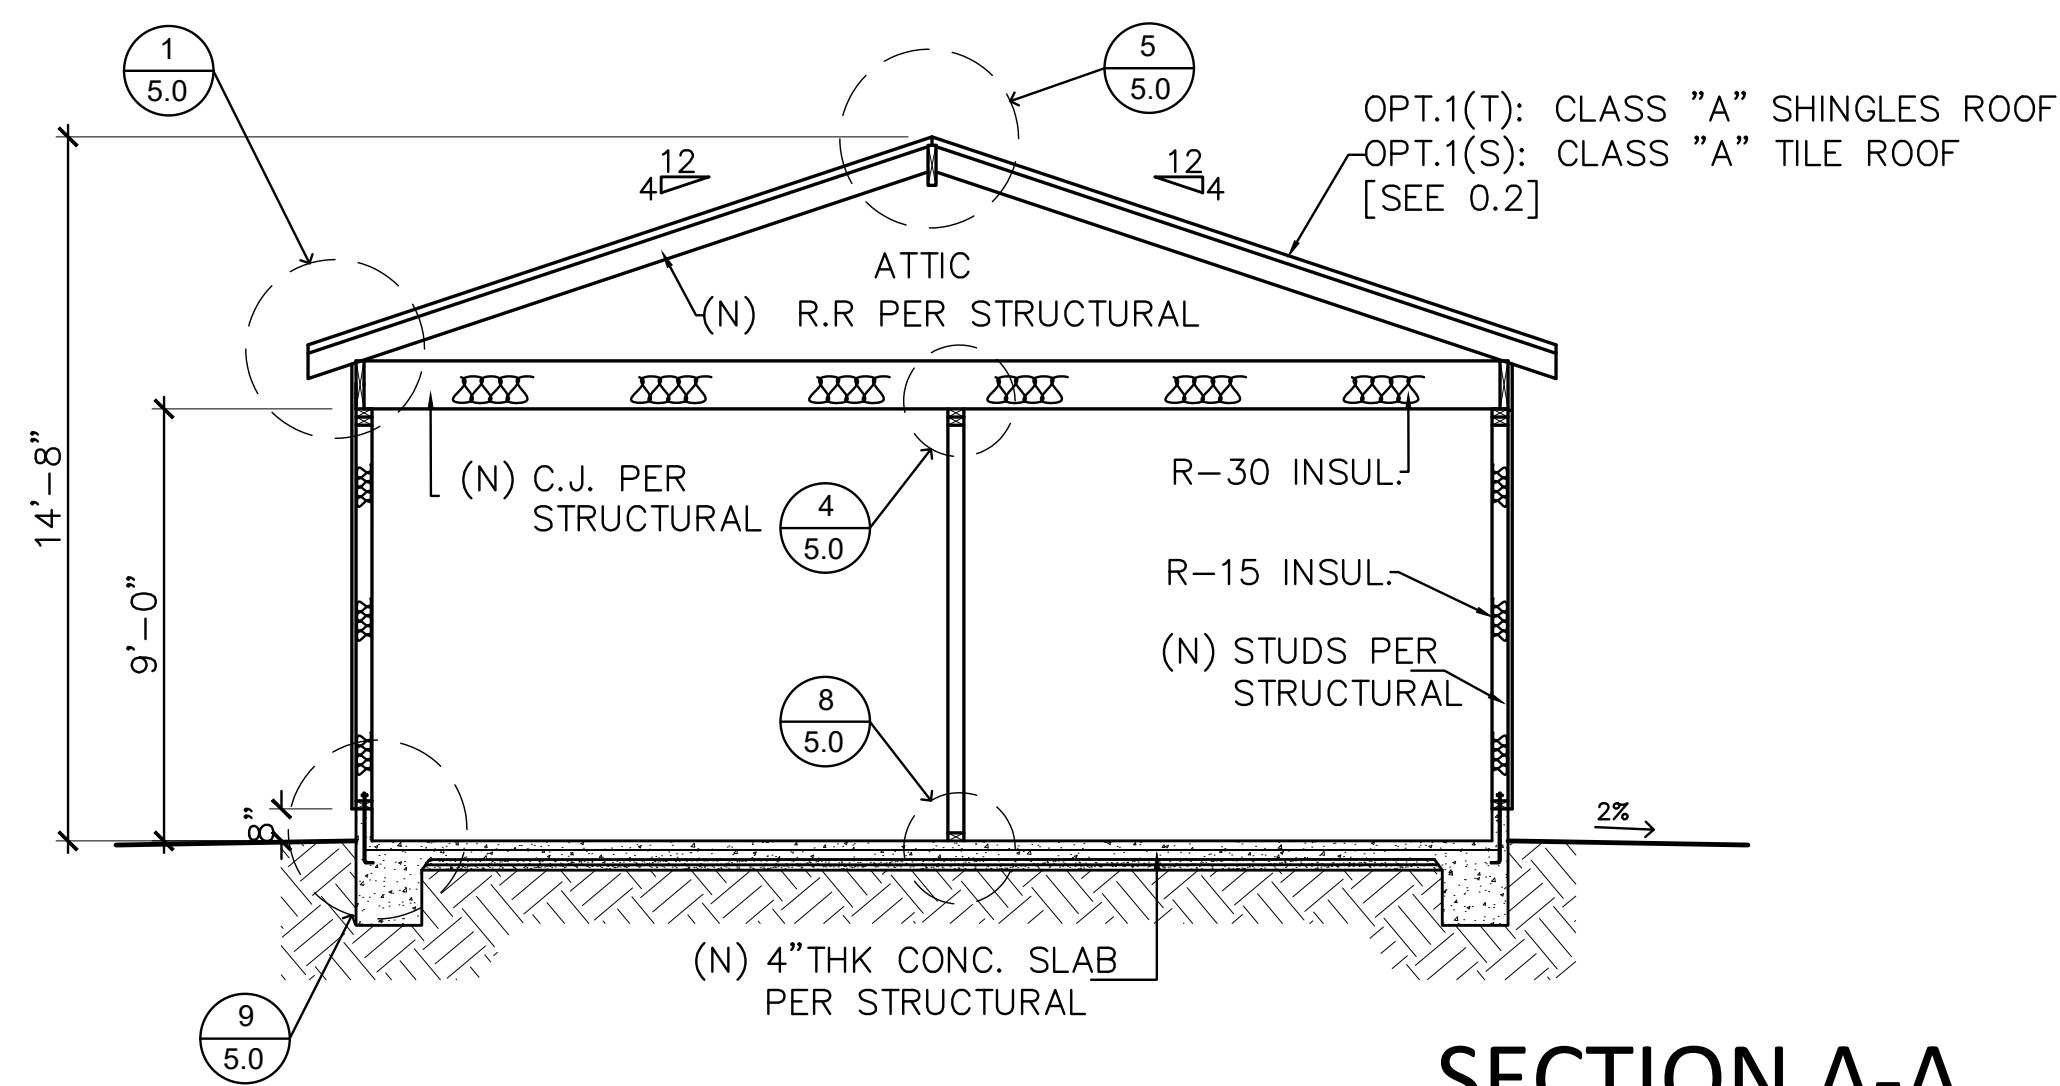


**SECTION A-A
(OPTION 1)**

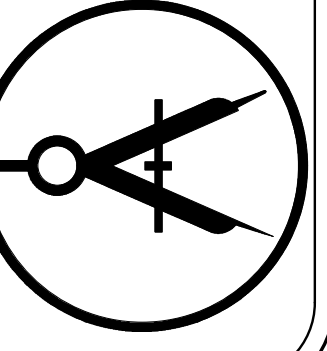


ADDRESS

PROPOSED ADU
 ELEVATIONS, SECTION A-A
 (OPTION 1)


SCALE: 1/4"=1'-0"
 DATE: 04.22.2024

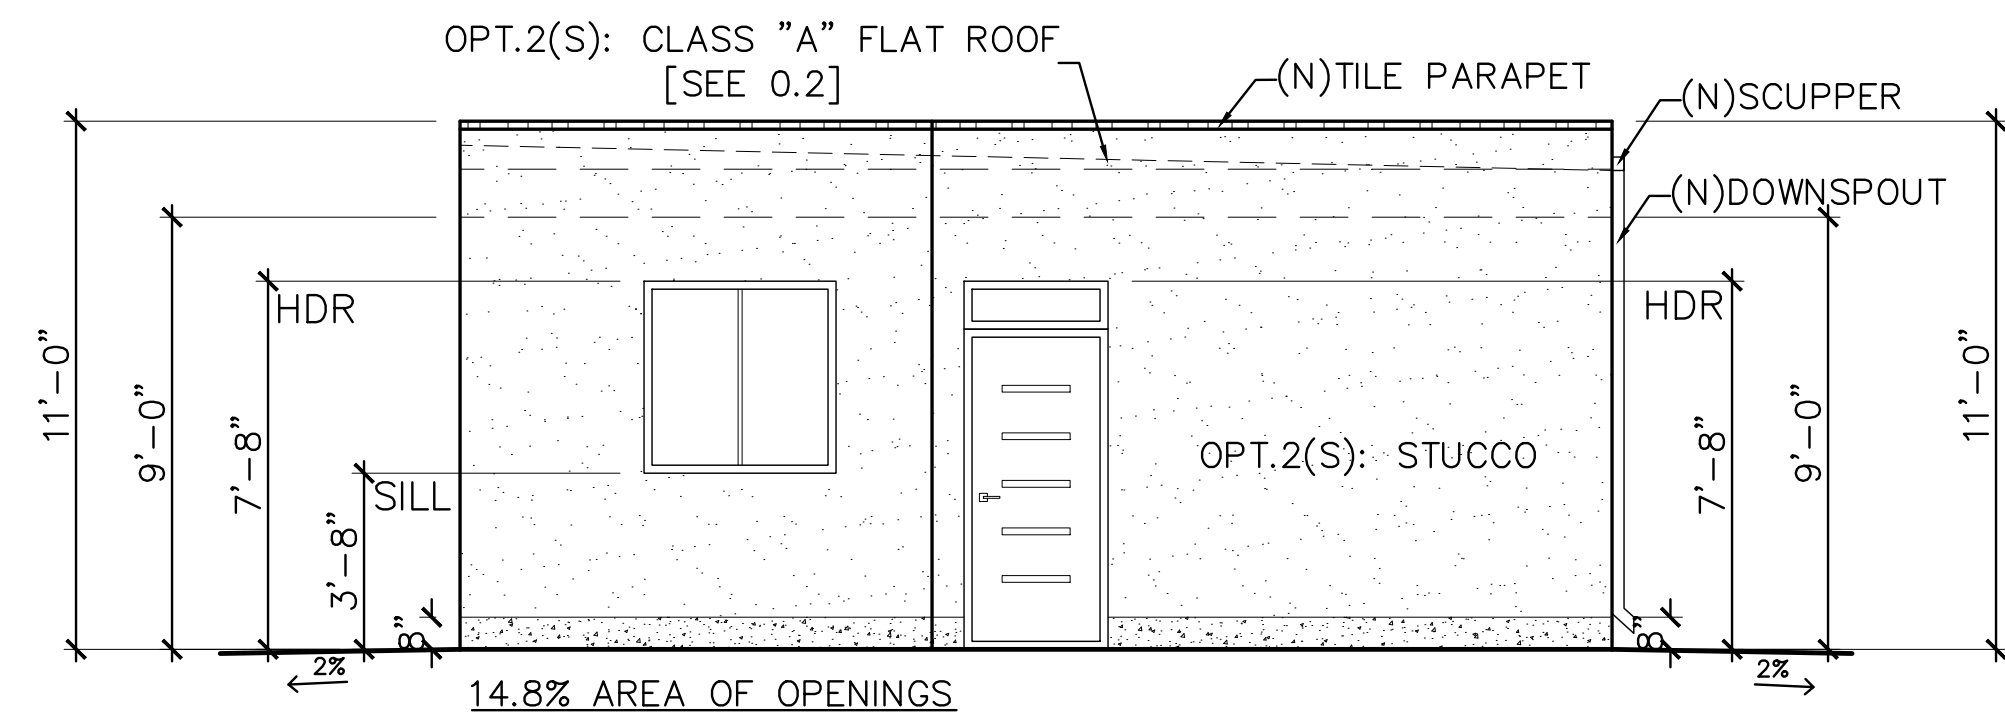


**ELEVATION A
(OPTION 2)**

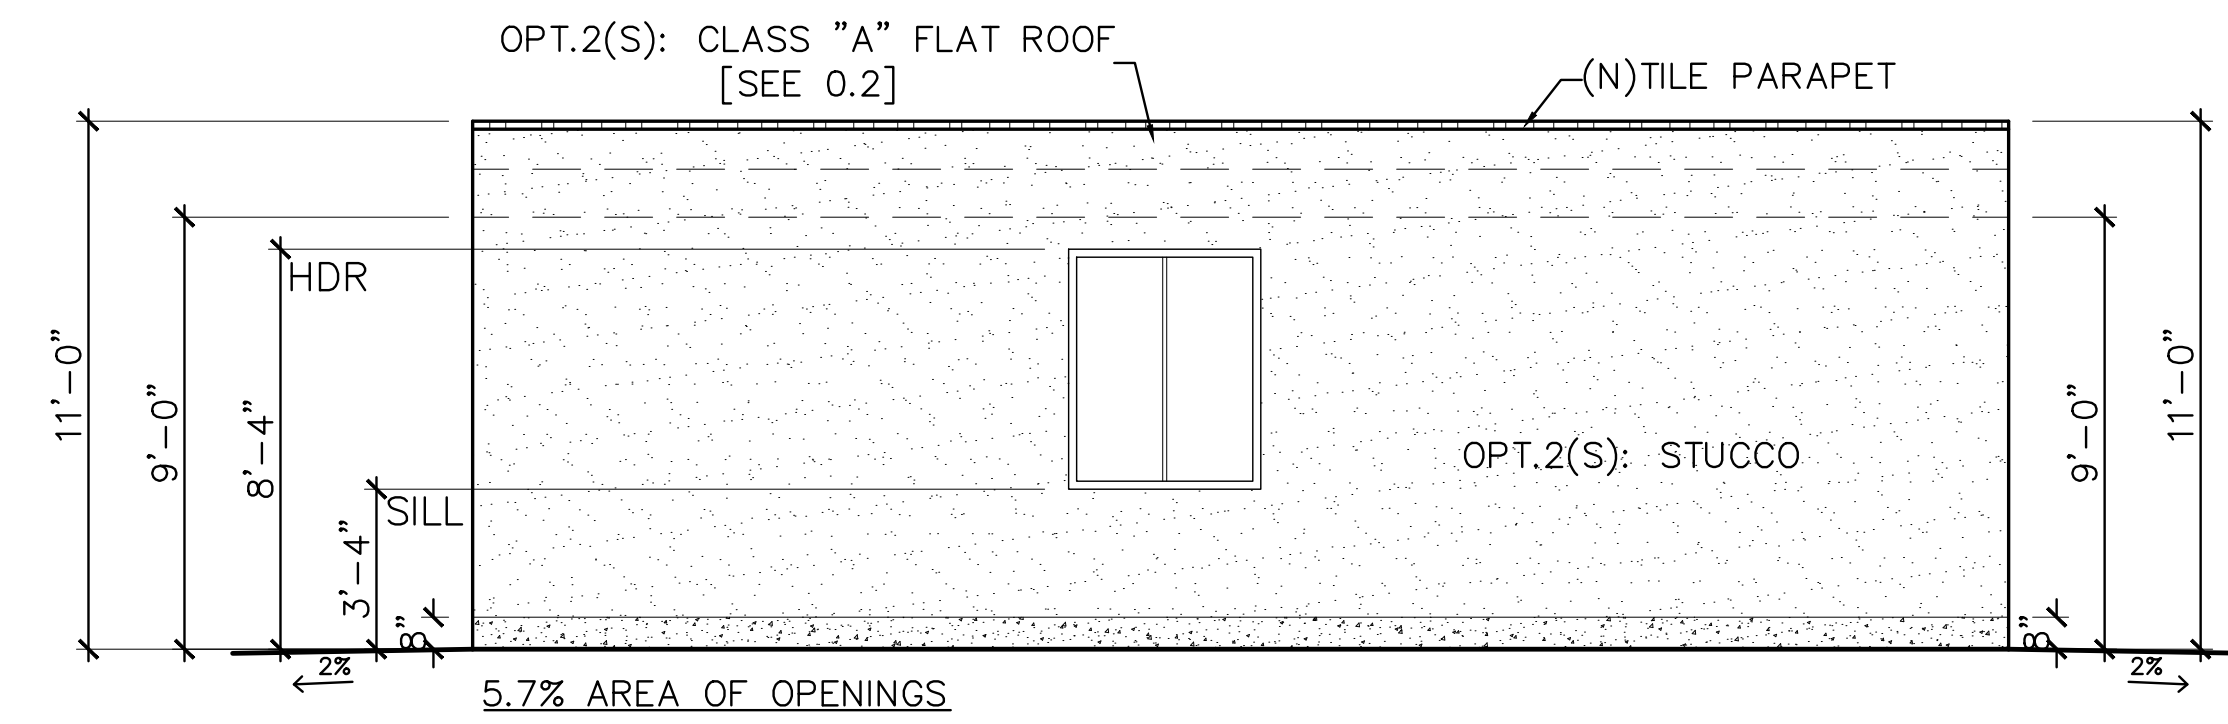


**ELEVATION B
(OPTION 2)**

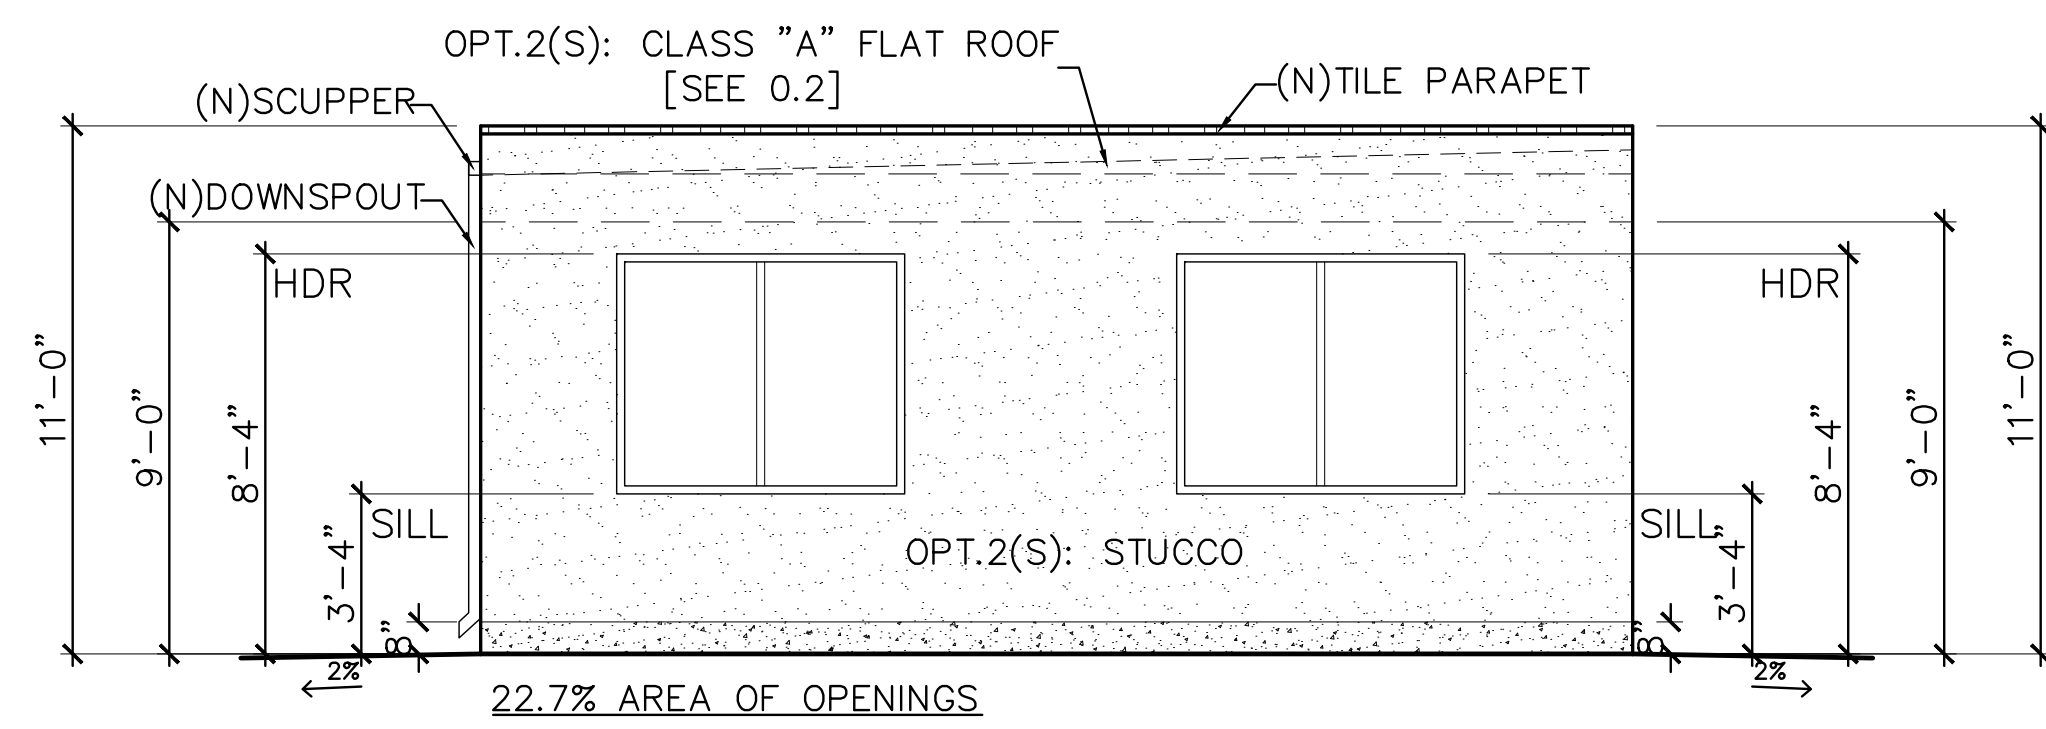


**ELEVATION C
(OPTION 2)**

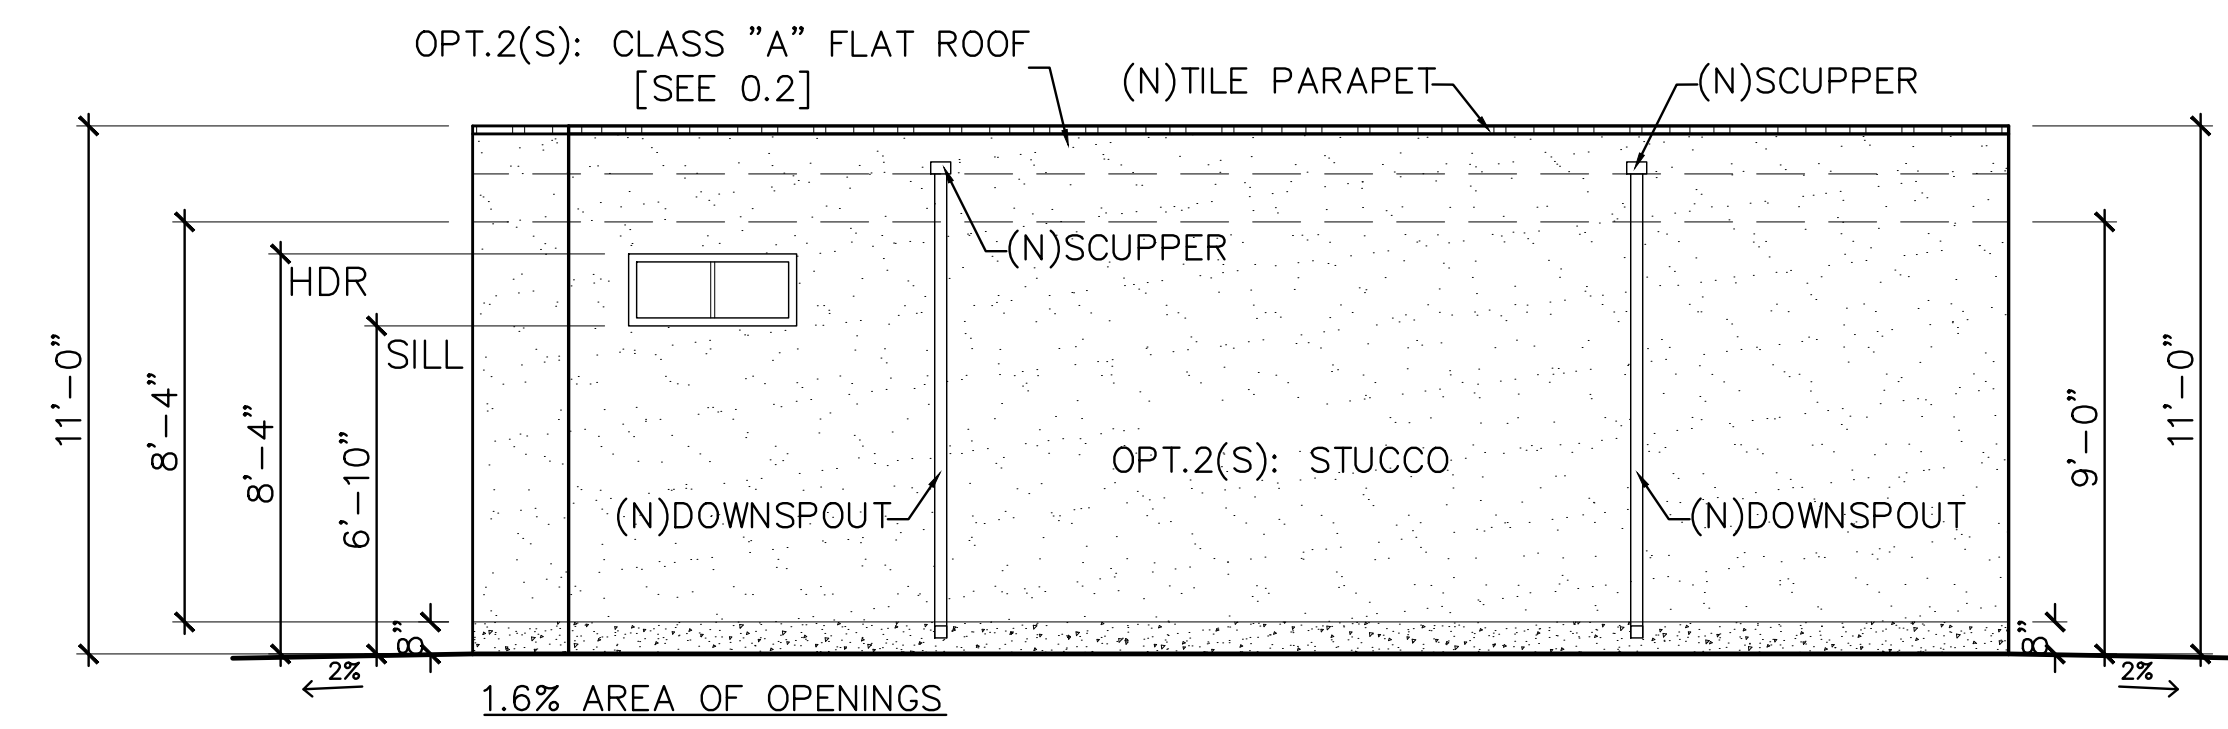

**ELEVATION D
(OPTION 2)**

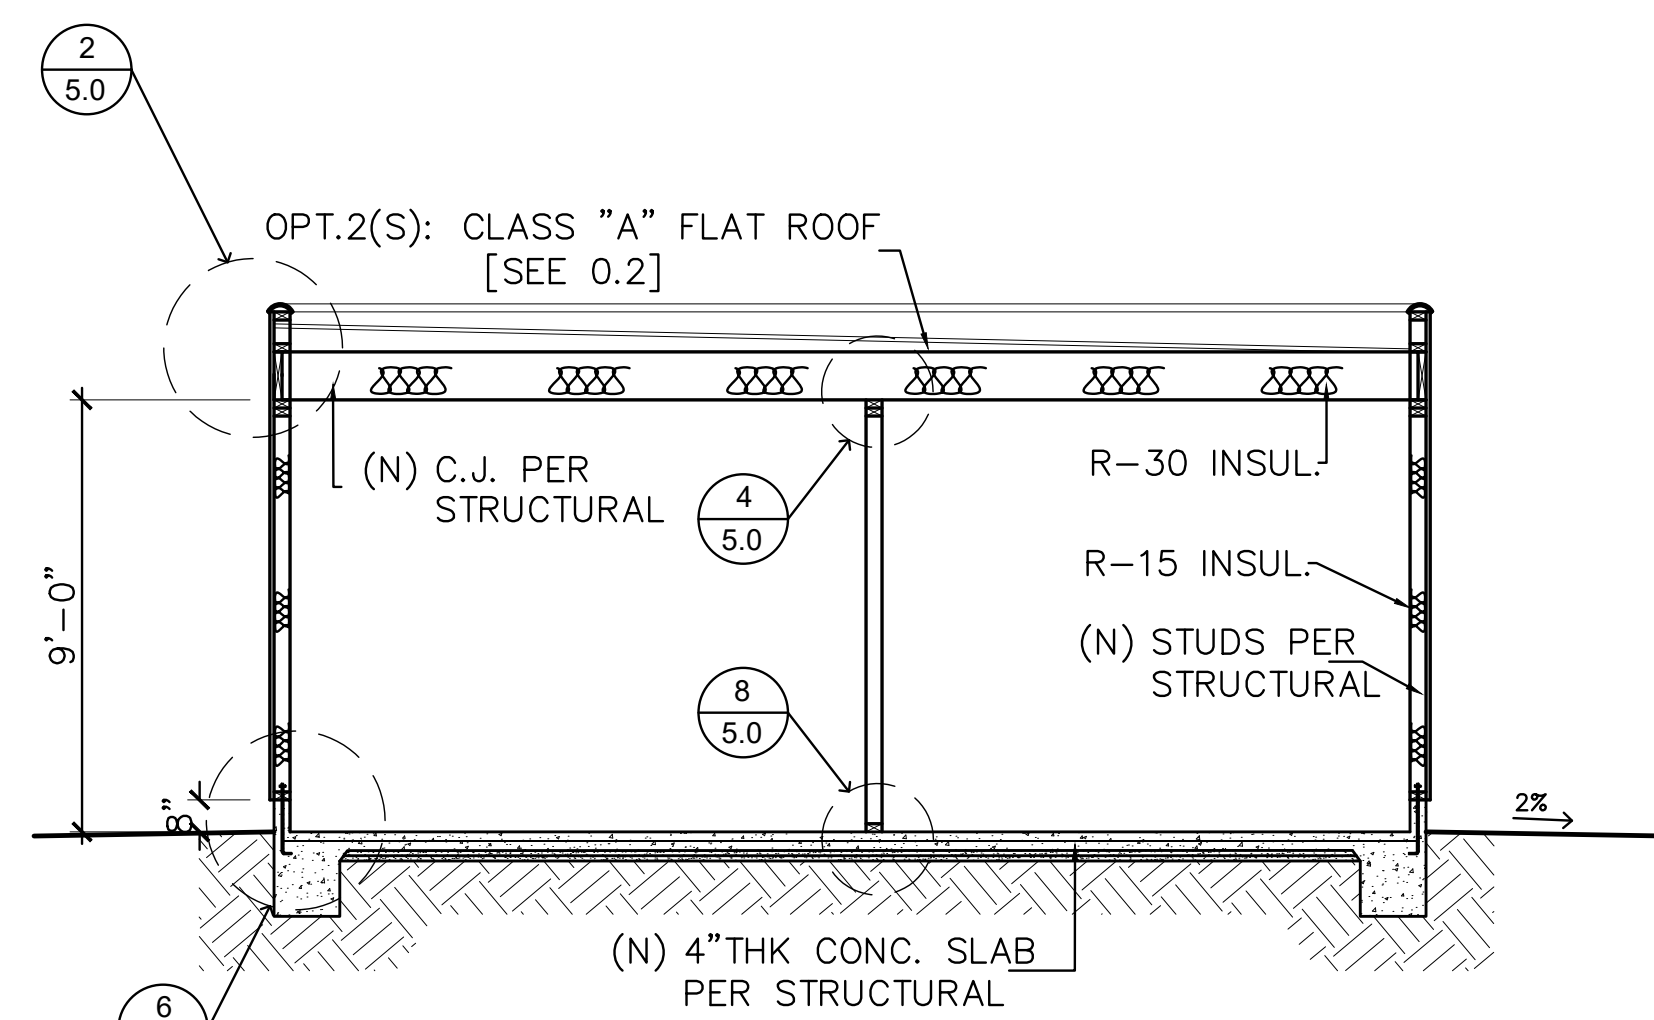


**SECTION A-A
(OPTION 2)**

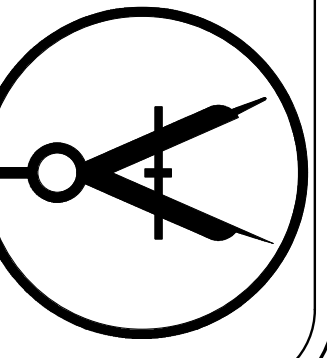

ADDRESS

PROPOSED ADU
ELEVATIONS, SECTION A-A
(OPTION 2)


SCALE: 1/4"=1'-0"
DATE: 04.22.2024

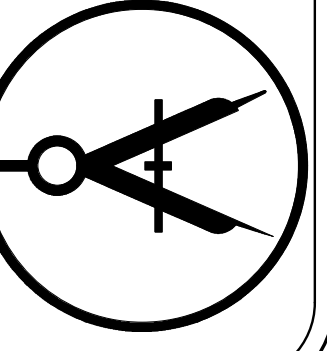


ADDRESS

DETAILS


SCALE:
 DATE: 04.22.2024

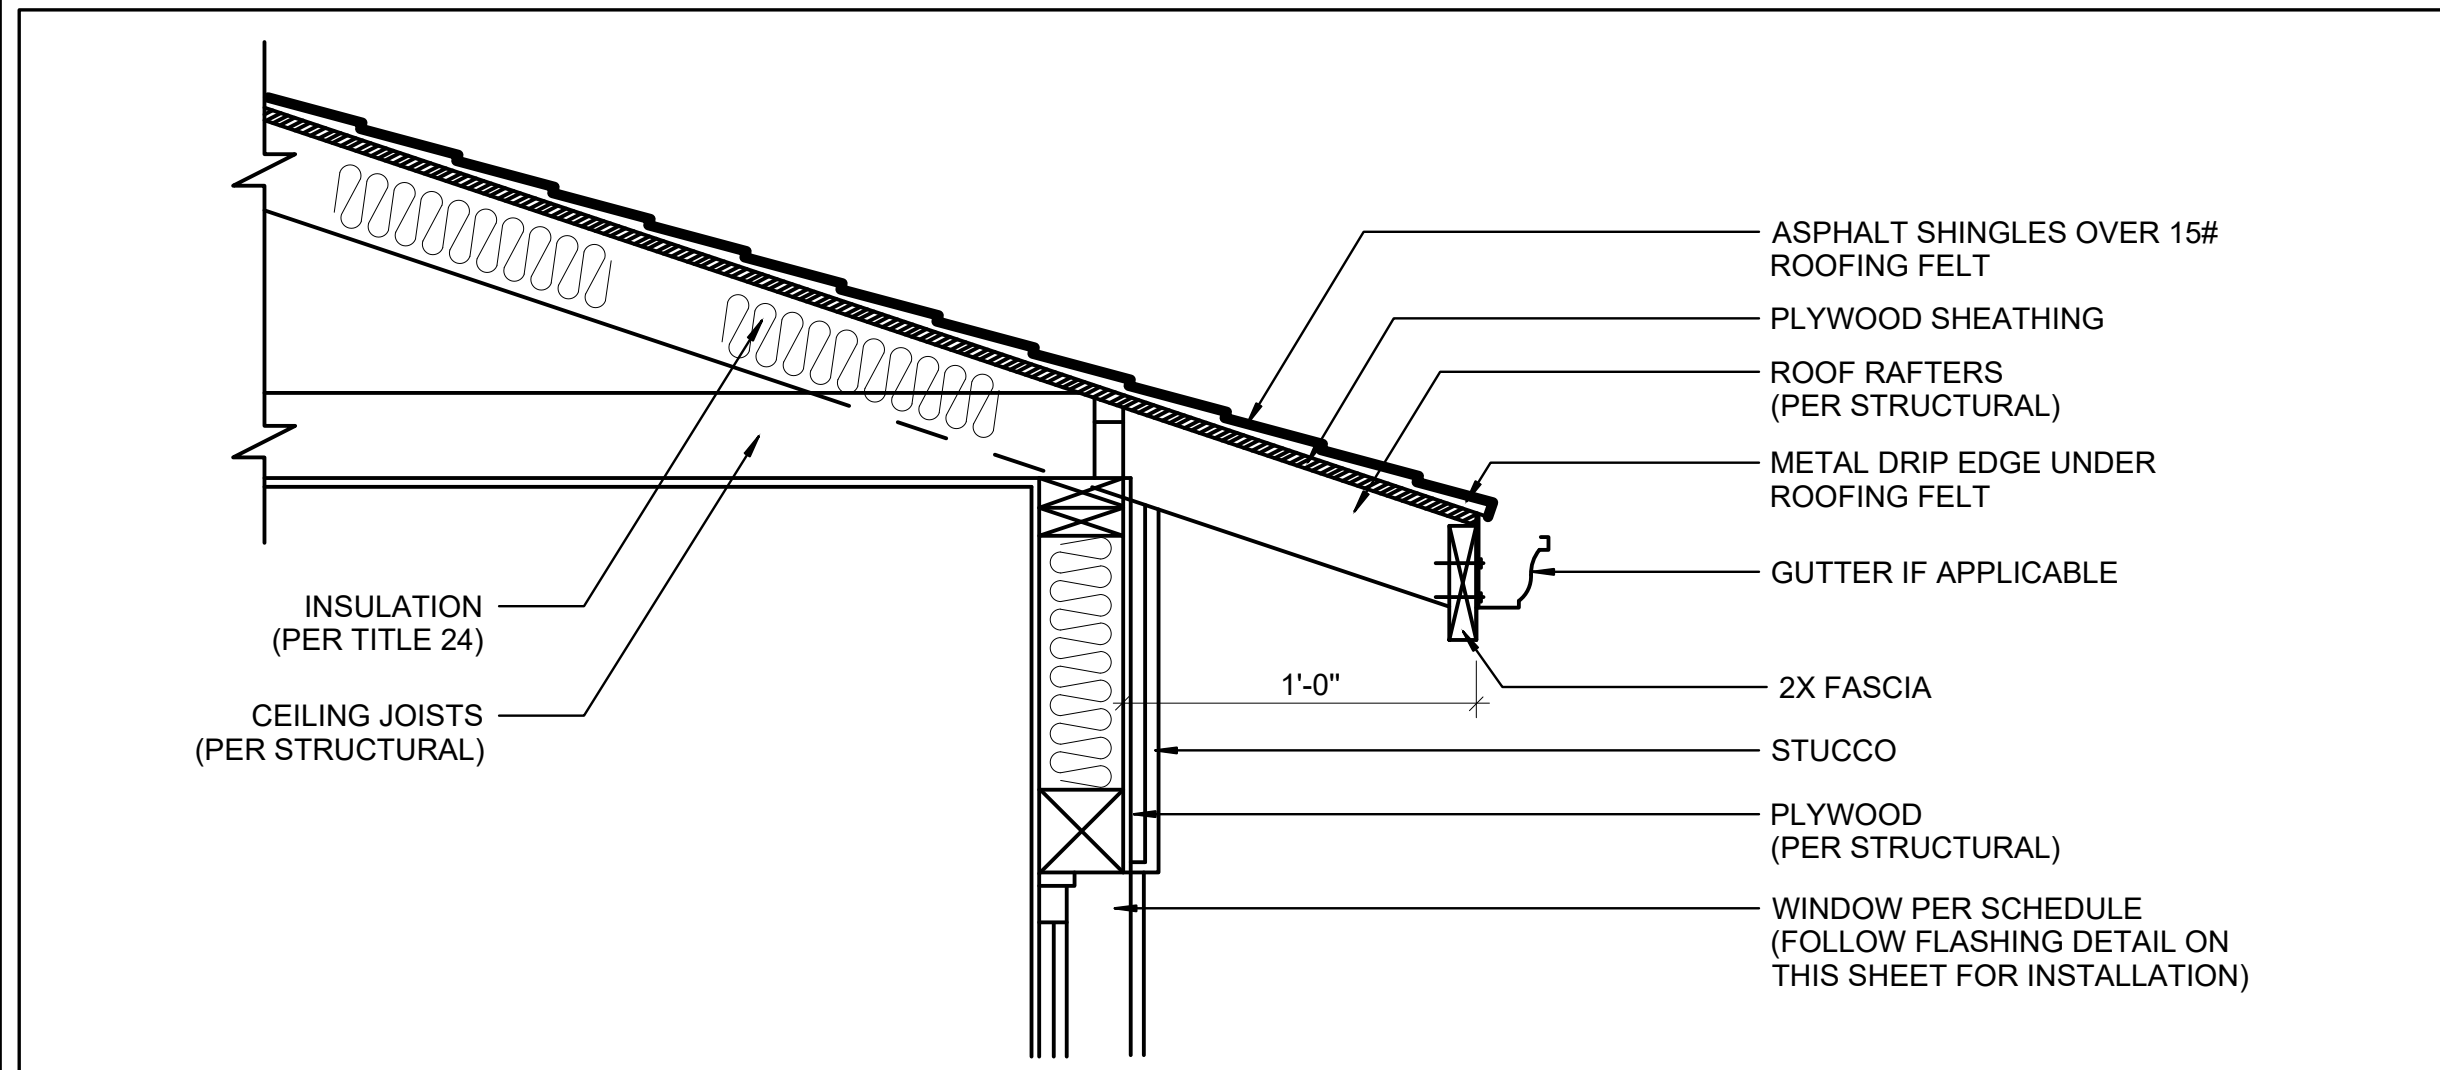


1 EAVE DETAIL

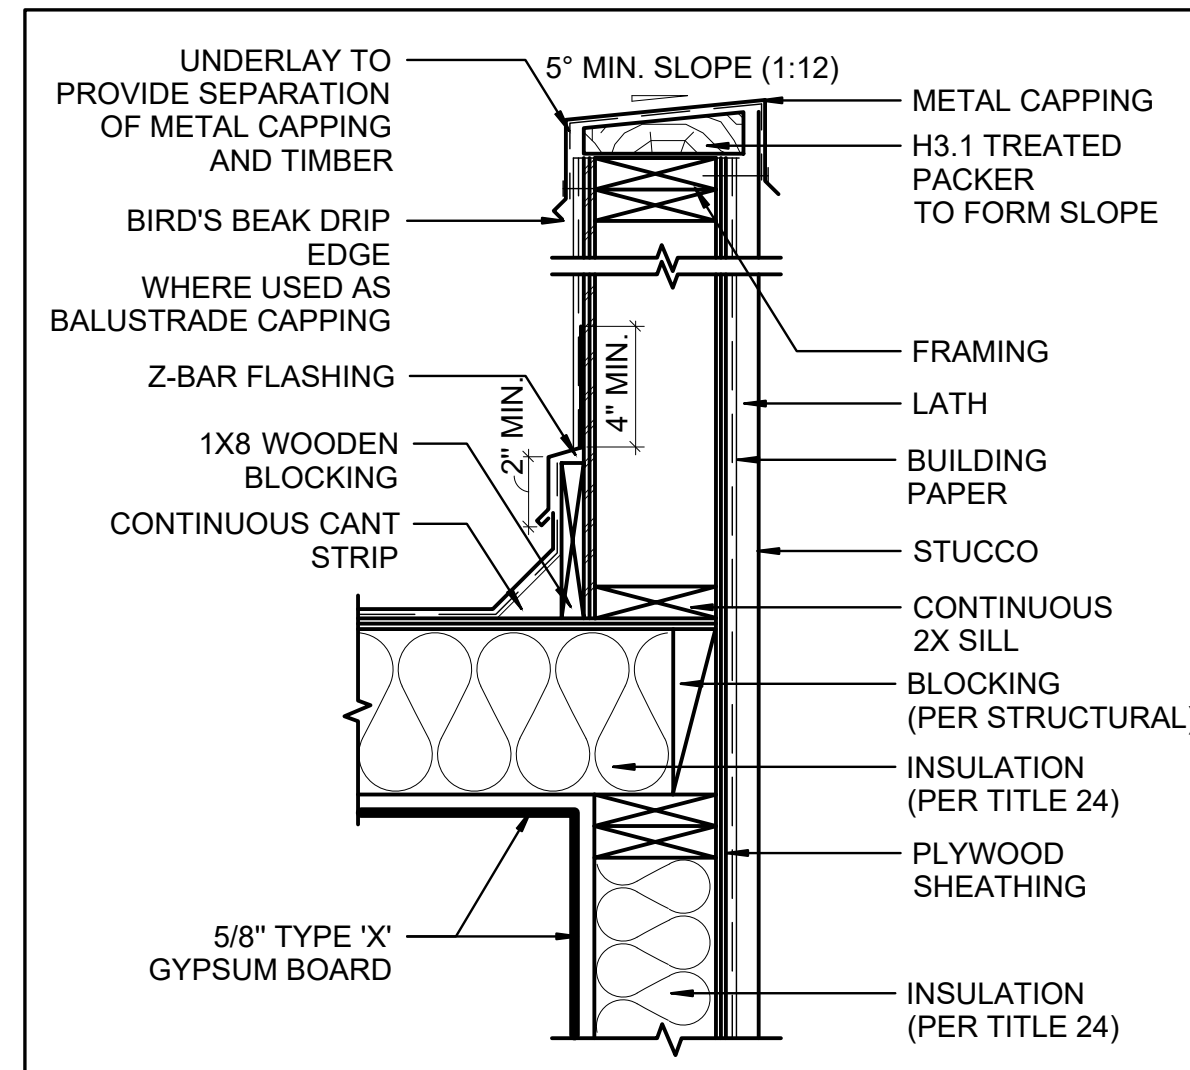


2 PARAPET DETAIL

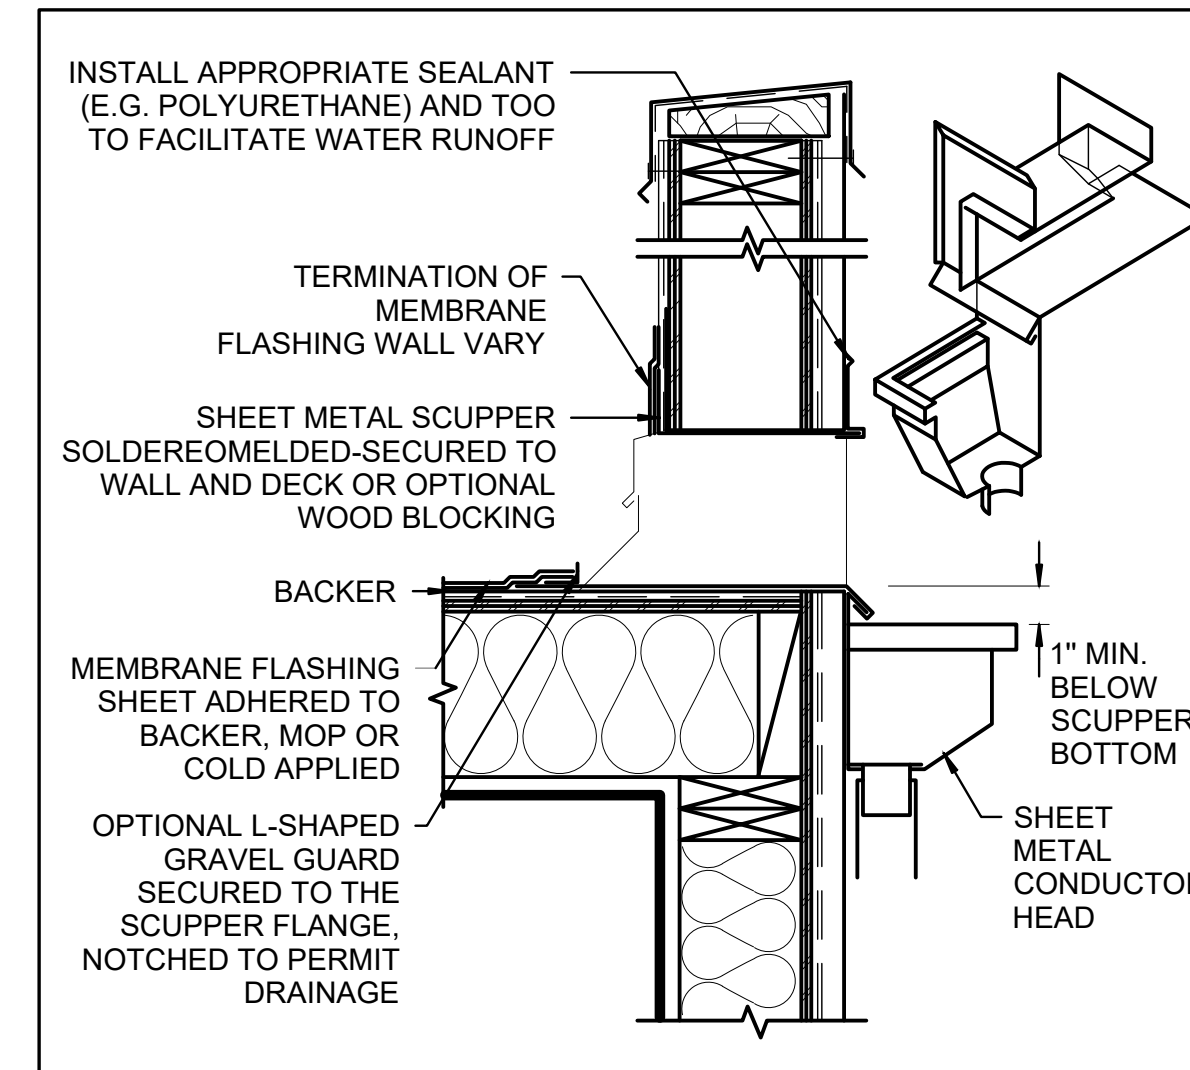


3 SCUPPER DETAIL

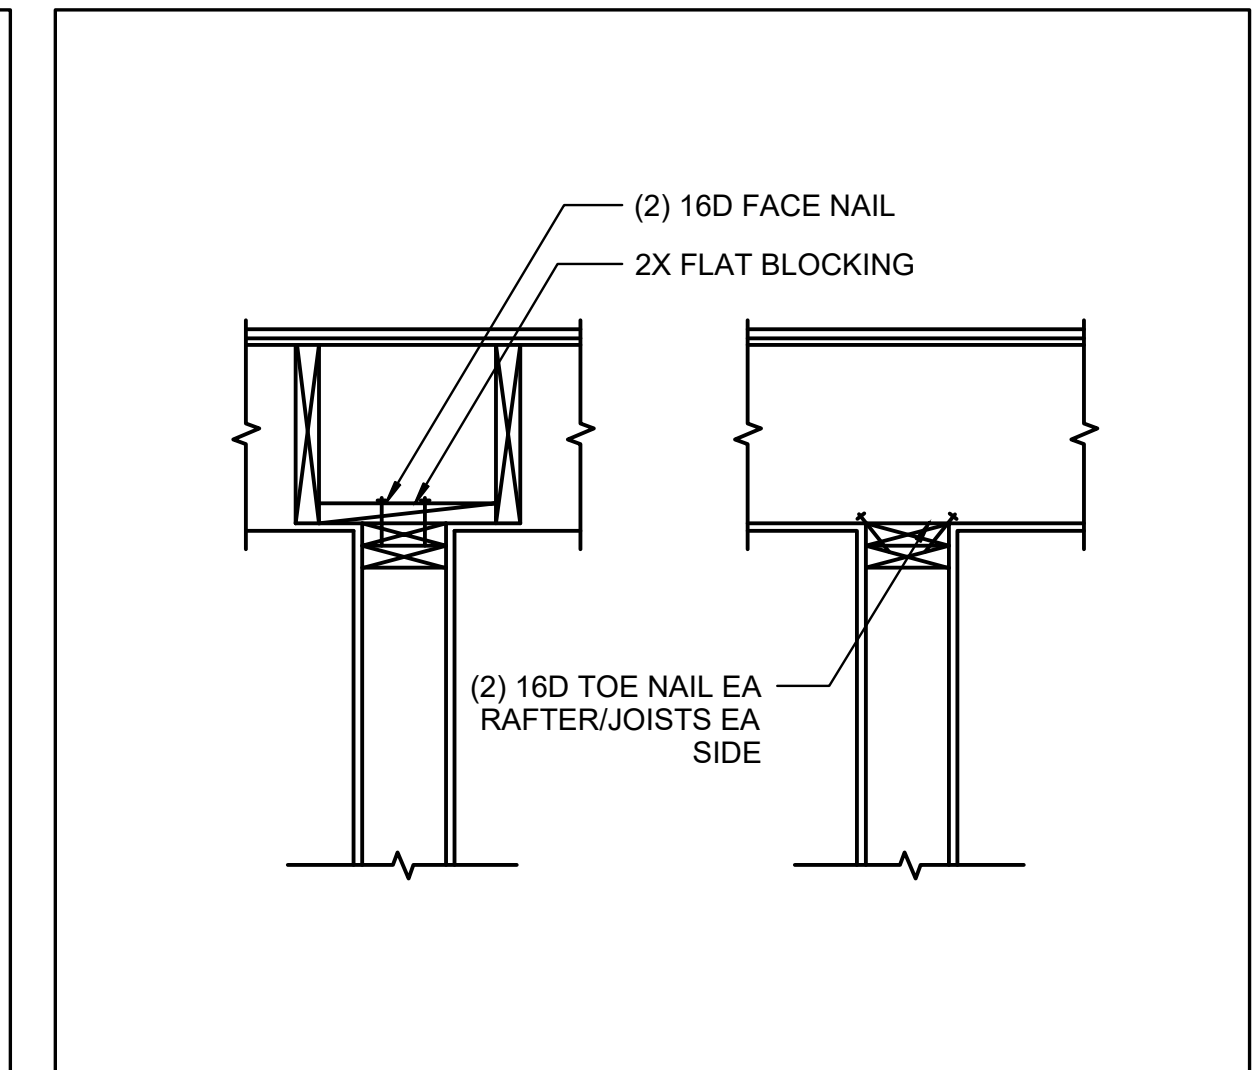


4 INTERIOR PARTITIONS DETAIL (UPPER)

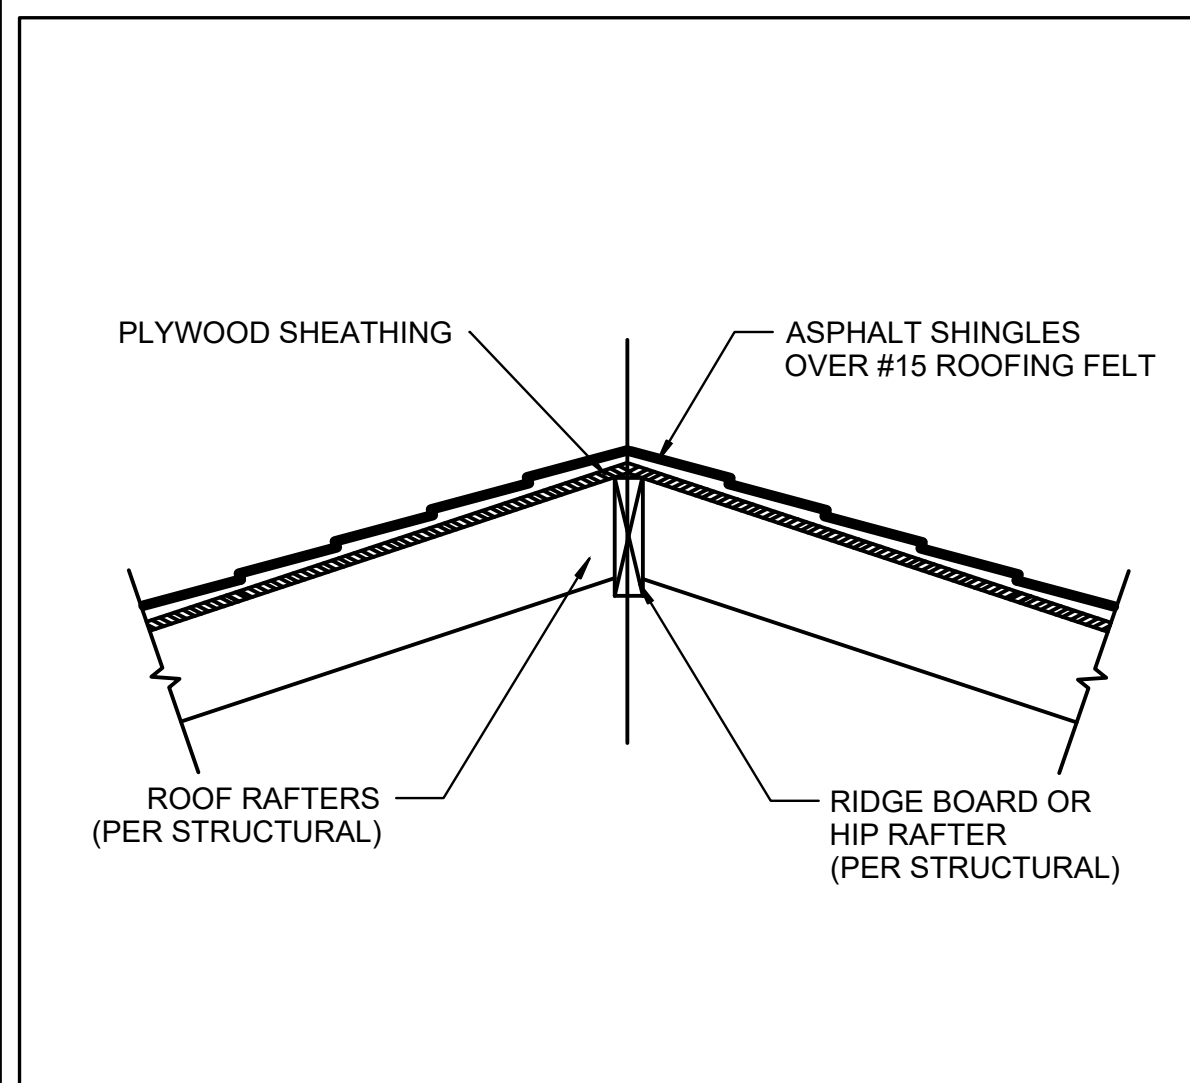


5 RIDGE AND HIP FLASHING

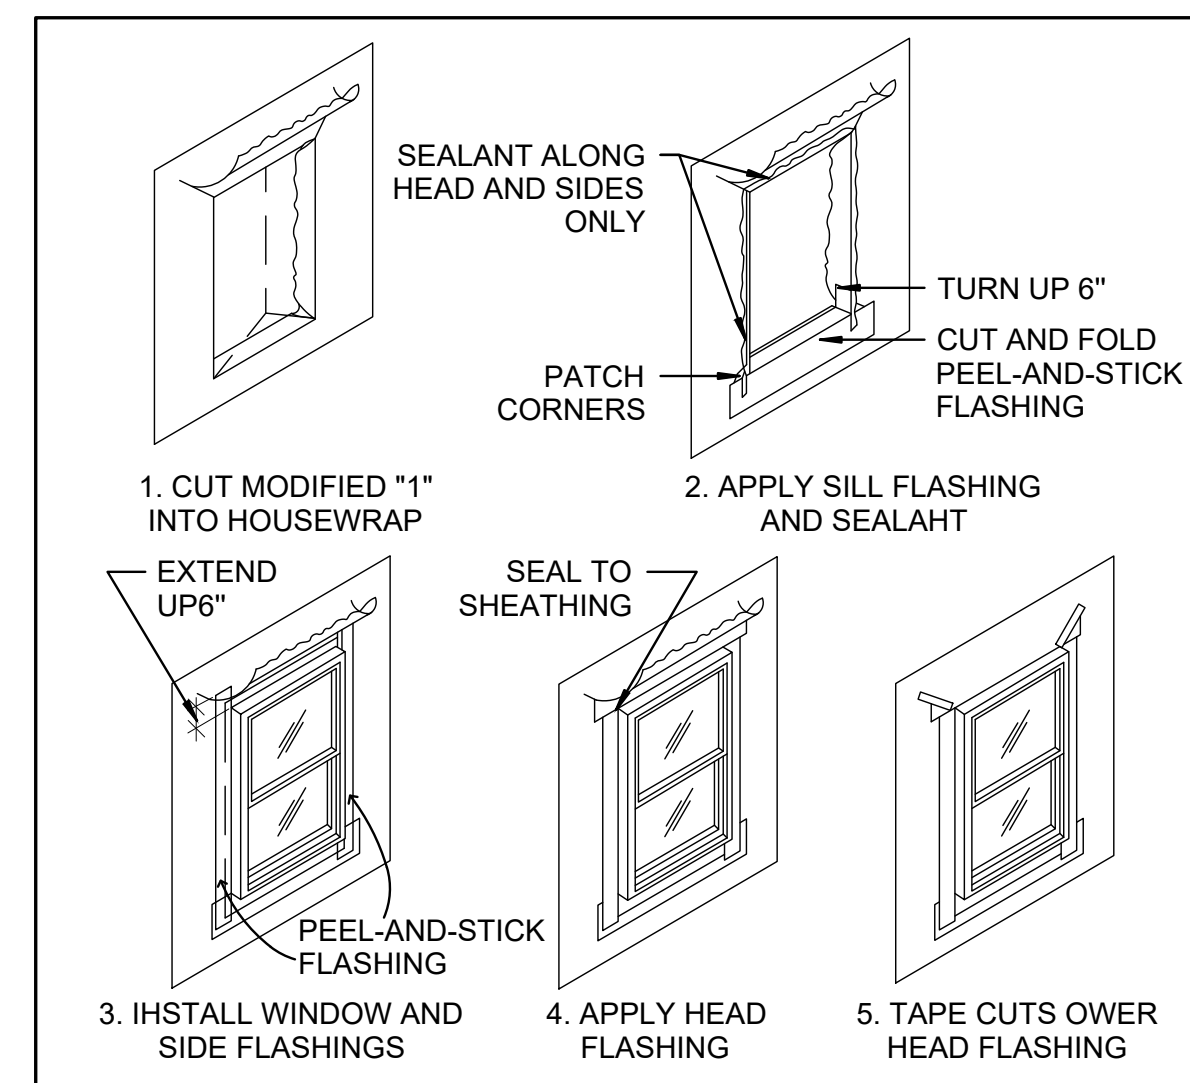


6 WINDOW FLASHING

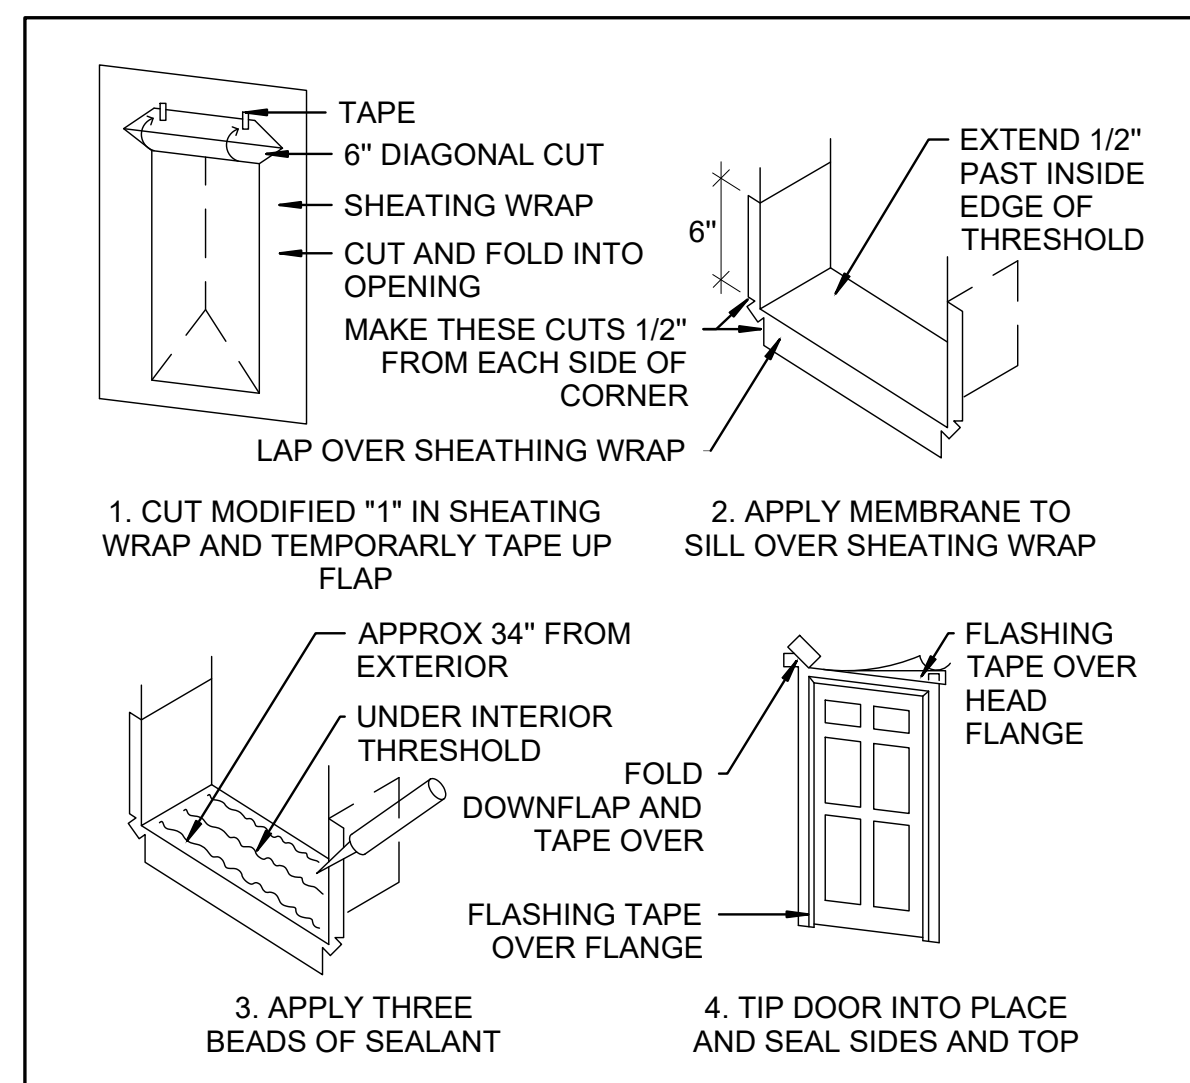


7 DOOR FLASHING

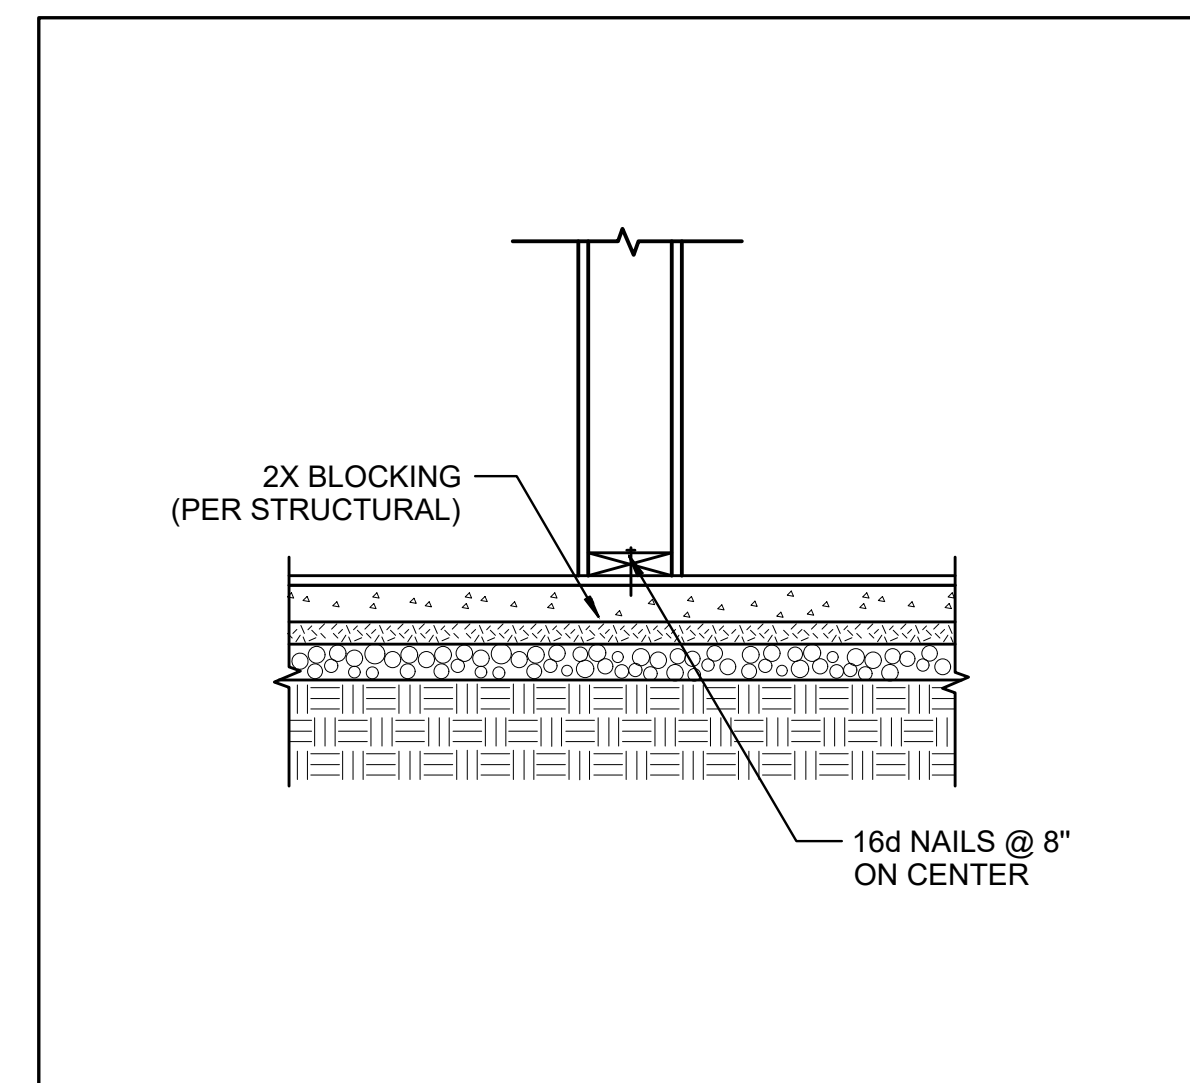


8 INTERIOR PARTITIONS DETAIL (LOWER)

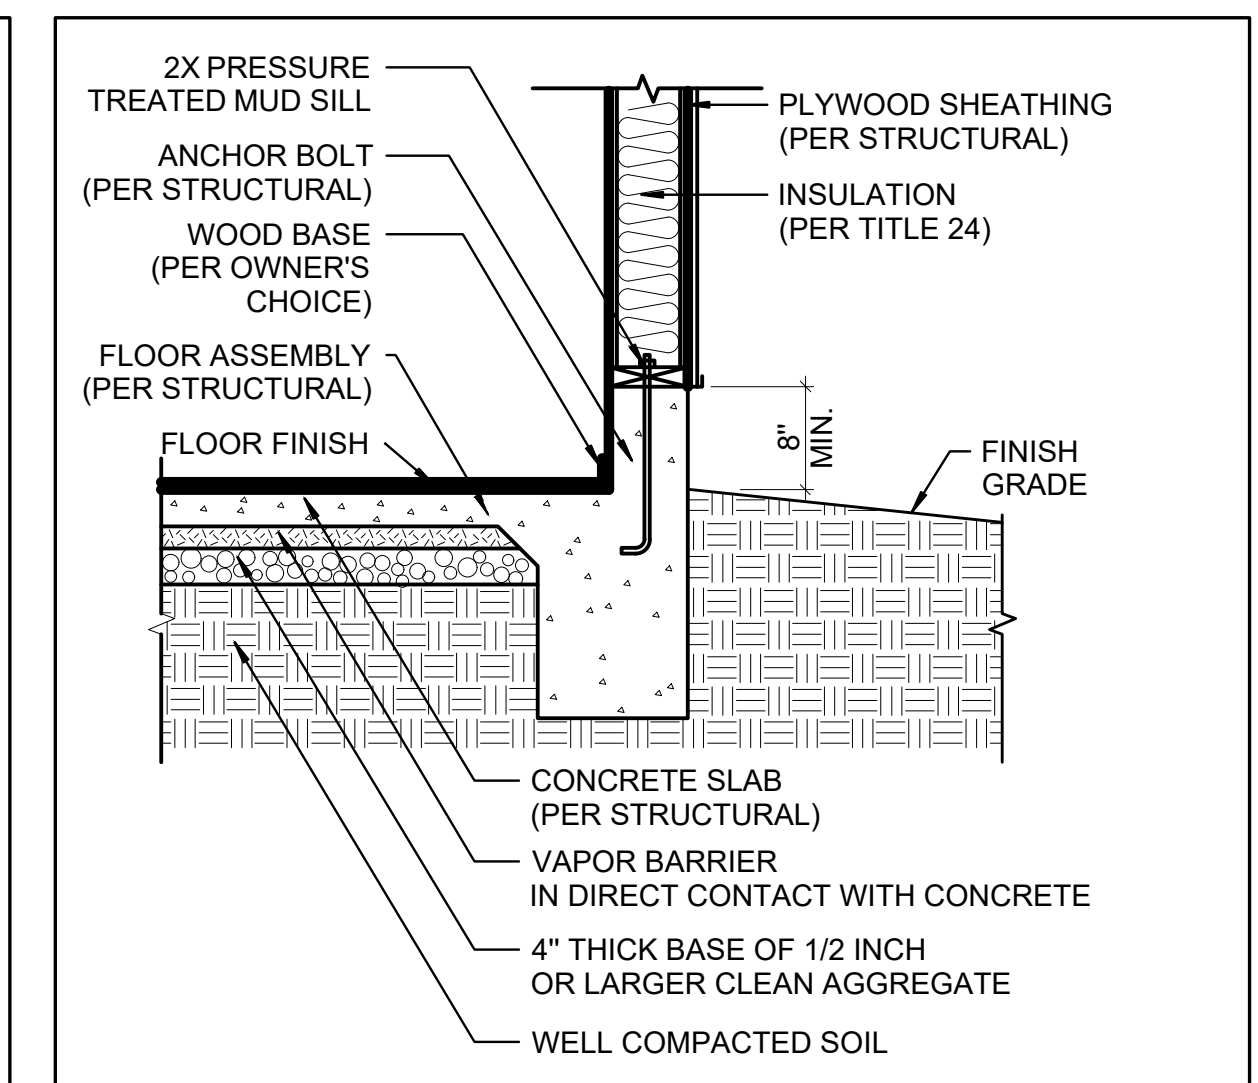


9 EXTERIOR WALL AT FIRST FLOOR

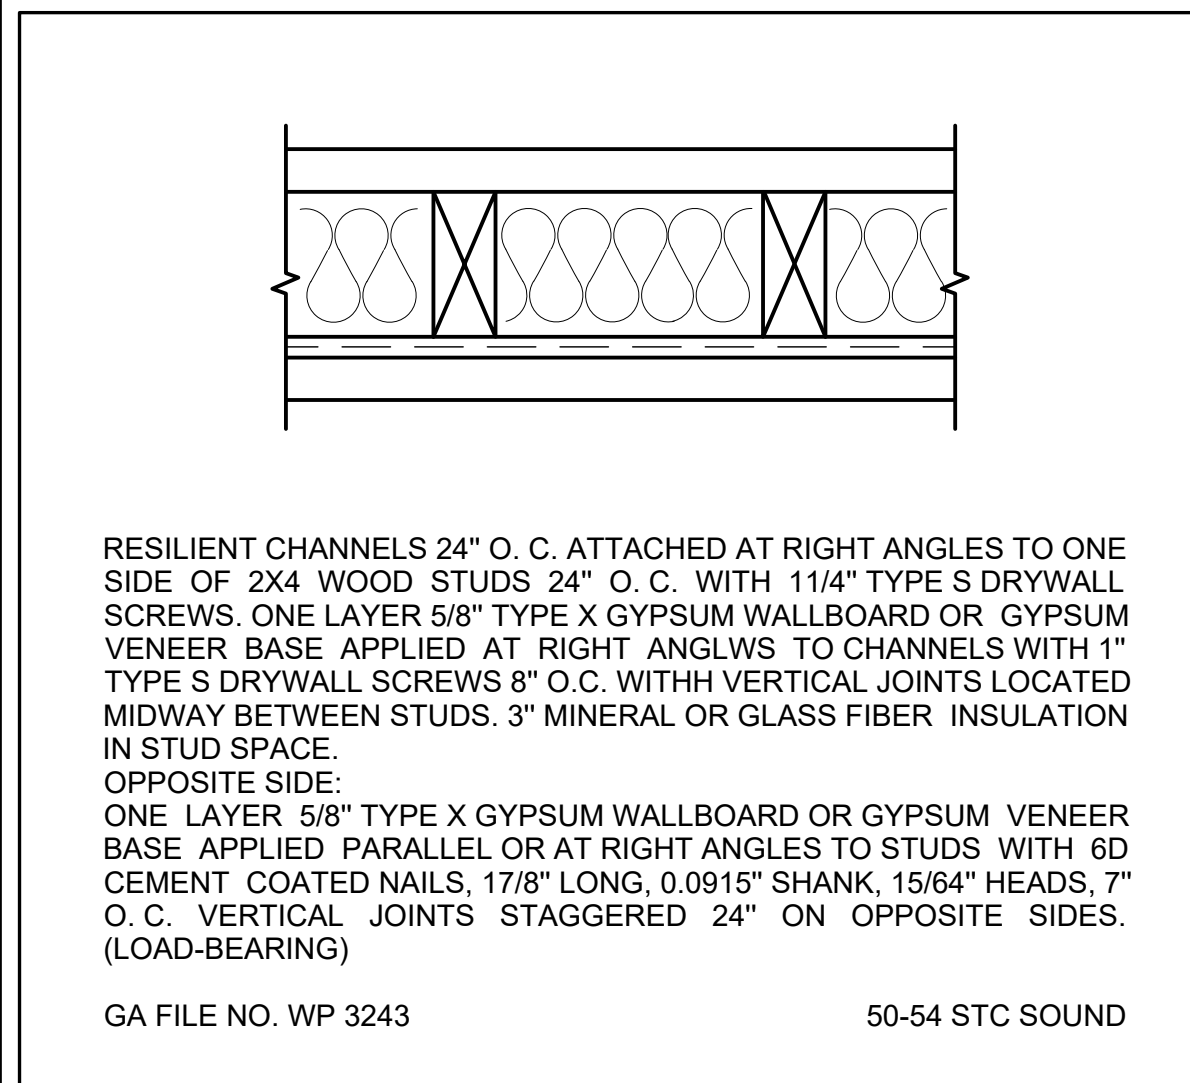

10 1-HR RATED FIRE WALL DETAIL

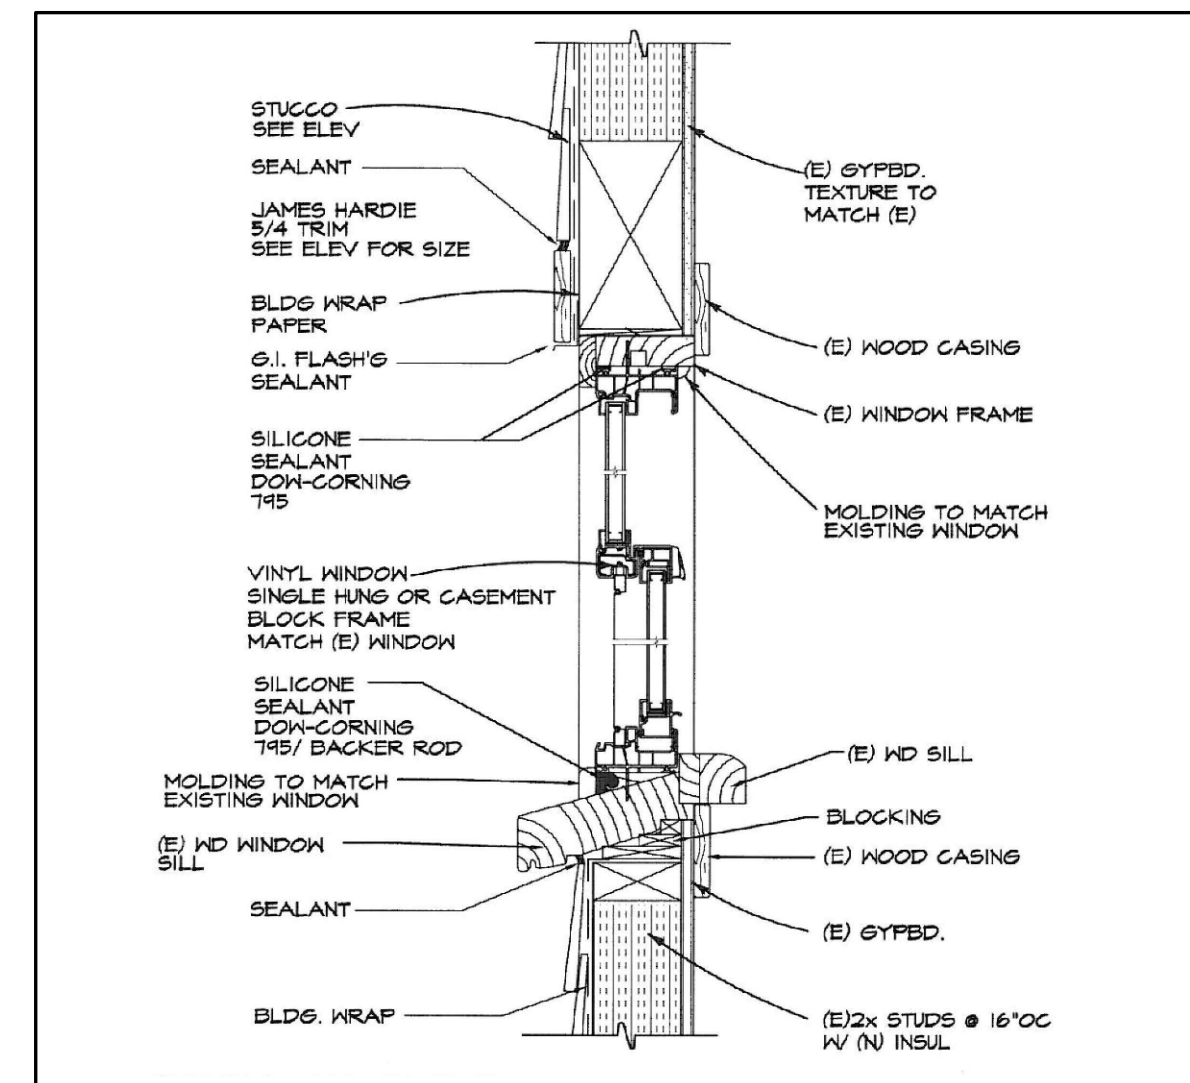

11 RECESSED WINDOW DETAIL

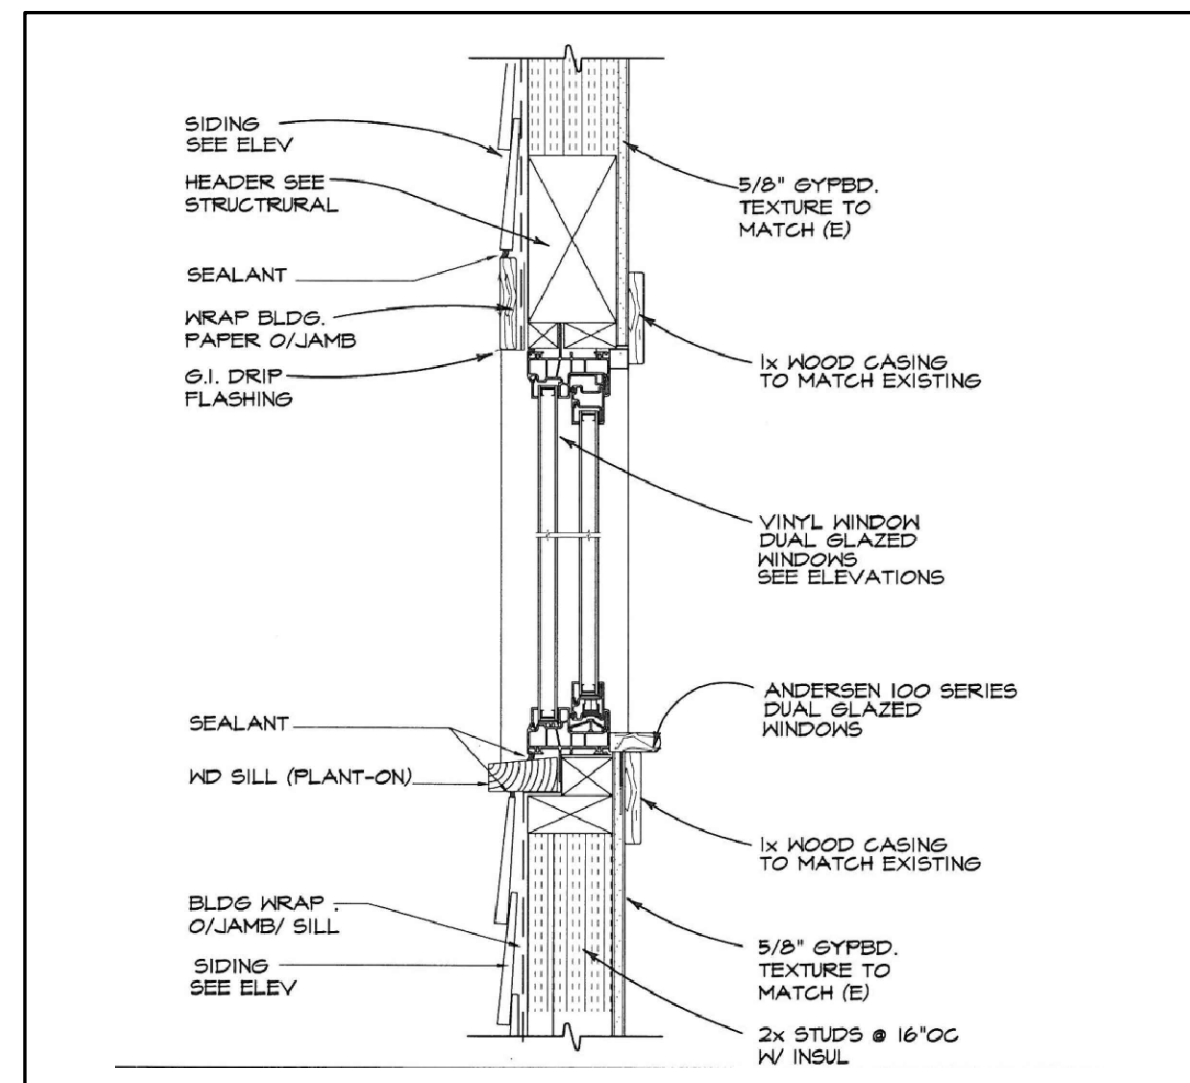

12 RECESSED WINDOW DETAIL

ALL TRADES

A. THE FOLLOWING ABBREVIATIONS OR ACRONYMS MAY BE USED IN THESE DRAWINGS:

- PROJECT = NEW ADU
- ARCHITECT = YAKOV DESIGN
- SAA = SAA STRUCTURAL ENGINEERING
PRIMARY CONTACT: NICK SIVUSHENKA, P.E.
- GEOTECHNICAL ENGINEER = N/A
- BUILDING DEPARTMENT = THE CITY OF LOS ANGELES DEPARTMENT OF BUILDING AND SAFETY
- IBC = THE INTERNATIONAL BUILDING CODE, 2018 EDITION; SECONDARY BUILDING CODE FOR PROJECT.
- CBC = THE CALIFORNIA BUILDING CODE, 2019 EDITION (CONSISTING OF THE 2018 IBC AS ADOPTED BY THE STATE OF CALIFORNIA); SECONDARY BUILDING CODE FOR PROJECT
- ICC = THE INTERNATIONAL CODE CONFERENCE; AUTHOR OF IBC, SOURCE AUTHORITY FOR GENERAL CODE REQUIREMENTS.
- ACI = THE AMERICAN CONCRETE INSTITUTE; SOURCE AUTHORITY FOR STRUCTURAL CONCRETE WORK.
- AISC = THE AMERICAN INSTITUTE OF STEEL CONSTRUCTION; SOURCE AUTHORITY FOR STRUCTURAL STEEL WORK.
- AISI = THE AMERICAN IRON AND STEEL INSTITUTE; SOURCE AUTHORITY FOR LIGHT GAGE STEEL FRAMING.
- AWS = THE AMERICAN WELDING SOCIETY; SOURCE AUTHORITY FOR WELDING.
- ASTM = THE AMERICAN SOCIETY FOR TESTING OF MATERIALS; SOURCE AUTHORITY FOR MATERIAL QUALITY AND TESTING STANDARDS.
- CRSI = THE CONCRETE REINFORCING STEEL INSTITUTE; SOURCE AUTHORITY FOR REINFORCING STEEL FABRICATION AND INSTALLATION STANDARDS.
- ABV = ABOVE
- A.B. = ANCHOR BOLTS(S)
- APX = APPROXIMATE OR APPROXIMATELY
- ARCH = ARCHITECTURAL
- BTWN = BETWEEN
- REQD = REQUIRED
- BLW = BELOW
- BOT = BOTTOM
- COL = COLUMN
- CONT = CONTINUOUS
- (E) = EXISTING (CONTRACTOR TO FIELD VERIFY)
- EA = EACH
- EL = ELEVATION
- EMBD = EMBEDMENT
- EQ = EQUAL
- FIN = FINISH (SEE ARCHITECTURAL DETAILS)
- FOF = FACE OF FINISH
- FP = FULL PENETRATION (WELD)
- F.S. = FAR SIDE
- GA = GAGE (SHEET METAL OR WIRE AS APPLICABLE)
- HORZ = HORIZONTAL
- LLH = LONG LEG HORIZONTAL (ORIENTATION OF UNEQUAL LEG ANGLE)
- LLV = LONG LEG VERTICAL (ORIENTATION OF UNEQUAL LEG ANGLE)
- LSH = LONG SIDE HORIZONTAL (ORIENTATION OF RECTANGULAR TUBE)
- LSV = LONG SIDE VERTICAL (ORIENTATION OF RECTANGULAR TUBE)
- MAX = MAXIMUM
- M.B. = MACHINE BOLTS OR BOLTS (INDICATED ASTM A307 FASTENERS)
- MIN = MINIMUM
- (N) = NEW
- NIC = NOT IN CONTRACT (WORK EXCLUDED FROM SCOPE)
- NOM = NOMINAL
- NTS = NOT TO SCALE
- O.C. = ON CENTER
- OP = OPPOSITE
- PC = PIECE
- PP = PARTIAL PENETRATION (WELD)
- PSF = POUNDS PER SQUARE FOOT
- ROD = REQUIRED
- SIM = SIMILAR
- SMS = SHEET METAL SCREW (SELD TAPPING UNO)
- SYM = SYMMETRICAL OR STMMETRY
- STD = STANDARD
- TOC = TOP OF CONCRETE
- TOF = TOP OF FINISH
- TOS = TOP OF STEEL (NOT TOP OF SLAB)
- TYP = TYPICAL
- UNO = UNLESS NOTED OTHERWISE
- VERT = VERTICAL

B. LADBS NOTES:

1. CONTRACTORS RESPONSIBLE FOR THE CONSTRUCTION OF A WIND OR SEISMIC FORCE RESISTING SYSTEM/COMPONENT LISTED IN THE STATEMENT OF SPECIAL INSPECTION SHALL SUBMIT A WRITTEN STATEMENT OF RESPONSIBILITY TO THE LADBS INSPECTORS AND THE OWNER PRIOR TO THE COMMENCEMENT OF WORK ON SUCH SYSTEM OR COMPONENT PER SEC 1704.4.
2. CONTINUOUS SPECIAL INSPECTION BY A REGISTERED DEPUTY INSPECTOR IS REQUIRED FOR FIELD WELDING, POST-INSTALLED ADHESIVE ANCHORS INSTALLED HORIZONTALLY OR UPWARDLY INCLINED TO RESIST SUSTAINED TENSION LOADS, SHOTCRETE PLACEMENT, CONCRETE STRENGTH F-C > 2500 PSI, SPRAYED-ON FIREPROOFING, ENGINEERED MASONRY, HIGH-LIFT GROUTING, HIGH LOAD DIAPHRAGMS, SPECIAL MOMENT-RESISTING CONCRETE FRAMES, AND HELICAL PILE FOUNDATIONS.
3. FOUNDATION SILLS SHALL BE NATURALLY DURABLE OR PRESERVATIVE-TREATED WOOD.
4. SHOP WELDS MUST BE PERFORMED IN A LADBS LICENSED FABRICATOR SHOP
5. LADBS LICENSED FABRICATOR IS REQUIRED FOR STRUCTURAL STEEL
6. PROVIDE LEAD HOLE 40% - 70% OF THREADED SHANK DIAMETER AND FULL DIAMETER FOR SMOOTH SHANK PORTION.
7. PERIODIC SPECIAL INSPECTION IS REQUIRED FOR WOOD SHEAR WALLS, SHEAR PANELS, AND DIAPHRAGMS, INCLUDING NAILING, BOLTING, ANCHORING, AND OTHER FASTENING TO COMPONENTS OF THE SEISMIC FORCE RESISTING SYSTEM. SPECIAL INSPECTION BY A DEPUTY INSPECTOR IS REQUIRED WHERE THE FASTENER SPACING OF THE SHEATHING IS 4 INCHES ON CENTER OR LESS.
8. PERIODIC SPECIAL INSPECTION IS REQUIRED FOR WOOD SHEAR WALLS, SHEAR PANELS, AND DIAPHRAGMS, INCLUDING NAILING, BOLTING, ANCHORING, AND OTHER FASTENING TO COMPONENTS OF THE SEISMIC FORCE RESISTING SYSTEM. SPECIAL INSPECTION BY A DEPUTY INSPECTOR IS REQUIRED WHERE THE FASTENER SPACING OF THE SHEATHING IS 4 INCHES ON CENTER OR LESS.

C. THE CONTRACTOR SHALL VERIFY EXISTING CONDITIONS ON THE SITE.

1. THE CONTRACTOR SHALL MAKE A SURVEY FOR GENERAL CONSISTENCY OF FIELD CONDITIONS WITH INFORMATION SHOWN IN THE CONTRACT DOCUMENTS BEFORE STARTING WORK. THIS SURVEY SHALL INCLUDE VERIFICATION OF DIMENSIONS AND ELEVATIONS.
2. SHOULD THE CONTRACTOR BECOME AWARE OF A DISCREPANCY OR INCONSISTENCY BETWEEN FIELD CONDITIONS AND INFORMATION SHOWN IN THE CONTRACT DOCUMENTS AT ANY TIME, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY ARCHITECT IF THE DISCREPANCY OR INCONSISTENCY INVOLVES OR EFFECTS WORK SHOWN IN THE STRUCTURAL DRAWINGS, SAA SHALL ALSO BE NOTIFIED, AND THE CONTRACTOR SHALL OBTAIN DIRECTION FROM SAA BEFORE PROCEEDING WITH AFFECTED WORK.
3. THE CONTRACTOR SHALL CONFIRM AND LIMIT LOADS IMPOSED ON THE STRUCTURE BY NEW MECHANICAL EQUIPMENT OR OTHER NEW NONSTRUCTURAL ITEMS, INCLUDING FRAMES, CURBS OR OTHER SUPPORTS AS OCCUR. WEIGHTS AND OTHER LOADS SHALL BE COMPARED TO AND SHALL NOT EXCEED THOSE SHOWN IN THESE STRUCTURAL DRAWINGS. WHERE WEIGHTS OR LOADS ARE NOT SHOWN, THE CONTRACTOR SHALL DETERMINE AND SUBMIT THEM TO SAA, WHICH SHALL VERIFY COMPATIBILITY WITH STRUCTURAL DESIGN BEFORE INSTALLATION.
4. NO SUBSTITUTION, CHANGE OR OTHER DEVIATION FROM THE REQUIREMENTS OF ANY CONTRACT DOCUMENT SHALL BE MADE WITHOUT THE APPROVAL OF OWNER.
 - a. UNAUTHORIZED SUBSTITUTION, CHANGE OR DEVIATION SHALL BE SUFFICIENT CAUSE FOR REJECTION OF THE WORK AND/OR OF PAYMENT REQUESTS.
 - b. NO DEVIATION FROM INFORMATION SHOWN IN THE STRUCTURAL DRAWINGS SHALL BE MADE WITHOUT WRITTEN APPROVAL FROM SAA.
5. SHOP DRAWINGS AND OTHER SUBMITTALS PREPARED BY SUBCONTRACTORS SHALL BE REVIEWED BY THE GENERAL CONTRACTOR PRIOR TO SUBMISSION.
 - a. ACCEPTANCE OF A SHOP DRAWING SHALL NOT CONSTITUTE APPROVAL OF ANY DEVIATION FROM REQUIREMENTS OF THE CONTRACT DOCUMENTS.
 - b. REQUESTS FOR APPROVAL OF PROPOSED ALTERNATE DETAILS, MATERIAL SUBSTITUTIONS OR OTHER DEVIATIONS SHALL BE DIRECTED TO SAA INDEPENDENTLY FROM AND IN ADVANCE OF SUBMISSION OF AFFECTED SHOP DRAWINGS OR START-UP OF AFFECTED PARTS OF THE WORK.

D. THE CONTRACTOR SHALL BE RESPONSIBLE FOR SAFETY ON THE PROJECT SITE.

1. SHOULD THE CONTRACTOR BECOME AWARE OF ANY CONDITION WHICH IN HIS OPINION MIGHT CAUSE DISTRESS OF ANY PART OF THE CONSTRUCTION OR ENDANGER STABILITY, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY OWNER, ARCHITECT AND SAA AND TAKE ANY ACTION NECESSARY TO PROTECT LIFE AND PROPERTY PENDING DIRECTION FROM OWNER.
2. MEANS AND METHODS OF CONSTRUCTION SHALL BE SELECTED BY THE CONTRACTOR, WHO SHALL BE RESPONSIBLE FOR BRACING OR SHORING AS REQUIRED TO ASSURE SAFETY AND STABILITY DURING CONSTRUCTION AND TO SATISFY BUILDING DEPARTMENT REQUIREMENTS.

E. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO PLAN THE WORK SO AS TO MINIMIZE ITS IMPACT ON THE OPERATIONS OF THE BUILDING'S OCCUPANTS, WHO MAY INTEND TO ATTEMPT TO REMAIN IN OPERATION TO THE GREATEST EXTENT POSSIBLE DURING THE PROJECT.

1. NO PROCEDURE WHICH CAUSES DAMAGE TO THE BUILDING OR ITS CONTENTS OR WHICH AFFECTS OCCUPANT OPERATIONS SHALL BE USED UNLESS NO REASONABLE ALTERNATIVE THAT WOULD REDUCE THE IMPACT IS POSSIBLE.
2. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO INFORM THE OWNER OR LANDLORD OF ANY PROCEDURE WHICH MIGHT IMPACT THEIR OPERATIONS WITH AS MUCH ADVANCE NOTICE AS POSSIBLE AND TO MAKE ALL TREASONABLE EFFORTS TO COORDINATE OPERATIONS WITH THE OCCUPANTS SO AS TO MINIMIZE THE DISTURBANCE.

F. THE DESIGN REPRESENTED IN THESE DESIGN DRAWINGS IS BASED ON THE FOLLOWING DESIGN PARAMETERS:

1. **GRAVITY LOADS:**
 ROOF DEAD LOAD = 7 PSF
 ROOF LIVE LOAD = 20 PSF
 CEILING DEAD LOAD = 6 PSF
 CEILING LIVE LOAD = 10 PSF
2. **WIND DESIGN DATA:**
 EXPOSURE
 BASIC WIND SPEED = 95 MPH
 RISK CATEGORY = II
3. **EARTHQUAKE DESIGN DATA:**
 SEISMIC DESIGN CATEGORY = E (WORST CASE ASSUMED)
 OCCUPANCY CATEGORY = II
 IMPORTANCE FACTOR I = 1.0
 EQUIVALENT LATERAL FORCE PROCEDURE:
 LIGHT-FRAME (WOOD) SHEAR WALLS : R = 6.5; Cs = 0.400
 REDUNDANCY FACTOR = 1.3
 (WORST CASE ASSUMED)
4. **FOUNDATIONS:**
 FOUNDATIONS HAVE BEEN PROPORTIONED BASED ON THE FOLLOWING ALLOWABLE BEARING PRESSURES PER CBC:
 CONTINUOUS FOOTINGS 1500 PSF

PROJECT SCOPE

THE PROPOSED PROJECT INVOLVES THE CONSTRUCTION OF NEW ADU

STRUCTURAL OBSERVATION

THE STRUCTURAL OBSERVER SHALL PERFORM SITE VISITS AT THOSE STEPS IN THE PROGRESS OF THE WORK THAT ALLOW FOR CORRECTION OF DEFICIENCIES WITHOUT SUBSTANTIAL EFFORT OR UNCOVERING OF THE WORK INVOLVED.

THE STRUCTURAL OBSERVER SHALL PREPARE A REPORT OF THE STRUCTURAL OBSERVATION REPORT FORM FOR EACH SIGNIFICANT STAGE OF CONSTRUCTION OBSERVED. THE ORIGINAL OF THE STRUCTURAL OBSERVATION REPORT SHALL BE SENT TO THE BUILDING INSPECTOR'S OFFICE AND SHALL BE SIGNED AND SEALED (WET STAMP) BY THE RESPONSIBLE STRUCTURAL OBSERVER. ONE COPY OF THE OBSERVATION REPORT SHALL BE ATTACHED TO THE APPROVED PLANS. THE COPY ATTACHED TO THE PLANS SHALL BE SIGNED AND SEALED BY THE RESPONSIBLE STRUCTURAL OBSERVER OR THE DESIGNEE. COPIES OF THE REPORT SHALL ALSO BE GIVEN TO THE OWNER, CONTRACTOR, AND DEPUTY INSPECTOR. ANY DEFICIENCY NOTED ON THE OBSERVATION REPORT WILL BECOME THE RESPONSIBILITY OF THE STRUCTURAL ENGINEER OF RECORD TO VERIFY ITS COMPLETION BY HIM (HER), OR BY A REGISTERED DEPUTY INSPECTOR AT THE DISCRETION OF THE STRUCTURAL OBSERVER.

A FINAL OBSERVATION REPORT AND THAT OF THE REGISTERED DEPUTY INSPECTOR MUST BE SUBMITTED WHICH SHOWS THAT ALL OBSERVED DEFICIENCIES WERE RESOLVED AND STRUCTURAL SYSTEM GENERALLY CONFORMS TO THE APPROVED PLANS AND SPECIFICATIONS. THE DEPARTMENT OF BUILDING AND SAFETY WILL NOT ACCEPT THE STRUCTURAL WORK WITHOUT THIS FINAL OBSERVATION REPORT AND THAT OF THE REGISTERED DEPUTY INSPECTOR (WHEN PROVIDED) AND THE CORRECTION OF SPECIFIC DEFICIENCIES NOTED DURING NORMAL BUILDING INSPECTION.

STRUCTURAL OBSERVATION/ SIGNIFICANT CONSTRUCTION STAGES (Only Checked Items are required)		
Architect or Engineer of Record for the project to be responsible for the "Structural Observation": Name: Nick Sivushenka <input type="checkbox"/> Licensed Architect <input checked="" type="checkbox"/> Registered Engineer Phone: (323) 448-4682 California Registration Number: C-87698		
Construction Stage	Construction Type	Elements/Connections to be observed
Foundation	<input checked="" type="checkbox"/> Footing, Stem Walls, Piers <input type="checkbox"/> Mat Foundation <input type="checkbox"/> Caisson, Pile, Grade beams <input type="checkbox"/> Stepping/Retaining Foundation, Hillside Special Anchors <input checked="" type="checkbox"/> Others: slab on grade	Excavations, rebar placement, and anchor bolt templates prior to pouring concrete
Wall	<input type="checkbox"/> Concrete <input type="checkbox"/> Masonry <input type="checkbox"/> Wood <input type="checkbox"/> Others:	Shear wall framing, sheathing, nailing and hardware (including holdowns)
Frame	<input type="checkbox"/> Steel Moment Frame <input type="checkbox"/> Steel Braced Frame <input type="checkbox"/> Concrete Moment Frame <input type="checkbox"/> Masonry Moment Frame <input type="checkbox"/> Others:	
Diaphragm	<input type="checkbox"/> Concrete <input type="checkbox"/> Steel Deck <input type="checkbox"/> Wood <input type="checkbox"/> Others:	Roof framing, sheathing, nailing, and hardware
Others		

DECLARATION BY OWNER OR OWNER'S REPRESENTATIVE
 I, the owner of the project the owner's representative, declare that the above listed firm or individual is hired by me to be the Structural Observer.

Signature _____ Date _____

As a covered entity under Title 1 of the Americans with Disabilities Act, the City of Los Angeles does not discriminate on the basis of disability and, upon request, will provide reasonable accommodation to ensure equal access to its programs, services and activities. For efficient handling of information internally and in the internet connection to this new format of code review and administrative information builders including MCO and RCB, the review process may require that you provide a timely and complete distribution of information to the public.
 Page 7 of 7

Los Angeles Regional Uniform Code Program
 Committee I-3: Structural Observation

STRUCTURAL OBSERVATION PROGRAM AND DESIGNATION OF THE STRUCTURAL OBSERVER

PROJECT ADDRESS: _____ PERMIT APPL. NO.: _____
 Description of Work: New ADU
 Owner: _____ Architect: Yakov Design Engineer: SAA Structural

STRUCTURAL OBSERVATION (Only checked items are required)			
Firm or Individual to be responsible for the Structural Observation: Name: <u>SAA Structural Engineering</u> Phone: (323) 448-4682 Calif. Registration: C-87698			
FOUNDATION	WALL	FRAME	DIAPHRAGM
<input checked="" type="checkbox"/> Footing, Stem Walls, Piers	<input type="checkbox"/> Concrete	<input type="checkbox"/> Steel Moment Frame	<input type="checkbox"/> Concrete
<input type="checkbox"/> Mat Foundation	<input type="checkbox"/> Masonry	<input type="checkbox"/> Steel Braced Frame	<input type="checkbox"/> Steel Deck
<input type="checkbox"/> Caisson, Piles, Grade Beams	<input checked="" type="checkbox"/> Wood	<input type="checkbox"/> Concrete Moment Frame	<input checked="" type="checkbox"/> Wood
<input type="checkbox"/> Step g/Retain'g Foundation, Hillside Special Anchors	<input type="checkbox"/> Others:	<input type="checkbox"/> Others:	<input type="checkbox"/> Others:
<input checked="" type="checkbox"/> Others: slab on grade			

DECLARATION BY OWNER
 I, the Owner of the project, declare that the above listed firm or individual is hired by me to be the Structural Observer.

Signature _____ Date _____

DECLARATION BY ARCHITECT OR ENGINEER OF RECORD (required if the Structural Observer is different from the Architect or Engineer of Record)
 I, the Architect or Engineer of record for the project, declare that the above listed firm or individual is designated by me to be responsible for the Structural Observation.

Signature _____ License No. _____ Date _____

SBForm 08 (Rev. 06/19/17)

SPECIAL INSPECTIONS

THE OWNER SHALL RETAIN A DEPUTY INSPECTOR LICENSED BY THE CITY OF LOS ANGELES DEPARTMENT OF BUILDING & SAFETY IN ACCORDANCE WITH CHAPTER 17 OF CBC. THE FOLLOWING AREAS OF WORK REQUIRE INSPECTIONS BY A DEPUTY INSPECTOR TO VERIFY COMPLIANCE WITH CBC:

TRADE	INSPECTION DUTIES	INSPECTION DURATION
REBAR PLACEMENT	MATERIAL SPEC, REBAR SIZE AND CONFIGURATION	INTERMITTENT
INSTALLATION OF HOLDOWN ANCHOR BOLTS PRIOR TO CONCRETE PLACEMENT	VERIFY MATERIAL, SIZE, LOCATION AND INSTALLATION FOR COMPLIANCE WITH DESIGN DRAWINGS	PERIODIC
ADHESIVE ANCHORS	INSPECTION OF MATERIALS ND INSTALLATION IN ACCORDANCE WITH ICC APPROVAL	CONTINUOUS

ICC/LARR

THE FOLLOWING ARE A LIST OF COMPONENTS USED WITHIN THE PROJECT WITH INTERNATIONAL CODE COUNCIL REPORT NUMBERS AND CITY OF LOS ANGELES RESEARCH REPORT NUMBERS FOR THE CONTRACTOR TO OBTAIN AND FOLLOW PROVISIONS OF. ITEMS WITHOUT AN LARR# REQUIRE ONE TIME APPROVAL FROM CITY OF LOS ANGELES.

COMPONENT	ICC-ESR / IAPMO #	LARR # (LABC YR)
SIMPSON SDS WOOD SCREWS	ICC-ESR # 2236	LARR # 25711 (2011)
SIMPSON A35	ICC-ESR # 2606	LARR # 25814 (2014)
SIMPSON STRAPS	ICC-ESR # 2105	LARR # 25713 (2014)
SIMPSON HOLDOWNS	ICC-ESR # 2330	LARR # 25720 (2011)

Yakov Design
 Drafting service
 (562) 322-80-70
 info@yakovdesign.com

NEW ADU

GENERAL NOTES

SAA STRUCTURAL ENGINEERING
 PHONE: 323-448-4682

SCALE: AS NOTED
 DATE: 05/03/2024

S-0.1

STRUCTURAL LUMBER

A. IN ADDITION TO CODE, THE FOLLOWING SPECIFICATIONS AND STANDARDS APPLY TO STRUCTURAL LUMBER AND RELATED CARPENTRY WORK FOR PROJECT:

B.

1. NFPA NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION.

2. WCLBI GRADING RULES NO. 16 OR APPLICABLE WWPA GRADING RULES.

B. MATERIAL QUALITY SHALL BE CONSISTENT WITH DESIGN ASSUMPTIONS.

1. STRUCTURAL LUMBER SHALL BE DOUGLAS FIR-LARCH (UNO).

2. MEMBER SIZES SPECIFIED ARE NOMINAL. STRUCTURAL LUMBER SHALL BE FINISHED S4S (UNO).

3. STRUCTURAL LUMBER SHALL BE GRADE MARKED IN ACCORDANCE WITH REFERENCED GRADING STANDARDS (UNO).

4. MINIMUM GRADES SHALL BE AS REQUIRED BY APPLICABLE STANDARDS BUT AT LEAST EQUAL TO THE FOLLOWING:

a. 2X WALL STUDS ONLY -- CONSTRUCTION GRADE

b. OTHER STUDS, JOISTS AND RAFTERS -- NO. 2

c. BEAMS, POSTS AND ALL OTHER STRUCTURAL LUMBER -- NO. 1 OR BETTER

5. HIGHER LUMBER GRADES SHALL BE USED WHERE INDICATED.

6. NAILS SHALL BE COMMON WIRE NAILS (UNO).

7. BOLTS SHALL BE M.B. WITH STANDARD MALLEABLE IRON OR STEEL PLATE WASHERS UNDER ALL BOLT HEADS AND NUTS BEARING ON WOOD (UNO).

8. CONNECTION HARDWARE SHALL BE AS CALLED FOR. ALTERNATE PRODUCTS SHALL BE SUBSTITUTED ONLY WITH THE APPROVAL OF SAA AND BUILDING DEPARTMENT.

9. MACHINE NAILING SYSTEMS SHALL BE SUBJECT TO SATISFACTORY DEMONSTRATION AND TO THE ACCEPTANCE OF SAA AND BUILDING DEPARTMENT.

a. THE CONTRACTOR SHALL MAKE APPROPRIATE SUBMISSIONS, INCLUDING TECHNICAL DATA, IN SUPPORT OF ANY PROPOSED MACHINE NAILING SYSTEM ON REQUEST.

b. HEADS OR TOPS OF NAILS OR OTHER MACHINE DRIVEN FASTENERS SHALL NOT PENETRATE THE SURFACE OF THE WOOD MORE THAN WOULD BE NORMAL FOR HAND DRIVING.

c. LUMBER DAMAGED BY OVERDRIVING SHALL BE REMOVED AND REPLACED AT THE CONTRACTOR'S EXPENSE.

d. PERSISTANT OVERDRIVING SHALL BE SUFFICIENT CAUSE FOR REJECTION OF A MACHINE NAILING SYSTEM.

e. EDGE DISTANCES FOR MACHINE DRIVEN FASTENERS SHALL BE AS REQUIRED FOR HAND DRIVING AND BY APPLICABLE CODES AND STANDARDS AND SHALL BE CONSISTENT WITH THE NAILING SYSTEM MANUFACTURER'S RECOMMENDATIONS.

f. ACCEPTANCE OF A MACHINE NAILING SYSTEM SHALL BE SUBJECT TO CONTINUED SATISFACTORY PERFORMANCE.

g. MACHINE NAILING SHALL NOT BE USED WITH PLYWOOD LESS THAN 3/8" THICK.

C. APPROPRIATE PRECAUTIONS SHALL BE TAKEN TO ASSURE DURABILITY:

1. WOOD EXPOSED TO MOISTURE OR EARTH SHALL BE TREATED FOR PROTECTION AGAINST DECAY AND TERMITE ATTACK OR SHALL BE FOUNDATION GRADE REDWOOD. THIS REQUIREMENT SHALL APPLY TO:

a. ANY WOOD EMBEDDED IN OR IN DIRECT CONTACT WITH CONCRETE OR MASONRY.

b. ANY WOOD OTHER THAN WALL STUDS WITHIN ONE FOOT OF EARTH.

c. ANY FLOOR JOIST WITHIN 18" OF EARTH.

2. PRESSURE TREATMENT PROCESS SHALL BE APPROVED BY BUILDING DEPARTMENT AND SAA. TREATMENT PROCESSES EFFECTING MATERIAL PROPERTIES SHALL NOT BE USED ON STRUCTURAL LUMBER WITHOUT SAA'S WRITTEN APPROVAL. ADDITIONALLY CUT ENDS OF LUMBERS MUST BE FIELD TREATED WITH AN APPROPRIATE AGENT TO AVOID COMPROMISING DECAY RESISTANCE OF LUMBER.

3. LUMBER USED IN THE WORK SHALL BE KILN DRIED TO AVOID EXCESSIVE SHRINKAGE OR WARPING. "GREEN" LUMBER WITH EXCESSIVE MOISTURE CONTENT SHALL NOT BE USED IN THE WORK.

4. SUBFLOORS, ATTICS, PLENUMS, AND OTHER VOID SPACES SHALL BE APPROPRIATELY VENTILATED.

D. QUALITY FRAMING PRACTICES SHALL BE EMPLOYED IN THE CONSTRUCTION:

1. WOOD COLUMNS AND POSTS SHALL BE SECURED IN POSITION AT TRUE END BEARINGS DESIGNED TO PROTECT AGAINST DECAY OR OTHER DAMAGE.

2. STUDS FOR WALLS AND PARTITIONS SHALL BE AS REQUIRED BY APPLICABLE STANDARDS OR SPECIFIC DETAILS, WHICHEVER ARE MORE RESTRICTIVE, BUT NO LESS THAN:

a. 2X4 AT 16" o.c. FOR ANY WALL OR PARTITION.

b. 2X6 AT 16" o.c. FOR STUDS OVER 9'-0" HIGH, CARRYING COMBINED FLOOR LOADS FROM MORE THAN ONE LEVEL OR EXTERIOR WALLS (UNO)

3. DOUBLE TOP PLATES MATCHING STUDS FOR SIZE AND GRADE SHALL BE PROVIDED AT ALL WALLS (UNO). SPLICES IN PLATES, IF USED, SHALL BE STAGGERED NO LESS THAN 4'-0" o.c.

4. 4X6 OR BETTER HEADER BEAMS OR LINTELS SHALL BE PROVIDED AT ALL OPENINGS IN WALLS AND PARTITIONS.

5. CONTINUOUS HORIZONTAL 2X FIRE BLOCKING OF DEPTH TO MATCH STUDS SHALL BE PROVIDED AT FLOORS, CEILINGS, SOFFITS AND AT NO MORE THAN 8'-0" o.c. VERTICALLY IN ALL STUD WALLS.

6. BORED HOLES IN STUDS SHALL BE PERMITTED ONLY WITHIN THE FOLLOWING RESTRICTIONS:

a. HOLES SHALL NOT APPROACH WITHIN 3/4" OF EITHER EDGE OF THE STUD.

b. HOLES SHALL NOT OCCUR WITHIN 6" OF ANY OTHER BORED HOLE, CUT, NOTCH, OR END OF THE STUD.

c. HOLE DIAMETER SHALL BE LIMITED TO 60% OF WIDTH AT NON-BEARING STUDS IN INTERIOR PARTITIONS SUPPORTING ONLY THEIR OWN WEIGHT AND 40% OF WIDTH AT ALL OTHER STUDS.

8. NOTCHING OF STUDS SHALL BE PERMITTED ONLY WITHIN THE FOLLOWING RESTRICTIONS:

a. NOTCHES SHALL BE NEATLY MADE WITH PREDRILLED CORNERS AND WITHOUT OVERCUTTING.

b. NOTCHES SHALL NOT OCCUR WITHIN 6" OF ANY OTHER NOTCH, CUT, BORED HOLE, OR END OF THE STUD.

c. NOTCH DEPTH SHALL BE LIMITED TO 40% OF WIDTH AT NON-BEARING STUDS IN INTERIOR PARTITIONS SUPPORTING ONLY THEIR OWN WEIGHT AND 25% OF WIDTH AT ALL OTHER STUDS.

d. NOTCH WIDTH SHALL BE LIMITED TO TWICE MAXIMUM PERMITTED DEPTH BUT IN NO CASE MORE THAN SIX INCHES.

9. ALL STUD WALLS SHALL BE BRACED BY ONE OF THE FOLLOWING METHODS:

a. 1/2" GYPSUM BOARD SHEATHING WITH 5d COOLER NAILS AT 7" o.c. TO ALL STUDS AND TOP AND BOTTOM PLATES AND AT 12" o.c. AT ALL OTHER STUDS. EDGE BLOCKING NOT REQUIRED.

b. OTHER SHEAR RESISTING FINISH APPROVED BY BUILDING DEPARTMENT FOR EQUAL OR GREATER SHEAR STRENGTH THAN ITEM (a) ABOVE.

c. 1X6 LET IN DIAGONAL BRACING AT NO MORE THAN 25'-0" o.c. ALONG WALL ANGLED TO CROSS AT LEAST FOUR STUD SPACES IN WALL HEIGHT, WITH 2-8d NAILS AT EACH STUD AND AT TOP AND BOTTOM PLATES.

d. APPROVED STEEL STRAP BRACING SIMILAR TO ITEM (c) ABOVE.

e. 5/16" PLYWOOD PANELS AT LEAST 4'-0" WIDE AND EXTENDING FULL HEIGHT OF WALL AT NO MORE THAN 25'-0" o.c. WITH 6d NAILS AT 6" o.c. TO STUDS AT VERTICAL SHEET EDGES AND TO TOP AND BOTTOM PLATES AND AT 12" o.c. AT ALL OTHER STUDS. EDGE BLOCKING NOT REQUIRED.

10. BEAMS OR GIRDELS SUPPORTED BY HANGERS OR STRUCTURAL STEEL SHALL HAVE AT LEAST 3" OF FIRM BEARING IN A DETAIL APPROVED BY SAA (UNO).

11. BEAMS OR GIRDELS SUPPORTED BY CONCRETE OR MASONRY SHALL HAVE AT LEAST 4" OF FIRM BEARING ON SOUND MATERIAL (UNO).

12. BEAMS OR GIRDELS SUPPORTED BY TIMBER SHALL HAVE FULL BEARING ACROSS THE SECTION OF THE POST, GIRDER OR OTHER SUPPORT (UNO).

13. JOISTS OR RAFTERS SUPPORTED BY METAL HANGERS SHALL HAVE AT LEAST 1%³⁰/12" OF FIRM BEARING (UNO).

14. JOISTS OR RAFTERS SUPPORTED BY CONCRETE OR MASONRY SHALL HAVE AT LEAST 3" OF FIRM BEARING ON SOUND MATERIAL (UNO).

15. JOISTS OR RAFTERS SUPPORTED BY TIMBER SHALL HAVE FULL BEARING ACROSS THE WIDTH OF BEAMS OR GIRDELS OR THE TOP PLATES OF STUD WALLS OR SHALL BE ALIGNED WITH AND FACE NAILED TO STUDS AND SUPPORTED BY A 1X4 RIBBON STRIP (UNO).

16. STABILITY BRACING SHALL BE PROVIDED AT NO MORE THAN 10'-0" o.c. FOR RAFTERS AND 8'-0" FOR JOISTS IN ONE OF THE FOLLOWING WAYS:

a. CONTINUOUS 2X3 CROSS BRIDGING.

b. CONTINUOUS FULL DEPTH BLOCKING.

c. APPROVED METAL BRIDGING.

17. STABILITY BRACING SHALL BE PROVIDED FOR JOISTS AND RAFTERS AT ALL SUPPORTS IN ONE OF THE FOLLOWING WAYS:

a. CONTINUOUS FULL DEPTH BLOCKING.

b. FULL NAILING OF A HANGER APPROVED FOR ROTATIONAL RESTRAINT.

c. END NAILING TO A RIM JOIST OR RAFTER.

18. RAFTERS OR JOISTS WITH COMMON INTERIOR BEARINGS SHALL BE LAPPED AT LEAST 4" OVER SUPPORT AND ATTACHED TO ONE ANOTHER WITH 3-16d NAILS.

19. FLOOR JOISTS UNDER PARTITIONS PARALLEL TO THEIR SPAN SHALL BE DOUBLED (UNO).

20. DOUBLED JOISTS OR OTHER VERTICALLY LAMINATED MEMBERS SHALL BE SECURELY INTERCONNECTED ALONG THEIR ENTIRE LENGTH.

a. FASTENERS SHALL BE PLACED AT TOP AND BOTTOM QUARTER POINTS OF DEPTH AND STAGGERED.

b. FASTENERS FOR 2X MEMBERS LESS THAN 12" DEEP MAY BE 16d NAILS AT 12" o.c. (UNO).

c. FASTENERS FOR OTHER MEMBERS SHALL BE 1/2" DIAMETER BOLTS AT 24" o.c. (UNO).

21. STRUCTURAL FRAMING MEMBERS SHALL NOT BE NOTCHED WITHOUT SAA'S SPECIFIC APPROVAL.

22. BORED HOLES IN JOISTS OR RAFTERS SHALL BE PERMITTED ONLY WITHIN THE FOLLOWING RESTRICTIONS:

a. HOLES SHALL NOT APPROACH WITHIN 2" OF EITHER EDGE OF THE MEMBER.

b. HOLES SHALL NOT OCCUR WITHIN 12" OF ANY OTHER HOLE OR OF THE END OF THE MEMBER.

c. HOLE DIAMETER SHALL BE LIMITED TO ONE-THIRD OF DEPTH.

23. END JOINTS IN ADJACENT BOARDS IN LUMBER SHEATHING SHALL BE SEPARATED BY AT LEAST TWO SUPPORT SPACES AND AT LEAST TWO BOARDS SHALL SEPARATE ANY TWO JOINTS ON THE SAME SUPPORT.

24. NAILS DRIVEN PERPENDICULAR TO GRAIN SHALL BE USED IN FAVOR OF TOE NAILS WHENEVER POSSIBLE.

25. WHEN TOE NAILS MUST BE USED, THEY SHALL BE DRIVEN AT AN ANGLE OF APPROXIMATELY THIRTY DEGREES TO THE FACE AND STARTED APPROXIMATELY ONE-THIRD OF THEIR LENGTH FROM THE END OF THE PIECE.

26. IMPROPERLY INSTALLED TOE NAILS SHALL NOT BE CONSIDERED AS HAVING STRUCTURAL VALUE AND MEMBERS DAMAGED BY IMPROPER TOE NAILING SHALL BE REMOVED AND REPLACED AT THE CONTRACTOR'S EXPENSE.

27. BOLT HOLES, INCLUDING THOSE AT SILL ANCHORS, SHALL BE NO LESS THAN 1/32" AND NO MORE THAN 1/16" LARGER THAN THE NOMINAL DIAMETER OF THE FASTENER (UNO). OVERSIZE BOLT HOLES SHALL BE SUFFICIENT CAUSE FOR REJECTION OF THE WORK.

28. THE CONTRACTOR SHALL VERIFY AND RETIGHTEN ALL BOLTS PRIOR TO APPLICATION OF FINISH OR TO OTHER CONSTRUCTION WHICH WOULD MAKE THEM INACCESSIBLE.

29. NEITHER BOLTS, LAG SCREWS NOR WOOD SCREWS SHALL BE HAMMERED OR OTHERWISE DRIVEN INTO PLACE. DRIVING OF SUCH MEMBERS SHALL BE SUFFICIENT CAUSE FOR REJECTION OF THE FASTENING.

30. FRAMING HARDWARE SHALL BE INSTALLED WITH PROPER SIZE, LOCATION AND NUMBER OF FASTENERS IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS AND CONDITIONS OF RELEVANT APPROVALS.

31. SILL PLATES AT STUD WALLS SHALL BE PROPERLY DETAILED AND ANCHORED:

a. SILLS SHALL BE 3X MINIMUM (UNO).

b. SILLS BEARING ON MASONRY OR CONCRETE SHALL BE SECURED IN POSITION WITH NO LESS THAN 5/8" ANCHOR BOLTS AT 48" o.c. MAXIMUM WITH AT LEAST 7" EMBEDMENT INTO SOUND CONCRETE OR MASONRY GROUT.

c. SILL ANCHOR BOLTS SHALL BE PROVIDED WITHIN 9" OF EACH END OF EACH PIECE AND NO PIECE SHALL HAVE LESS THAN TWO BOLTS.

d. SILL ANCHOR BOLTS SHALL BE ARRANGED TO AVOID INTERFERENCE WITH FRAMING WHENEVER POSSIBLE.

32. WHERE GYPSUM BOARD, PLYWOOD OR OTHER STRUCTURAL SHEATHING IS SPECIFIED IN THE STRUCTURAL DRAWINGS, JOINTS SHALL NOT BE TAPED OR FINISH APPLIED UNTIL ATTACHMENT TO SUPPORTING FRAMING HAS BEEN INSPECTED AND APPROVED.

33. WHERE PLASTER OR STUCCO IS SPECIFIED IN THE STRUCTURAL DRAWINGS, APPLICATION SHALL NOT BEGIN UNTIL LATH TYPE AND ATTACHMENT TO SUPPORTING FRAMING HAS BEEN INSPECTED AND APPROVED.

EXCAVATIONS AND FOUNDATIONS

A. FOUNDATION EXCAVATION AND CONSTRUCTION SHALL BE ACCOMPLISHED IN A MANNER CONSISTENT WITH DESIGN ASSUMPTIONS:

1. FOOTINGS SHALL BE FOUNDED NO LESS THAN TWO FEET (2'-0") BELOW LOWEST ADJACENT FINISH GRADE, SLAB OR PAVEMENT AND BE EMBEDDED INTO NATIVE SOIL OR CERTIFIED COMPACTED FILL.

B. ALL EXCAVATION AND GRADING OPERATIONS SHALL BE CONDUCTED IN ACCORDANCE WITH REQUIREMENTS OF GOVERNING AUTHORITIES AND IN A MANNER CONSISTENT WITH QUALITY CONSTRUCTION STANDARDS.

1. EXCAVATIONS SHALL BE LAID BACK OR SHORED AS REQUIRED FOR SAFETY AND STABILITY AT ALL STAGES OF THE WORK.

2. ADEQUATE PROVISIONS FOR DRAINAGE AND REMOVAL OF RAINWATER AND GROUNDWATER IF PRESENT, SHALL BE INCORPORATED INTO TEMPORARY SLOPES OR GRADED SURFACES IN ORDER TO PRESERVE STABILITY AND PROTECT AGAINST ILLEGAL, DANGEROUS, UNSIGHTLY, OR OTHERWISE INAPPROPRIATE RUN-OFF.

3. BACKFILL WHICH WILL SUPPORT STRUCTURAL LOADS SHALL BE PLACED IN LIFTS AND COMPACTED TO AT LEAST 95% OF MAXIMUM DENSITY UNDER THE SUPERVISION OF GEOTECHNICAL ENGINEER.

4. BACKFILL SHALL NOT BE PLACED AGAINST NEW RETAINING STRUCTURES UNTIL THEY AND THEIR SUPPORTS HAVE ACHIEVED THEIR DESIGN STRENGTH UNLESS APPROPRIATE TEMPORARY SUPPORTS ARE PROVIDED.

5. COMPACTION METHODS USED FOR BACKFILL BEHIND RETAINING STRUCTURES SHALL TAKE SURCHARGE OF THOSE STRUCTURES INTO CONSIDERATION. APPROPRIATE TEMPORARY SUPPORTS SHALL BE PROVIDED AS NECESSARY.

6. THE CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIR TO THE SATISFACTION OF OWNER, LANDLORD, ARCHITECT, BUILDING DEPARTMENT, AND SAA OF ANY DAMAGE TO RETAINING STRUCTURES CAUSED BY PREMATURE BACKFILLING, COMPACTION EFFORTS, OR OTHER CONSTRUCTION SURCHARGE.

7. CONCRETE SHALL NOT BE PLACED IN EXCAVATIONS CONTAINING STANDING WATER WITHOUT PRIOR APPROVAL. REQUESTS FOR SUCH APPROVAL SHALL INCLUDE DETAILED DESCRIPTION OF APPROPRIATE WET PLACEMENT PROCEDURES THAT SHALL BE SUBJECT TO THE APPROVAL OF GEOTECHNICAL ENGINEER, BUILDING DEPARTMENT, AND SAA AND WHICH, IF APPROVED, SHALL BE STRICTLY FOLLOWED.

STRUCTURAL CONCRETE

A. IN ADDITION TO CODE, THE FOLLOWING SPECIFICATIONS AND STANDARDS APPLY TO STRUCTURAL CONCRETE WORK FOR PROJECT:

1. ACI BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE (ACI 318).

2. ACI CODE OF STANDARD PRACTICE.

3. ASTM C33 FOR AGGREGATE (UNO).

4. ASTM C330 FOR AGGREGATE FOR STRUCTURAL LIGHTWEIGHT CONCRETE (AS SPECIFIED).

5. ASTM C150 TYPE I OR II FOR CEMENT. ALL STRUCTURAL CONCRETE IN CONTACT WITH SOIL SHALL BE MADE WITH TYPE II CEMENT.

6. ASTM C260 FOR AIR ENTRAINING ADMIXTURES WHERE SPECIFIED OR ADDED AT CONTRACTOR'S OPTION.

7. ASTM C494 FOR WATER-REDUCING, RETARDING, ACCELERATING, WATER-REDUCING AND RETARDING OR WATER-REDUCING AND ACCELERATING ADMIXTURES WHERE SPECIFIED OR ADDED AT CONTRACTOR'S OPTION.

8. ASTM C618 FOR FLY ASH OR OTHER POZZOLANIC ADMIXTURES WHERE SPECIFIED OR ADDED AT CONTRACTOR'S OPTION. NO MORE THAN 15% OF THE TOTAL CEMENT CONTENT IN ANY STRUCTURAL CONCRETE MIX SHALL BE SUCH MATERIAL (UNO).

9. ASTM C94 FOR READY-MIXED CONCRETE. ALL STRUCTURAL CONCRETE SHALL BE DELIVERED TO THE SITE READY-MIXED.

B. STRUCTURAL CONCRETE SHALL BE OF SPECIFIED TYPES AND STRENGTHS AND OF QUALITY COMPATIBLE WITH THE REQUIREMENTS OF THE WORK.

1. ALL STRUCTURAL CONCRETE SHALL HAVE AN ULTIMATE COMPRESSIVE STRENGTH OF AT LEAST 3,000 PSI AT THE AGE OF 28 DAYS (UNO). STRUCTURAL CONCRETE FOR THIS PROJECT DESIGNED USING 2500 PSI, BUT CONTRACTOR TO PLACE 3000 PSI MATERIAL (NO SPECIAL INSPECTION REQUIRED).

2. ALL STRUCTURAL CONCRETE SHALL BE STONE TYPE WITH A FULLY CURED DENSITY BETWEEN 140 AND 150 PCF (UNO).

3. STRUCTURAL LIGHTWEIGHT CONCRETE, WHERE SPECIFIED, SHALL HAVE A FULLY CURED DENSITY BETWEEN 110 AND 120 PCF (UNO).

4. SLUMPS OF STRUCTURAL CONCRETE SHALL BE AS SMALL AS PRACTICAL FOR THE INTENDED APPLICATION AND SHALL COMPLY WITH RECOMMENDATIONS OF REFERENCED STANDARDS AND LIMITATIONS OF THE MIX DESIGN.

5. NO CONCRETE WITH MEASURED SLUMP GREATER THAN SIX INCHES SHALL BE USED IN THE WORK WITHOUT THE SPECIFIC WRITTEN APPROVAL OF SAA. SLUMP MAY BE MEASURED AT POINT OF PLACEMENT.

C. GROUT AND DRYPACK SHALL BE TREATED AS STRUCTURAL CONCRETE AND SHALL BE SUBJECT TO ALL APPLICABLE REQUIREMENTS OF THESE NOTES (UNO).

1. GROUT SHALL BE A HIGH-STRENGTH, SHRINKAGE-COMPENSATING (NONSHRINK) CEMENTITIOUS MATERIAL OBTAINING AN ULTIMATE COMPRESSIVE STRENGTH OF AT LEAST 5000 PSI AT THE AGE OF 28 DAYS WHEN TESTED IN ACCORDANCE WITH ASTM C109.

2. GROUT SHALL BE A PRE-ENGINEERED PRODUCT ACCEPTABLE TO BUILDING DEPARTMENT AND SAA.

3. GROUT SHALL BE DELIVERED TO THE SITE PREMIXED IN MANUFACTURER'S ORIGINAL PACKAGING. ONLY WATER SHALL BE ADDED ON SITE. GROUT SHALL BE PREPARED AND PLACED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.

4. GROUT SHALL BE MIXED TO A UNIFORM FLUID CONSISTENCY, POURED INTO FORMS AS REQUIRED, AND CHAINED OR RODDED TO ASSURE THAT ALL VOIDS ARE FILLED.

5. GROUT CONTAINING METALLIC ADMIXTURES SHALL NOT BE USED WITHOUT THE WRITTEN APPROVAL OF BOTH ARCHITECT AND SAA.

6. DRYPACK, WHERE SPECIFIED, SHALL BE GROUT MIXED TO A STIFF CLAY-LIKE CONSISTENCY. CARE SHALL BE TAKEN TO ASSURE UNIFORMITY PRIOR TO PLACEMENT.

7. EXISTING CONCRETE OR OTHER POROUS SURFACES AGAINST WHICH GROUT OR DRYPACK IS TO BE PLACED SHALL BE MOISTENED TO PREVENT PREMATURE DEHYDRATION OF THE MATERIAL.

8. INSPECTION REQUIREMENTS FOR STRUCTURAL GROUT AND DRYPACK SHALL BE AS FOR STRUCTURAL CONCRETE EXCEPT THAT CUBES RATHER THAN CYLINDERS MAY BE TAKEN FOR COMPRESSIVE STRENGTH TESTING.

9. CONSISTENCY, POURED INTO FORMS AS REQUIRED, AND CHAINED OR RODDED TO ASSURE THAT ALL VOIDS ARE FILLED.

10. GROUT CONTAINING METALLIC ADMIXTURES SHALL NOT BE USED WITHOUT THE WRITTEN APPROVAL OF BOTH ARCHITECT AND SAA.

11. DRYPACK, WHERE SPECIFIED, SHALL BE GROUT MIXED TO A STIFF CLAY-LIKE CONSISTENCY. CARE SHALL BE TAKEN TO ASSURE UNIFORMITY PRIOR TO PLACEMENT.

12. EXISTING CONCRETE OR OTHER POROUS SURFACES AGAINST WHICH GROUT OR DRYPACK IS TO BE PLACED SHALL BE MOISTENED TO PREVENT PREMATURE DEHYDRATION OF THE MATERIAL.

D. THE CONTRACTOR SHALL BE RESPONSIBLE FOR MIX DESIGNS.

1. MIX DESIGNS FOR CONCRETE WITH SPECIFIED STRENGTH UP TO 2500 PSI MAY BE BY SUPPLIER AND NEED NOT BE SUBMITTED FOR REVIEW PRIOR TO USE.

2. MIX DESIGNS FOR CONCRETE WITH SPECIFIED STRENGTH GREATER THAN 2500 PSI SHALL BE BY A CALIFORNIA LICENSED CIVIL ENGINEER IN THE EMPLOY OF A CERTIFIED INDEPENDENT TESTING LABORATORY ACCEPTABLE TO BUILDING DEPARTMENT AND SAA. COSTS OF SUCH DESIGN SHALL BE BORNE BY THE CONTRACTOR.

3. CALCIUM CHLORIDE OR OTHER ADMIXTURES CONTAINING CHLORIDE OTHER THAN AS AN IMPURITY SHALL NOT BE USED IN STRUCTURAL CONCRETE WITHOUT THE WRITTEN APPROVAL OF SAA.

4. COPIES OF EACH MIX DESIGN, BEARING THE SEAL AND SIGNATURE OF THEIR DESIGNER AND ACCOMPANIED BY CERTIFIED RESULTS OF 7 AND 28 DAY TRIAL BATCH CYLINDER TEST RESULTS, SHALL BE SUBMITTED TO BUILDING DEPARTMENT AND SAA NO LESS THAN TWO WORKING DAYS BEFORE USE.

5. COPIES OF THE MIX DESIGN SHALL BE PRESENT AT BATCH PLANT AND JOB SITE PRIOR TO USE.

E. THE CONTRACTOR SHALL BE RESPONSIBLE FOR MAKING PROPER PREPARATIONS PRIOR TO THE PLACEMENT OF STRUCTURAL CONCRETE.

1. THE CONTRACTOR SHALL DESIGN AND CONSTRUCT COMPETENT FORMS AS REQUIRED AND SHALL BE SOLELY RESPONSIBLE FOR THEIR ADEQUACY.

2. REINFORCEMENT SHALL BE PLACED AS CLOSE TO THE SURFACE OF CONCRETE AS PERMITTED WHILE MAINTAINING MINIMUM COVER AS FOLLOWS (UNO):

a. AT SURFACES CAST AGAINST EARTH -- THREE INCHES (3").

b. AT SURFACES EXPOSED TO EARTH OR WEATHER:

i. FOR #6 OR LARGER BARS -- TWO INCHES (2").

ii. FOR #5 AND SMALLER -- ONE AND ONE-HALF INCHES (1-1/2").

3. PROJECTING CORNERS OF EXPOSED CONCRETE STRUCTURAL MEMBERS SHALL BE FORMED WITH 3/4" CHAMFER (UNO).

4. REINFORCING STEEL, ANCHOR BOLTS, AND OTHER INSERTS SHALL BE SECURED IN POSITION BEFORE CONCRETE PLACEMENT. SETTING DURING OR AFTER PLACEMENT SHALL NOT BE PERMITTED (UNO).

5. EXCEPT FOR SIMPLE, SYMMETRICAL, UNIFORM CONFIGURATIONS, THE CONTRACTOR SHALL PREPARE REINFORCEMENT PLACEMENT DRAWINGS. COPIES OF THESE DRAWINGS SHALL BE AVAILABLE FOR REFERENCE ON SITE AT LEAST ONE WORKING DAY BEFORE PLACEMENT OF CONCRETE AND BEFORE ANY INSPECTION OF THE REINFORCEMENT OR FORMWORK.

6. THE CONTRACTOR SHALL COORDINATE WITH ALL TRADES BEFORE PLACEMENT OF CONCRETE TO ASSURE PROPER INCORPORATION OF REQUIRED SLEEVES, INSERTS, CURBS, DEPRESSIONS AND SIMILAR ITEMS.

7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ADDITIONAL COSTS OF CORRECTIVE ACTION IN CASE OF ITEMS IMPROPERLY LOCATED OR OMITTED FROM CONCRETE PLACEMENT.

8. THE CONTRACTOR SHALL SUBMIT SKETCHES SHOWING SIZE AND LOCATION OF ANY REQUIRED SLEEVE, INSERT, DEPRESSION, OR OTHER MODIFICATION TO STRUCTURAL CONCRETE NOT SHOWN IN THESE STRUCTURAL DESIGN DRAWINGS TO SAA FOR REVIEW AND SHALL OBTAIN ITS APPROVAL BEFORE PLACEMENT.

F. CONCRETE SHALL BE PLACED, FINISHED, AND CURED IN ACCORDANCE WITH THE RECOMMENDATIONS OF REFERENCED STANDARDS.

1. STRUCTURAL CONCRETE WITH SPECIFIED STRENGTH GREATER THAN 2500 PSI SHALL BE PLACED UNDER THE CONTINUOUS SUPERVISION OF A DEPUTY INSPECTOR LICENSED BY BUILDING DEPARTMENT. THIS INSPECTOR'S WORK SHALL INCLUDE PRE-PLACEMENT INSPECTION OF FORMWORK, REINFORCEMENT AND EMBEDDED ITEMS.

2. EXISTING CONCRETE AGAINST WHICH NEW CONCRETE IS TO BE PLACED SHALL BE ROUGHENED TO AT LEAST 1/4" AMPLITUDE TO EXPOSE COARSE AGGREGATE, SANDBLASTED OR OTHERWISE THOROUGHLY CLEANED BY AN APPROVED METHOD, MOISTENED AND SCOURED WITH A CEMENT/WATER PASTE IMMEDIATELY PRIOR TO PLACEMENT OF NEW MATERIAL.

3. COLD JOINTS IN STRUCTURAL CONCRETE SHALL BE MADE AT LOCATIONS INDICATED IN DESIGN DRAWINGS OR APPROVED BY SAA. INCORPORATION OF UNAPPROVED JOINTS SHALL BE SUFFICIENT CAUSE FOR REJECTION OF WORK.

4. CURING COMPOUNDS, IF USED, SHALL BE OF APPROVED TYPES. THE CONTRACTOR SHALL OBTAIN WRITTEN APPROVAL OF CURING COMPOUNDS PROPOSED FOR USE ON SURFACES TO RECEIVE FINISH FROM THE FINISH MANUFACTURER PRIOR TO APPLICATION.

5. FORMS SHALL BE KEPT DAMP AND STRUCTURAL CONCRETE SURFACES EXPOSED TO THE ENVIRONMENT SHALL BE MOIST CURED OR OTHERWISE PROTECTED AGAINST PREMATURE DEHYDRATION FOR AT LEAST 72 HOURS AFTER PLACEMENT.

6. CONCRETE SHALL BE TESTED AND INSPECTED IN ACCORDANCE ACI-318 REQUIREMENTS BY QUALIFIED TECHNICIANS UNDER THE SUPERVISION OF A LICENSED CIVIL ENGINEER.

1. FOUR TEST CYLINDERS FROM EACH 150 YARDS, OR FRACTION THEREOF, POURED IN ANY ONE DAY, SHALL BE SECURED AND TESTED BY AN INDEPENDENT TESTING AGENCY. ONE TO BE TESTED AT 7 DAYS, TWO AT 28 DAYS, AND THE FOURTH HELD IN RESERVE.

2. QUALIFIED FIELD TESTING TECHNICIANS SHALL PERFORM TESTS ON FRESH CONCRETE AT THE JOB SITE. PREPARE SPECIMENS REQUIRED FOR CURING UNDER FIELD CONDITIONS. PREPARE SPECIMENS REQUIRED FOR TESTING IN THE LABORATORY, AND RECORD THE TEMPERATURE OF THE FRESH CONCRETE WHEN PREPARING SPECIMENS FOR STRENGTH TESTS. QUALIFIED LABORATORY TECHNICIANS SHALL PERFORM ALL REQUIRED LABORATORY TESTS.

3. THE CONTRACTOR SHALL REMOVE AND REPLACE ANY CONCRETE WHICH FAILS TO ATTAIN SPECIFIED STRENGTH IN 28 DAYS IF SO DIRECTED BY THE ENGINEER OF RECORD. ANY DEFECTS IN THE HARDENED CONCRETE SHALL BE SATISFACTORILY REPAIRED OR THE HARDENED CONCRETE SHALL BE REPLACED.

REINFORCING STEEL

A. IN ADDITION TO CODE, THE FOLLOWING SPECIFICATIONS AND STANDARDS APPLY TO THE MANUFACTURE, FABRICATION AND INSTALLATION OF REINFORCING STEEL IN STRUCTURAL CONCRETE AND/OR MASONRY WORK FOR PROJECT:

1. CRSI HANDBOOK.

2. ASTM A615 GRADE 60 FOR ALL REINFORCING STEEL (UNO).

3. ASTM A185 FOR COLD DRAWN WELDED WIRE FABRIC (UNO). 4AWS D1.4 FOR WELDING OF REINFORCING STEEL.

B. QUALITY DETAILING AND CONSTRUCTION STANDARDS SHALL BE OBSERVED.


1. REINFORCEMENT SHALL BE TRACEABLE FROM SOURCE TO SITE AND SHALL BE SAMPLED AND TESTED TO CONFIRM PHYSICAL PROPERTIES AS REQUIRED BY BUILDING DEPARTMENT OR OTHERWISE NOTED IN THE PROJECT SPECIFICATION.

2. REINFORCEMENT DELIVERED TO THE SITE SHALL BE ACCOMPANIED BY APPROPRIATE TESTING REPORTS AND CERTIFICATION, INCLUDING EVIDENCE OF CONFORMANCE WITH SPECIAL DUCTILITY REQUIREMENTS SPECIFIED ABOVE.

3. LACK OF CERTIFICATION OR INADEQUATE CERTIFICATION SHALL BE SUFFICIENT CAUSE FOR REJECTION OF MATERIAL. UNCERTIFIED OR INADEQUATELY CERTIFIED MATERIAL SHALL NOT BE STORED AT THE SITE OR USED IN THE WORK AND IF DELIVERED TO THE SITE SHALL BE IMMEDIATELY REMOVED.

4. SUBJECT TO SAA'S WRITTEN APPROVAL, REINFORCEMENT NOT MEETING THE SPECIAL DUCTILITY REQUIREMENTS SPECIFIED ABOVE (NOTE 2) MAY BE PERMITTED IN LOCATIONS NOT SUBJECT TO YIELDING UNDER SEISMIC LOAD.

5. BARS SHALL BE COLD BENT AS D

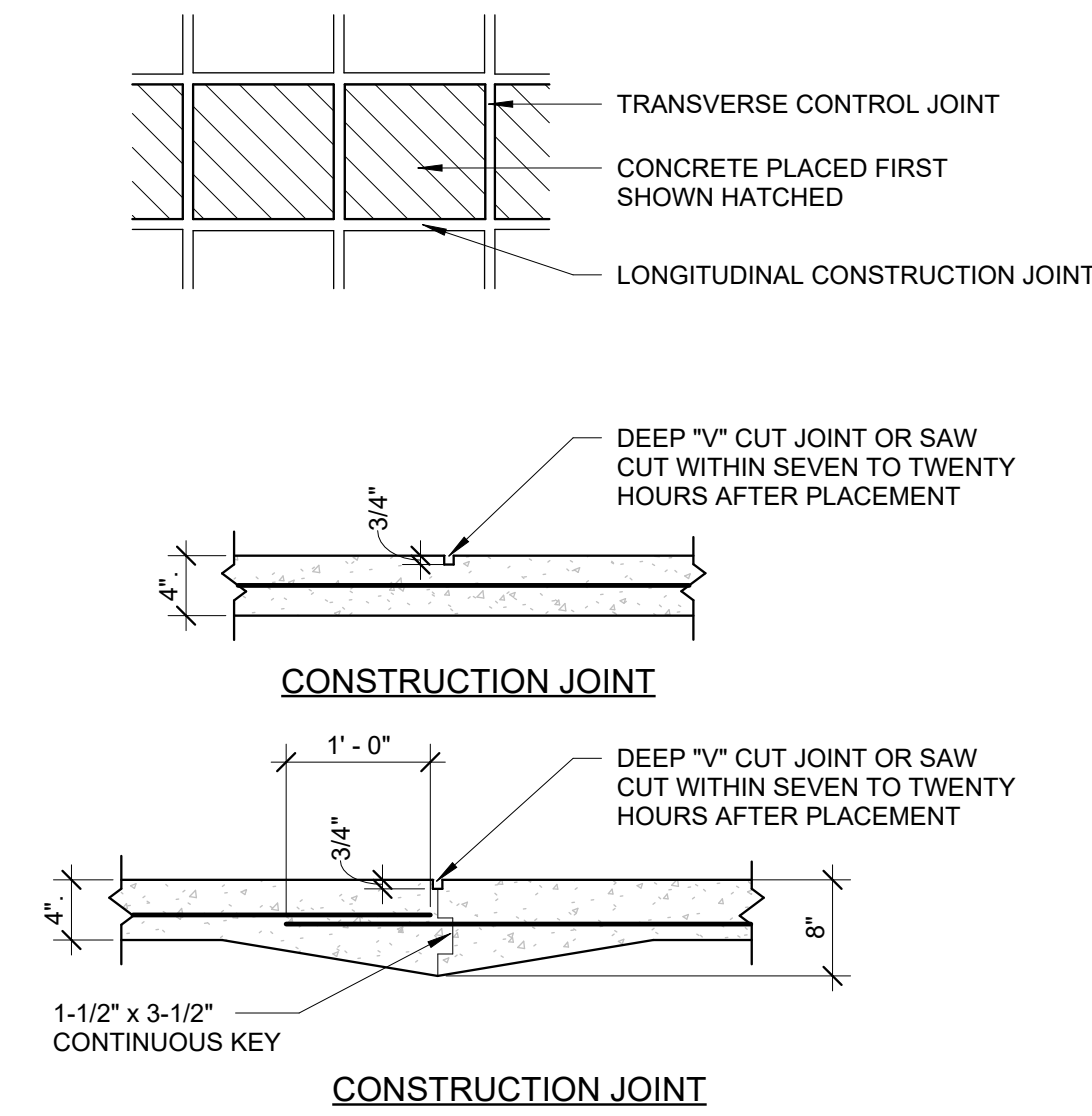


- NOTES:**
- SLABS SHALL BE PLACED IN LONGITUDINAL STRIPS OR SECTIONS HAVING A MAXIMUM WIDTH OF 20'-0".
 - SLABS SHALL BE SUBDIVIDED BY CONTROL JOINTS HAVING A MAXIMUM SPACING OF 15'-0".
 - CONTROL JOINTS TO BE PERPENDICULAR TO CONSTRUCTION JOINTS.
 - REINFORCING SHALL BE SECURELY PLACED IN MIDDLE OF SLAB.
 - CURING SHALL BE MAINTAINED PER WRITTEN SPECIFICATIONS.

2 Typical Slab on Grade Joints
S-0.3 NOT TO SCALE

HOOKED BAR DEVELOPMENT LENGTH (L _{dh})																	
BAR SIZE	f _y (ksi)	f _c = 3,000 psi		f _c = 4,000 psi		f _c = 5,000 psi		f _c = 6,000 psi		f _c = 7,000 psi		f _c = 8,000 psi		f _c = 9,000 psi		f _c = 10,000 psi	
		TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS
#3	60	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6
#4	60	8	8	7	7	6	6	6	6	6	6	6	6	6	6	6	6
#5	60	10	9	9	8	8	7	7	7	7	6	6	6	6	6	6	6
#6	60	12	12	10	10	9	9	9	9	8	8	8	7	7	7	7	7
#7	60	14	14	12	12	11	11	10	10	9	9	9	8	8	8	8	8
#8	60	16	16	14	14	12	12	11	11	11	11	10	10	9	9	9	9
#9	60	18	18	15	15	14	14	13	13	12	12	11	11	10	10	10	10
#10	60	20	20	17	17	16	16	14	14	13	13	12	12	12	11	11	11
#11	60	22	22	19	19	17	17	16	16	15	15	14	14	13	13	12	12
#11	75	28	28	24	24	21	21	20	20	18	18	17	17	16	16	15	15
#14	60	38	38	33	33	29	29	27	27	25	25	23	23	22	21	21	21
#14	75	47	47	41	41	38	38	33	33	31	31	29	29	27	27	26	26


BAR DEVELOPMENT LENGTH (L _d)																	
BAR SIZE	f _y (ksi)	f _c = 3,000 psi		f _c = 4,000 psi		f _c = 5,000 psi		f _c = 6,000 psi		f _c = 7,000 psi		f _c = 8,000 psi		f _c = 9,000 psi		f _c = 10,000 psi	
		TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS
#3	60	33	25	28	22	25	20	23	18	21	17	20	16	19	15	18	14
#4	60	43	33	37	29	34	26	31	24	28	22	27	21	25	19	24	18
#5	60	54	42	47	36	42	32	38	30	35	27	33	26	31	24	30	23
#6	60	66	50	56	43	50	39	46	35	42	33	40	31	37	29	36	27
#7	60	94	72	81	63	73	56	67	51	62	48	59	45	54	42	52	40
#8	60	107	83	93	72	83	64	76	59	70	54	66	51	62	48	59	45
#9	60	121	93	105	81	94	72	86	66	79	61	74	57	70	54	66	51
#10	60	138	105	118	91	106	81	98	74	89	69	84	64	79	61	75	58
#11	60	151	116	131	101	117	90	107	82	99	76	93	71	87	67	83	64
#11	75	189	145	164	126	146	113	134	103	124	85	116	89	109	84	104	80
#14	60	181	140	157	121	141	108	128	99	119	92	111	86	105	81	100	77
#14	75	227	174	196	151	176	135	160	123	148	114	139	107	131	101	124	96

BAR LAP SPlice LENGTH																	
BAR SIZE	f _y (ksi)	f _c = 3,000 psi		f _c = 4,000 psi		f _c = 5,000 psi		f _c = 6,000 psi		f _c = 7,000 psi		f _c = 8,000 psi		f _c = 9,000 psi		f _c = 10,000 psi	
		TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS	TOP BARS	OTHER BARS
#3	60	43	33	36	29	33	26	30	23	27	22	26	21	25	20	23	18
#4	60	56	43	48	38	44	34	40	31	36	29	35	27	33	25	31	23
#5	60	70	55	61	47	55	42	49	39	46	35	43	34	40	31	39	30
#6	60	85	65	73	56	68	51	60	46	55	43	52	40	48	38	47	35
#7	60	122	94	105	82	94	73	87	66	81	62	75	59	70	55	68	52
#8	60	139	108	121	94	108	83	99	77	91	70	86	68	81	62	77	59
#9	60	157	121	133	105	122	94	112	86	103	79	96	74	91	70	86	66
#10	60	177	137	153	118	138	105	125	96	116	90	109	83	103	79	98	75
#11	60	196	151	170	131	152	117	139	107	129	99	121	92	113	87	108	83
#11	75	246	189	213	164	190	147	174	134	161	124	151	116	142	109	139	104
#14	60	USE MECHANICAL SPLICE															

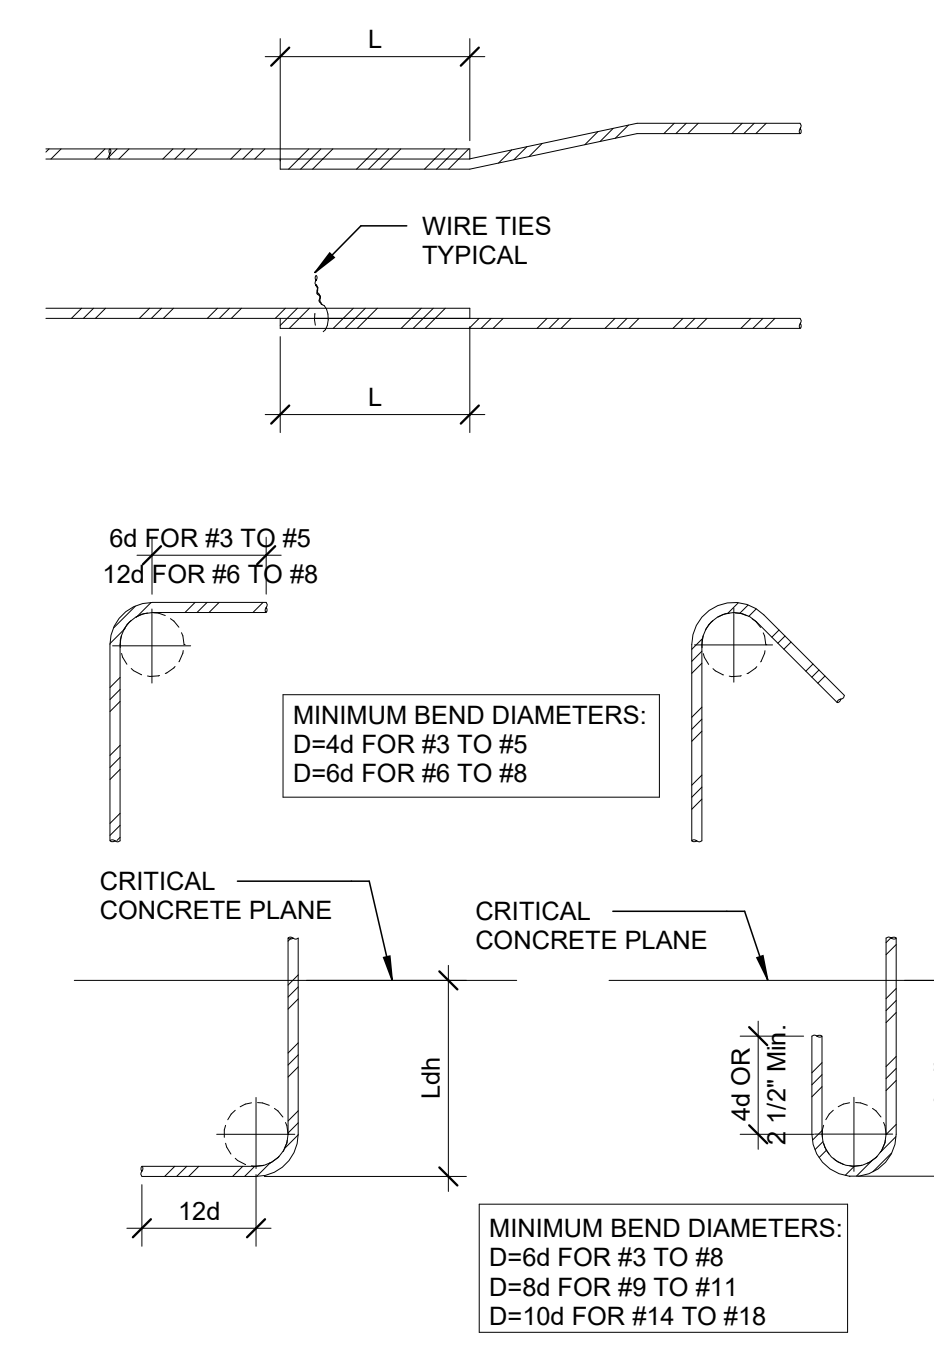


- NOTES:**
- TABULATED VALUES IN INCHES FOR NORMAL CONCRETE AND UNCOATED REINFORCING STEEL. FOR LIGHTWEIGHT CONCRETE INCREASE LENGTHS BY 30% FOR EPOXY COATED INCREASE LENGTHS BY 50%.
 - TABULATED LAP SPlice LENGTHS ARE FOR CLASS "B" SPlices AS DEFINED IN ACI 318.9 FOR CLASS A SPlices REDUCE LENGTH BY 30%. CLASS A SPlices MAY BE USED WHEN SPECIFICALLY CALLED ON DRAWINGS AND IF ONE HALF OR LESS OF THE TOTAL NUMBER OF BARS ARE SPliced WITHIN THE REQUIRED LAP LENGTH.
 - BAR DEVELOPMENT LENGTHS AND SPlice LENGTHS OF INDIVIDUAL BARS WITHIN A BUNDLE SHALL BE INCREASED BY 20% FOR A 3-BAR BUNDLE AND 33% FOR A 4-BAR BUNDLE.
 - TOP BARS ARE DEFINED AS HORIZONTAL BARS WITH MORE THAN 12" OF CONCRETE CAST BELOW THE BAR.
 - FOR COMPRESSION LAP SPlice LENGTH (ONLY WHERE INDICATED ON DRAWINGS) USE 30 BAR DIAMETER, NOT LESS THAN 12".
 - MECHANICAL SPlices MAY BE USED AT CONTRACTOR'S OPTION. MECHANICAL SPlices SHALL BE TYPE 2 AS DEFINED IN ACI 318 AND SHALL DEVELOP IN TENSION AT LEAST 125% OF THE SPECIFIED YIELD STRENGTH (F_y) OF THE SPliced BAR.
 - WHERE MECHANICAL SPlices ARE USED, STAGGER ADJACENT SPlices BY 24" O.C.
 - THE SMALLER BAR SPlice LENGTH SHALL BE USED WHEN SPlicing DIFFERENT SIZED BARS.

1 Tension Lap Splice & Embedment Length in Concrete
S-0.3 NOT TO SCALE

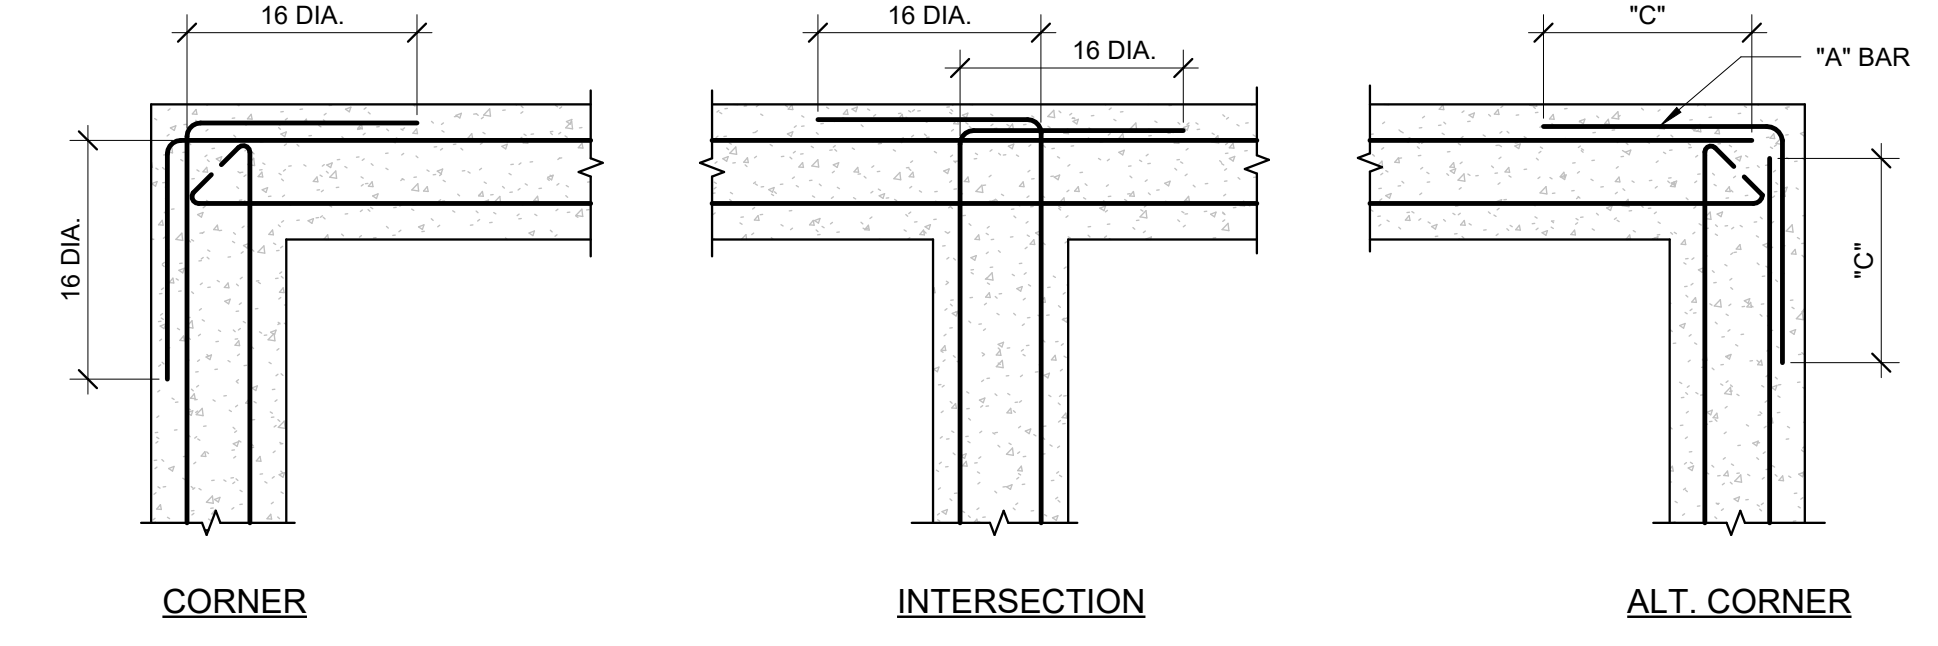


- NOTES:**
- IF "A" BAR IS USED, "C" IS BASED UPON ACI CLASS "B" SPlice PER DETAIL 1, THIS SHEET.
 - WHERE SINGLE LAYER OF REINFORCEMENT OCCURS, BEND BARS AS SHOWN FOR BARS AT OUTSIDE FACE.
 - AT INTERSECTIONS, ALTERNATE BENDS IN EACH DIRECTION.
 - WHERE SPlices OF DIFFERENT SIZE BARS OCCUR, CORNER DOWEL SIZE AND LAPS ARE BASED ON LARGER BAR SIZE.


5 Concrete Wall Corners
S-0.3 NOT TO SCALE

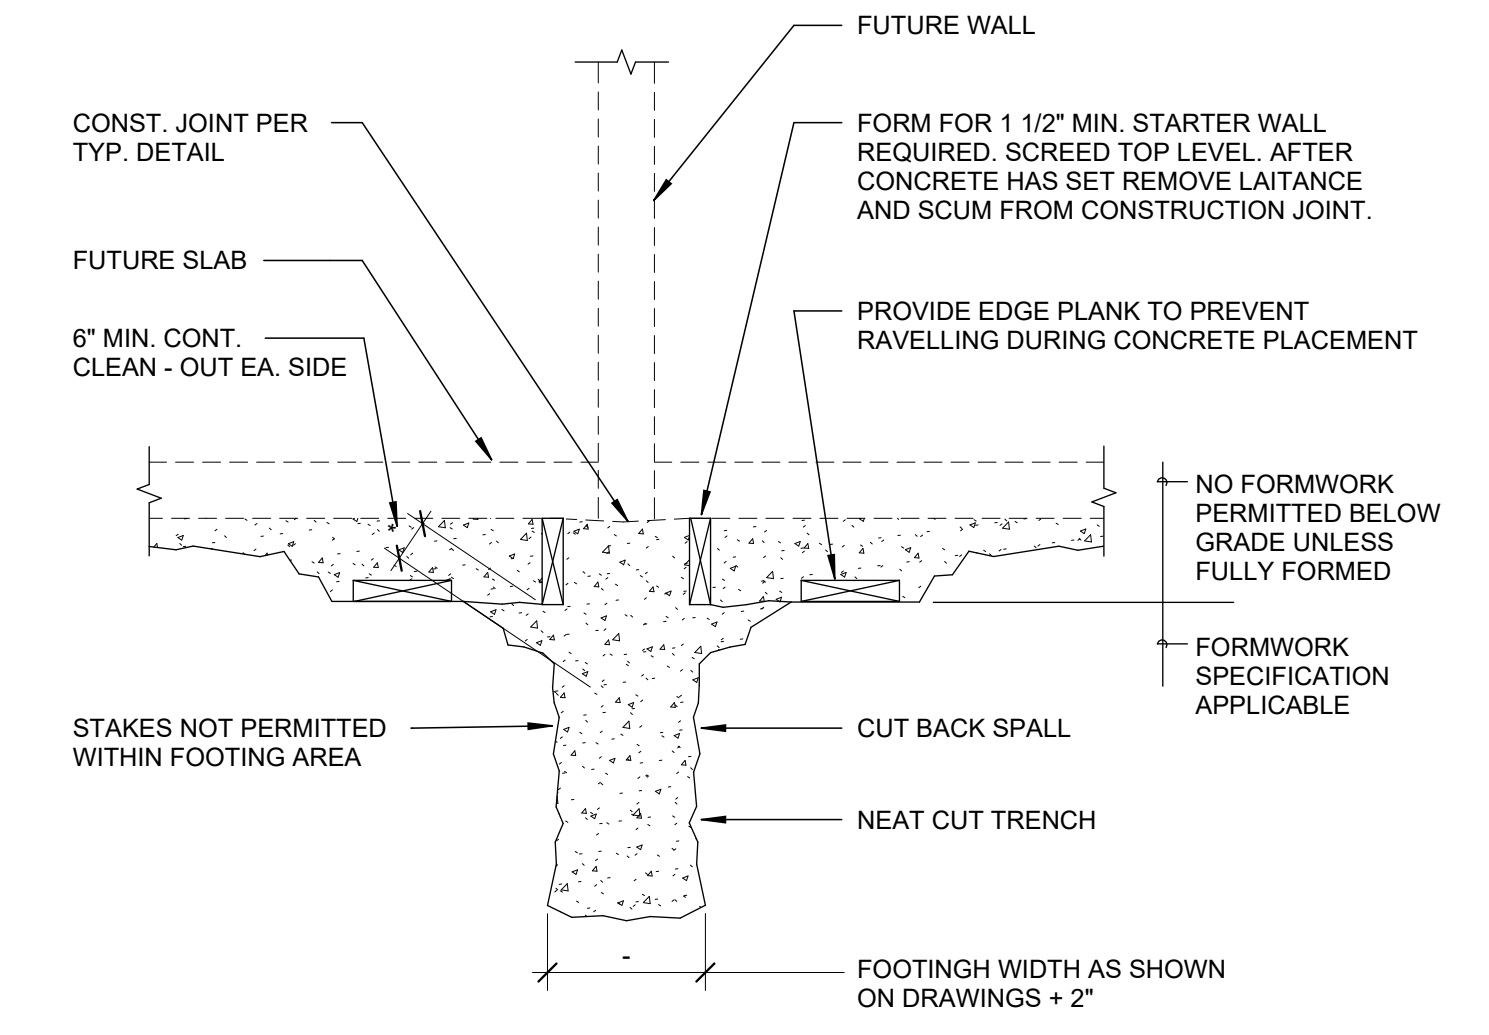

- NOTE:**
- ALL FOOTINGS POURED AGAINST EARTH ARE SUBJECT TO APPROVAL OF SOIL AND STRUCTURAL ENGINEERS AND MUST BE CONSTRUCTED IN THE MANNER SHOWN UNLESS SPECIFICALLY NOTED OTHERWISE

8 Footing Form Against Soil
S-0.3 NOT TO SCALE

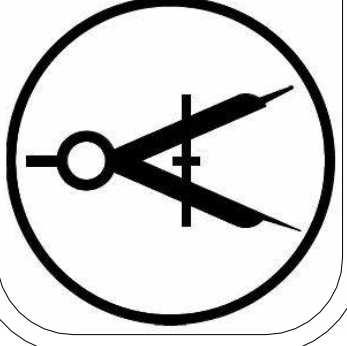


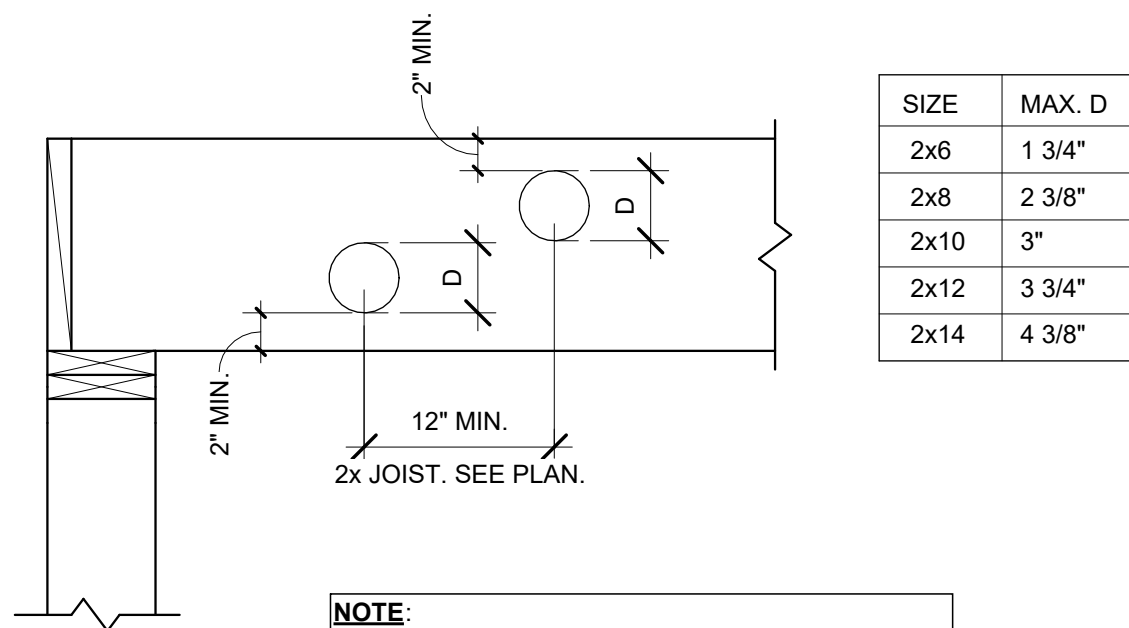

NOTE: NOTCHING JOIST IS NOT ACCEPTABLE WITHOUT STRUCTURAL ENGINEER'S APPROVAL

4 Typical Boring of Joists

S-0.4 NOT TO SCALE

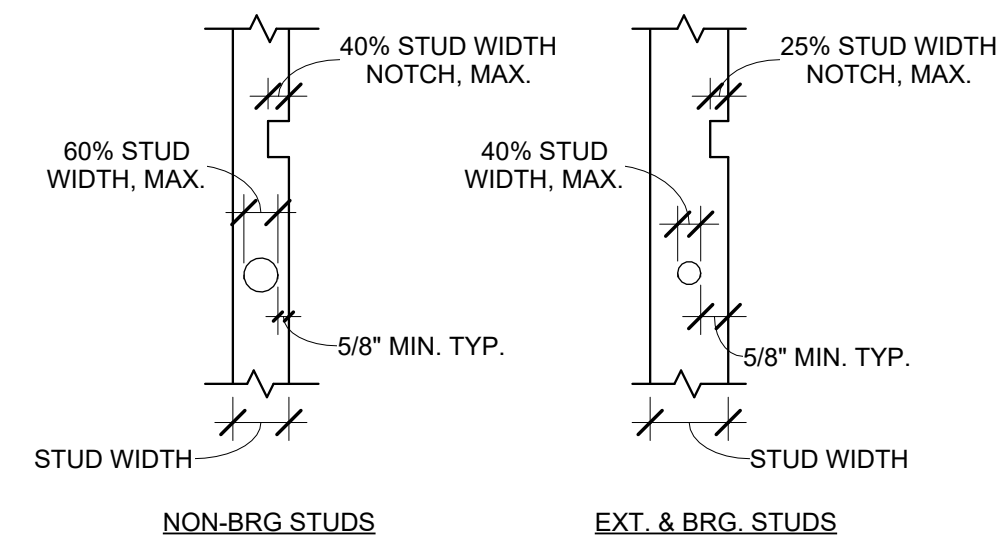


NOTE: NOTCH AND BORING NOT TO OCCUR IN SAME STUD SECTION.

NOTCH/BORING % OF STUD	2x4	2x6
25%	7/8"	1 3/8"
40%	1 3/8"	2 1/8"
60%	2"	3 1/4"


3 Typical Notching & Boring of Studs

S-0.4 NOT TO SCALE

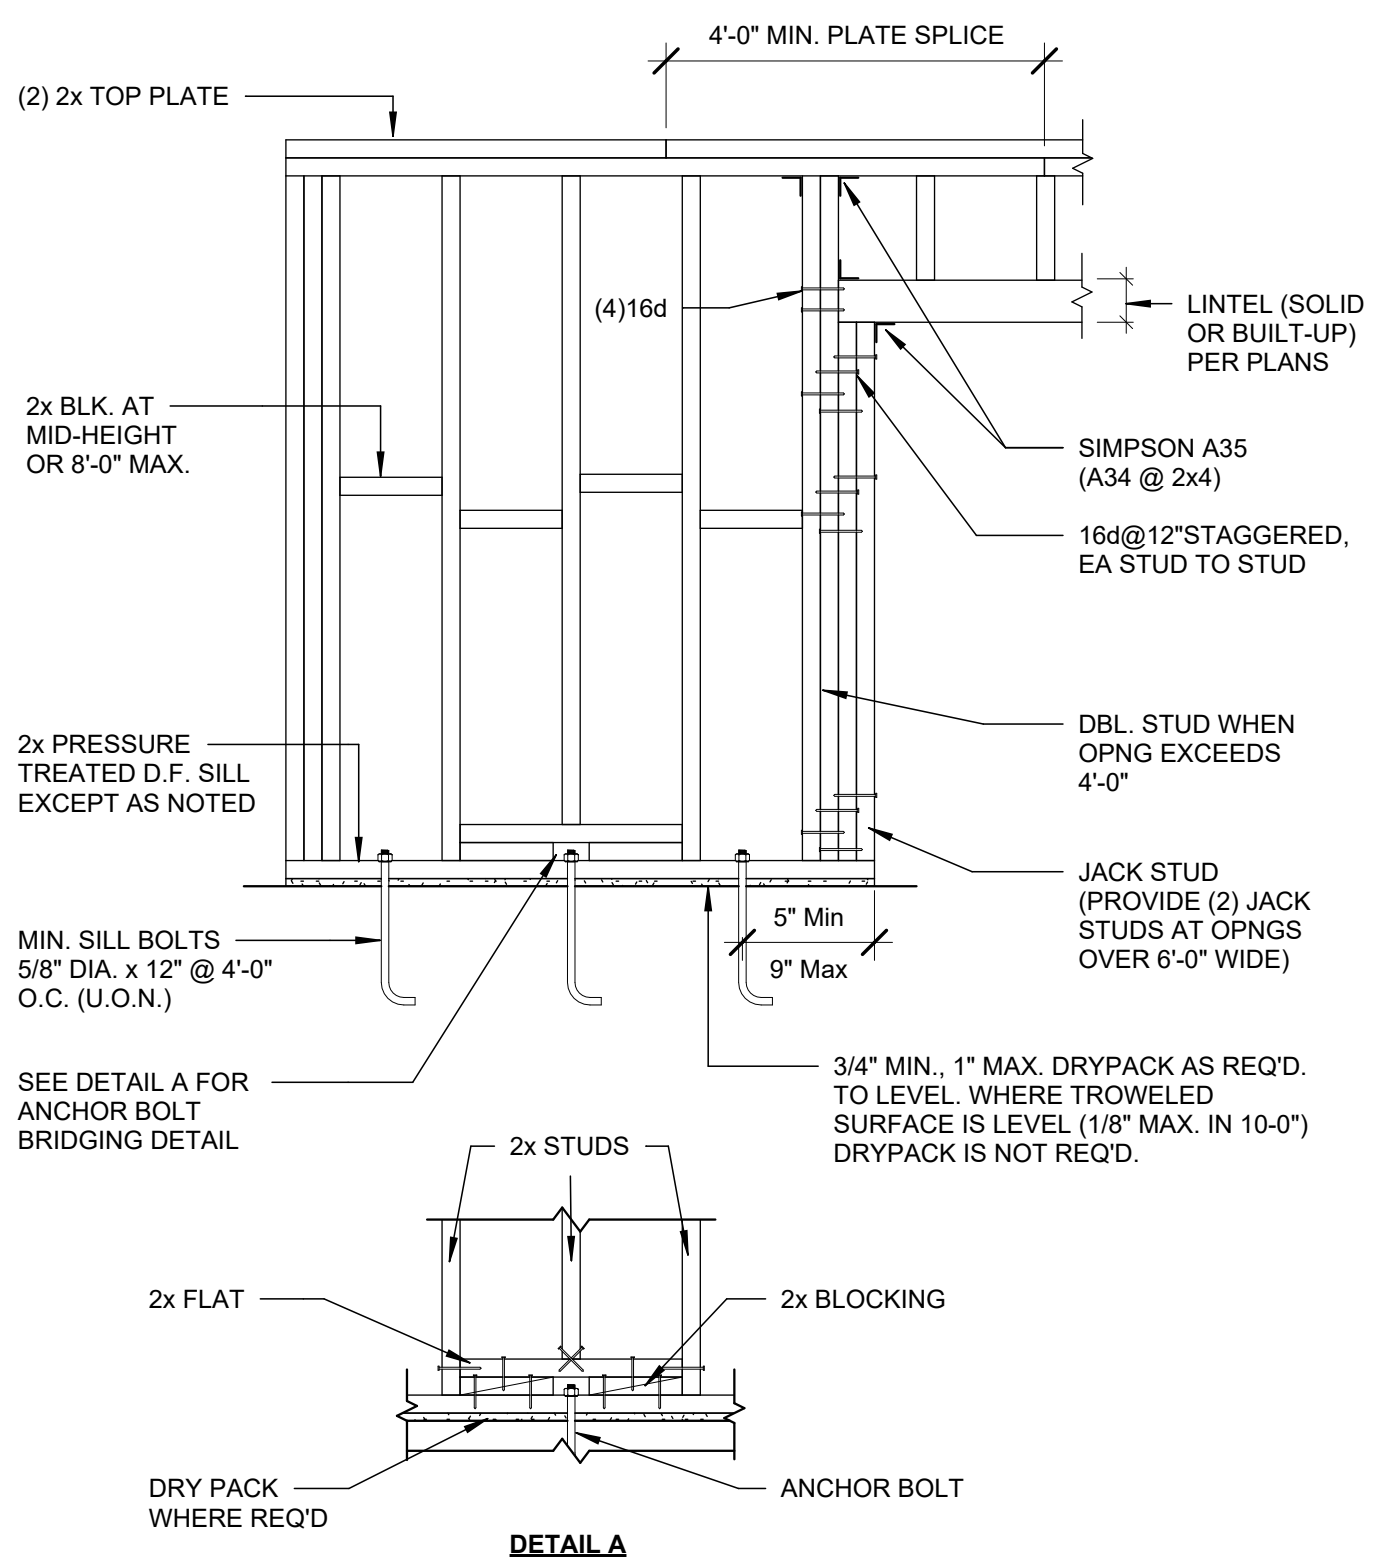


9 Stud Wall Framing

S-0.4 NOT TO SCALE

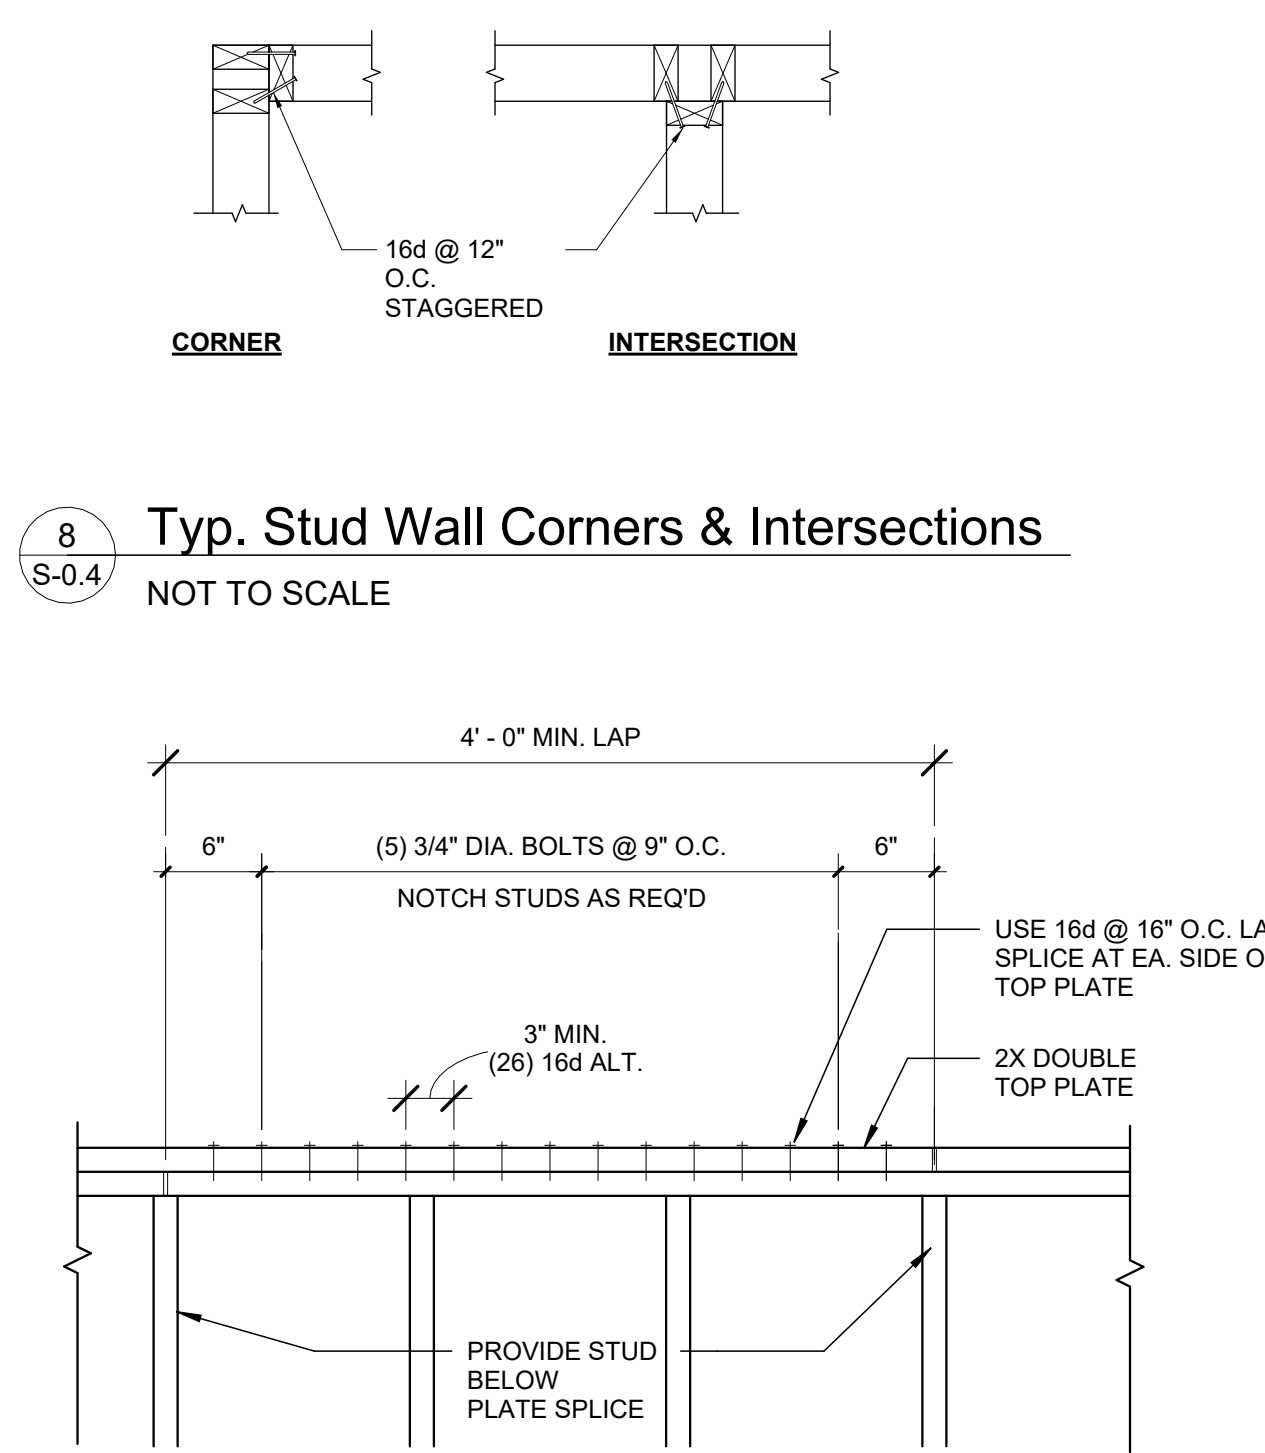

7 Double Top Plate Splice


S-0.4 NOT TO SCALE

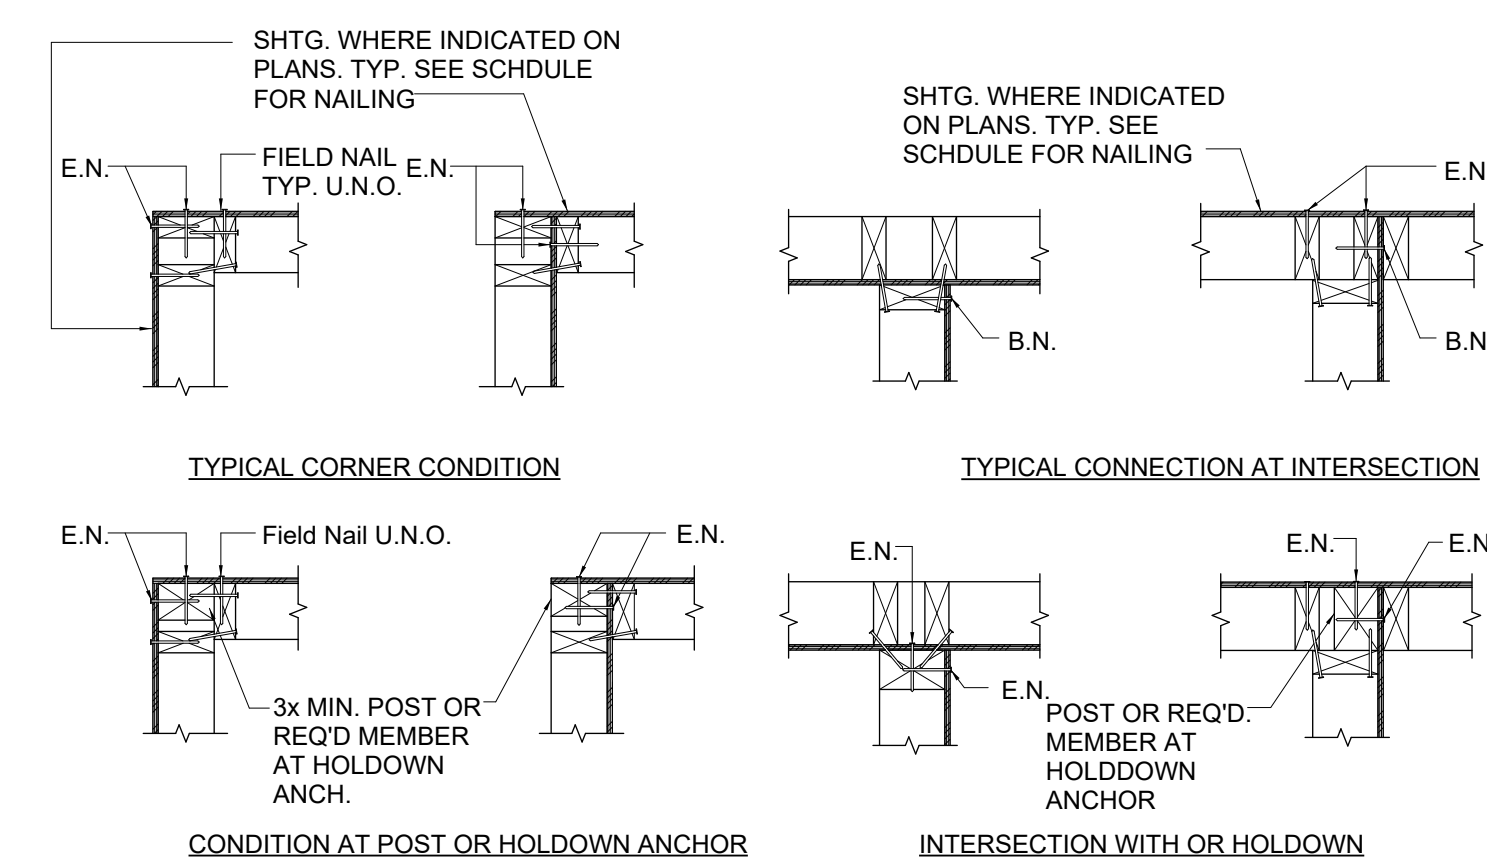

NOTES: STUDS IN DIRECT CONTACT SHALL BE NAILED TOGETHER WITH 16d @ 12" O.C. (STAGGERED IF POSSIBLE). STUDS SEPARATED BY SHEATHING SHALL BE NAILED WITH 20d @ 12" O.C. U.N.O. PRE-DRILLED HOLES ARE REQUIRED FOR 20d SPIKES.

13 Shear Wall Corners & Intersections

S-0.4 NOT TO SCALE

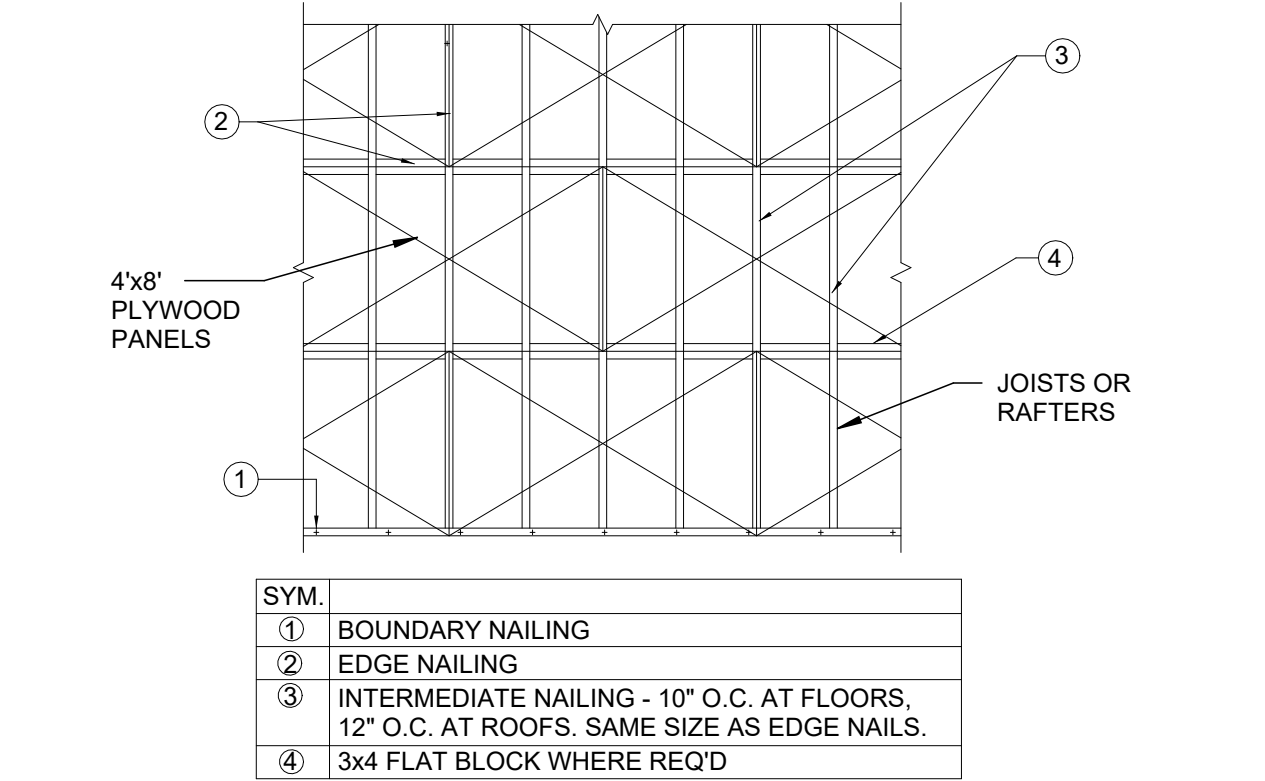

NOTES: 1. PLYWOOD THICKNESS AND NAILING PER PLAN. 2. FACE GRAIN OF PLYWOOD SHALL RUN PERPENDICULAR TO SUPPORTS. 3. NAILS SHALL HAVE MIN. 3/8" EDGE DISTANCE AND SHALL NOT BE OVER-DRIVEN THRU OUTER PLY. 4. CONTINUOUS PANEL EDGES SHALL RECEIVE BOUNDARY NAILING. 5. STAGGER PLYWOOD JOINTS.

12 Typical Plywood Layout & Nailing


S-0.4 NOT TO SCALE

CONNECTION		NAILING 1
1.	JOIST TO SILL OR GIRDER, TOENAIL	3-8d
2.	BRIDGING TO JOIST, TOENAIL EACH END	2-8d
3.	1"x6" SUBFLOOR OR LESS TO EACH JOIST, FACE NAIL	2-8d
4.	WIDER THAN 1"x6" SUBFLOOR TO EACH JOIST, FACE NAIL	3-8d
5.	2" SUBFLOOR TO JOIST OR GIRDER, BLIND AND FACE NAIL	2-16d
6.	SOLE PLATE TO JOIST OR BLOCKING, TYPICAL FACE NAIL	16d AT 16" O.C.
	SOLE PLATE TO JOIST OR BLOCKING, AT BRACED WALL PANELS	3-16d PER 16"
7.	TOP PLATE TO STUD, END NAIL	2-16d
8.	STUD TO SOLE PLATE	4-8d TOENAIL OR 2-16d END NAIL
9.	DOUBLE STUDS, FACE NAIL	16d AT 24" O.C.
10.	DOUBLED TOP PLATES, TYPICAL FACE NAIL	16d AT 16" o.c.
	DOUBLED TOP PLATES, LAP SPLICE	8-16d
11.	BLOCKING BETWEEN JOIST OR RAFTERS TO TOP PLATE, TOENAIL	3-8d
12.	RIM JOIST TO TOP PLATE, TOENAIL	8d AT 6" O.C.
13.	TOP PLATES, LAPS AND INTERSECTIONS	2-16d
14.	CONTINUOUS HEADER, TWO PIECES	16d AT 16" O.C. ALONG EA. END
15.	CEILING JOIST TO PLATE, TOENAIL	3-8d
16.	CONTINUOUS HEADER TO STUD, TOENAIL	4-8d
17.	CEILING JOIST, LAPS OVER PARTITIONS, FACE NAIL	3-16d
18.	CEILING JOIST TO PARALLEL RAFTERS, FACE NAIL	3-16d
19.	RAFTER TO PLATE, TOENAIL	3-8d
20.	1" BRACE TO EACH STUD AND PLATE, FACE NAIL	2-8d
21.	1"x8" SHEATHING OR LESS TO EACH BEARING, FACE NAIL	2-8d
22.	WIDER THAN 1"x8" SHEATHING TO EACH BEARING, FACE NAIL	3-8d
23.	BUILT UP CORNER STUDS	16d AT 24" O.C.
24.	BUILT UP GIRDER AND BEAMS	20d AT 32" O.C. AT TOP AND BOTTOM AND STAGGERED 2-20d AT ENDS AND AT EA. SPLICE
25.	2" PLANKS	2 - 16d AT EACH BEARING
26.	COLLAR TIE TO RAFTER, FACE NAIL	3-10d
27.	JACK RAFTER TO HIP	3-8d TOENAIL OR 2-16d FACE NAIL
28.	ROOF RAFTER TO 2x RIDGE BEAM	2-16d TOENAIL OR FACE NAIL
29.	JOIST TO BAND JOIST, FACE NAIL	3-16d
30.	LEDGER STRIP	3-16d
31.	WOOD STRUCTURAL PANELS AND PARTICLEBOARD 2	
	SUBFLOOR, ROOF AND WALL SHEATHING (TO FRAMING)	
	1/2" AND LESS	6d ^{3,12}
	19/32" TO 3/4"	8d ³ OR 6d ⁵
	7/8" TO 1"	8d ³
	1 1/8" TO 1 1/4"	10d OR 8d ⁵
	SINGLE FLOOR (COMBINATION SUBFLOOR-UNDERLAYMENT TO FRAMING)	
	3/4" AND LESS	6d ⁵
	7/8" TO 1"	8d ⁵
	1 1/8" TO 1 1/4"	10d OR 8d ⁵
32.	PANEL SIDING (TO FRAMING):	
	1/2" OR LESS	6d ⁶
	25/32"	8d ⁶
33.	FIBERBOARD SHEATHING: 7	
	1/2"	NO. 11 GA. ⁸
	6d ⁴	
	25/32"	NO. 11 GA. ⁸
		8d ⁴
34.	INTERIOR PANELING	
	1/4"	4d ¹⁰
	3/8"	6d ¹¹

6 Nailing Schedule


S-0.4 NOT TO SCALE

- COMMON OR BOX NAILS ARE PERMITTED TO BE USED EXCEPT WHERE OTHERWISE STATED.
- NAILS SPACED AT 6 INCHES ON CENTER AT EDGES, 12 INCHES AT INTERMEDIATE SUPPORTS EXCEPT 6 INCHES AT SUPPORTS WHERE SPANS ARE 48 INCHES OR MORE. FOR NAILING OF WOOD STRUCTURAL PANEL AND PARTICLE BOARD DIAPHRAGMS AND SHEAR WALLS, REFER TO CBC SECTION 2305. NAILS FOR WALL SHEATHING ARE PERMITTED TO BE COMMON, BOX OR CASING.
- COMMON OR DEFORMED SHANK
- COMMON
- DEFORMED SHANK
- CORROSION-RESISTANT SIDING OR CASING NAIL
- FASTENERS SPACED 3 INCHES ON CENTER AT EXTERIOR EDGES AND 6 INCHES ON CENTER AT INTERMEDIATE SUPPORTS. WHEN USED AS STRUCTURAL SHEATHING, SPACING SHALL BE 6 INCHES ON CENTER ON THE EDGES AND 12 INCHES ON CENTER AT INTERMEDIATE SUPPORTS FOR NON-STRUCTURAL APPLICATIONS.
- CORROSION-RESISTANT ROOFING NAILS WITH 7/16" DIAMETER HEAD AND 1 1/2" LENGTH FOR 1/2" SHEATHING AND 1 3/4" LENGTH FOR 25/32" SHEATHING
- CORROSION RESISTANT STAPLES WITH NOMINAL 7/16" CROWN AND 1 1/8" LENGTH FOR 1/2" SHEATHING AND 1 1/2" LENGTH FOR 25/32" SHEATHING. PANEL SUPPORTS AT 16 INCHES (20 INCHES IF STRENGTH AXIS IN THE LONG DIRECTION OF THE PANEL, UNLESS OTHERWISE MARKED).
- CASING OR FINISH NAILS SPACED 6 INCHES ON PANEL EDGES, 12 INCHES AT INTERMEDIATE SUPPORTS.
- PANEL SUPPORTS AT 24 INCHES. CASING OR FINISH NAILS AT 6 INCHES ON PANEL EDGES, 12 INCHES AT INTERMEDIATE SUPPORTS.
- FOR ROOF SHEATHING APPLICATIONS, 8d NAILS ARE THE MINIMUM REQUIRED FOR WOOD STRUCTURAL PANELS.
- STAPLES SHALL HAVE A MINIMUM CROWN WIDTH OF 7/16 INCH.
- FOR ROOF SHEATHING APPLICATIONS, FASTENERS SPACED 4 INCHES ON CENTER AT EDGES, 8 INCHES AT INTERMEDIATE SUPPORTS.
- FASTENERS SPACED 4 INCHES ON CENTER AT EDGES, 8 INCHES AT INTERMEDIATE SUPPORTS FOR SUBFLOOR AND WALL SHEATHING AND 3 INCHES ON CENTER AT EDGES, 6 INCHES AT INTERMEDIATE SUPPORTS FOR ROOF SHEATHING.
- FASTENERS SPACED 4 INCHES ON CENTER AT EDGES, 8 INCHES AT INTERMEDIATE SUPPORTS.

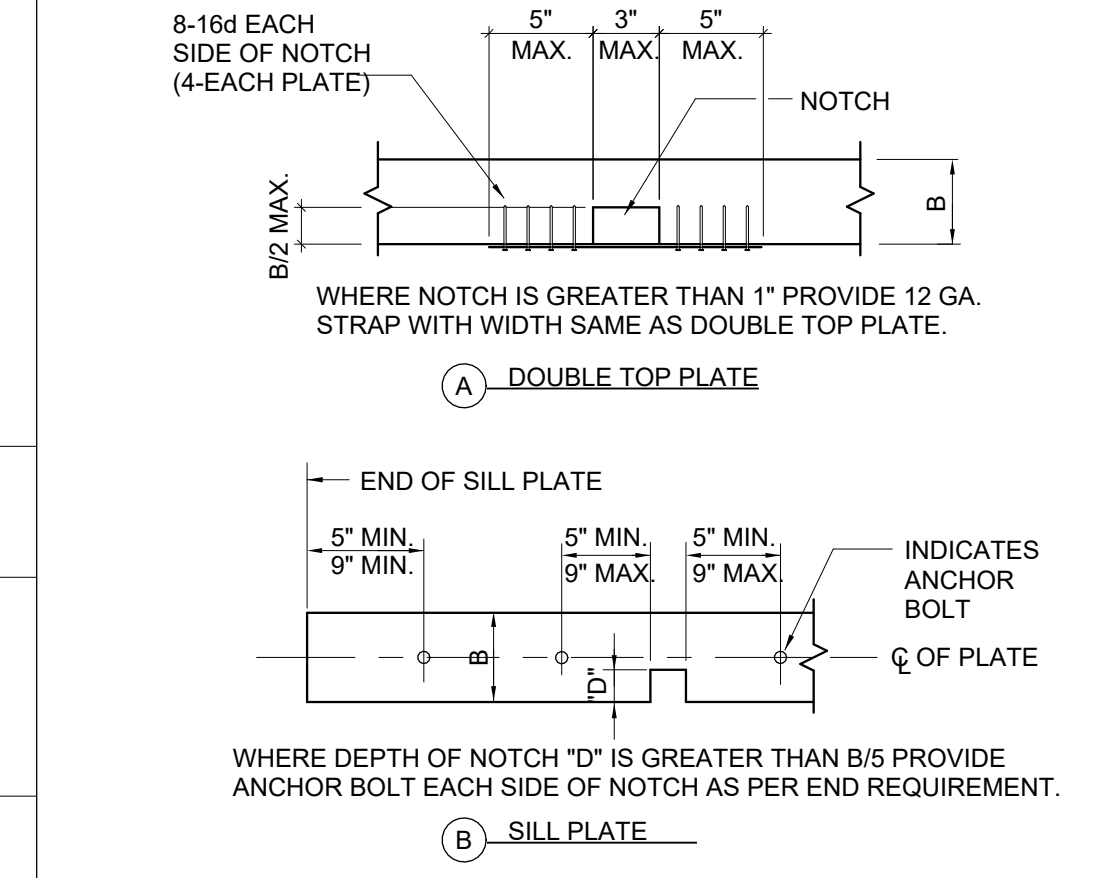

5 Notching of Plates


S-0.4 NOT TO SCALE

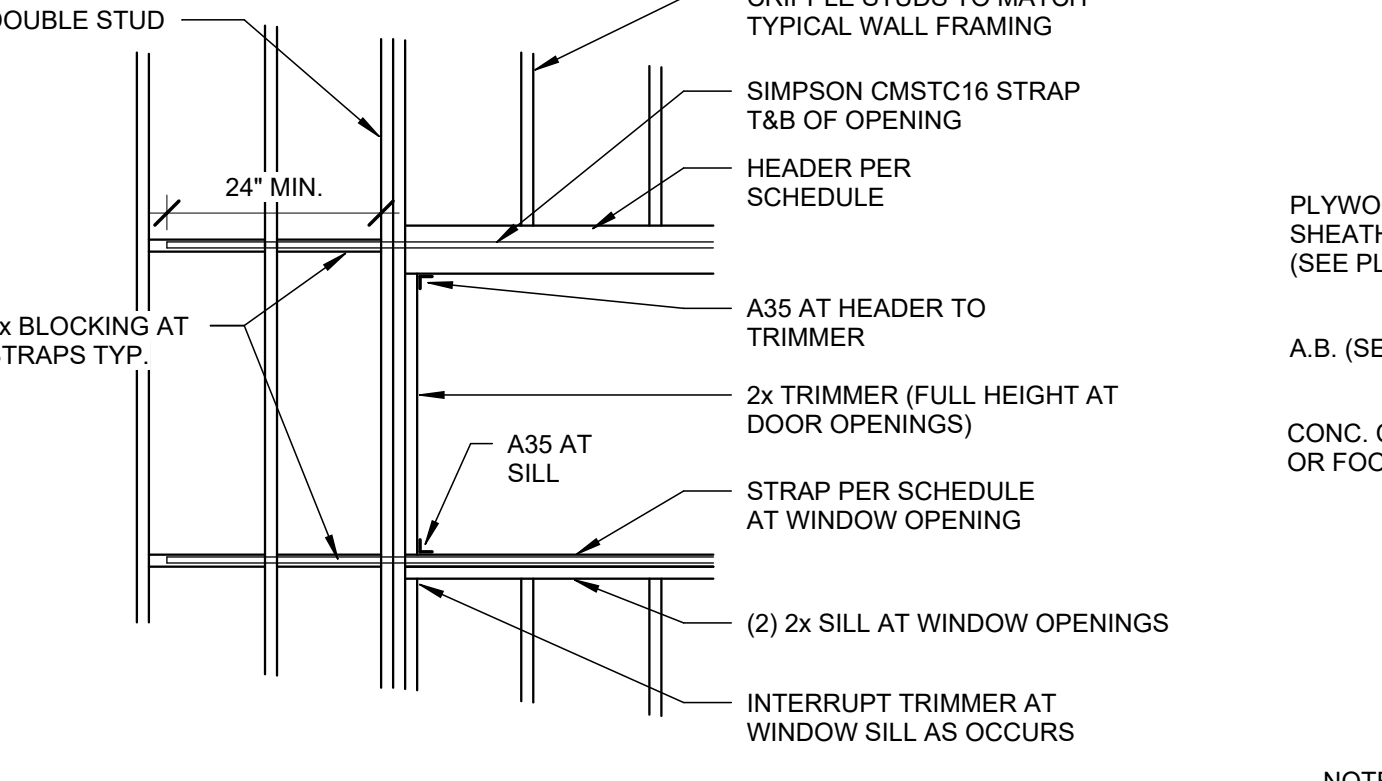

NOTES: 1. HEADERS TO BE DF-L NO. 1. HEADER SIZES PER SCHEDULE U.O.N. ON PLANS. 2. STRAPS ARE TO BE INSTALLED OVER PLYWOOD. 3. PROVIDE E.N. TO ALL FRAMING MEMBERS AROUND OPENINGS AND BLOCKING.

11 Typical Framed Opening in Shearwall


S-0.4 NOT TO SCALE

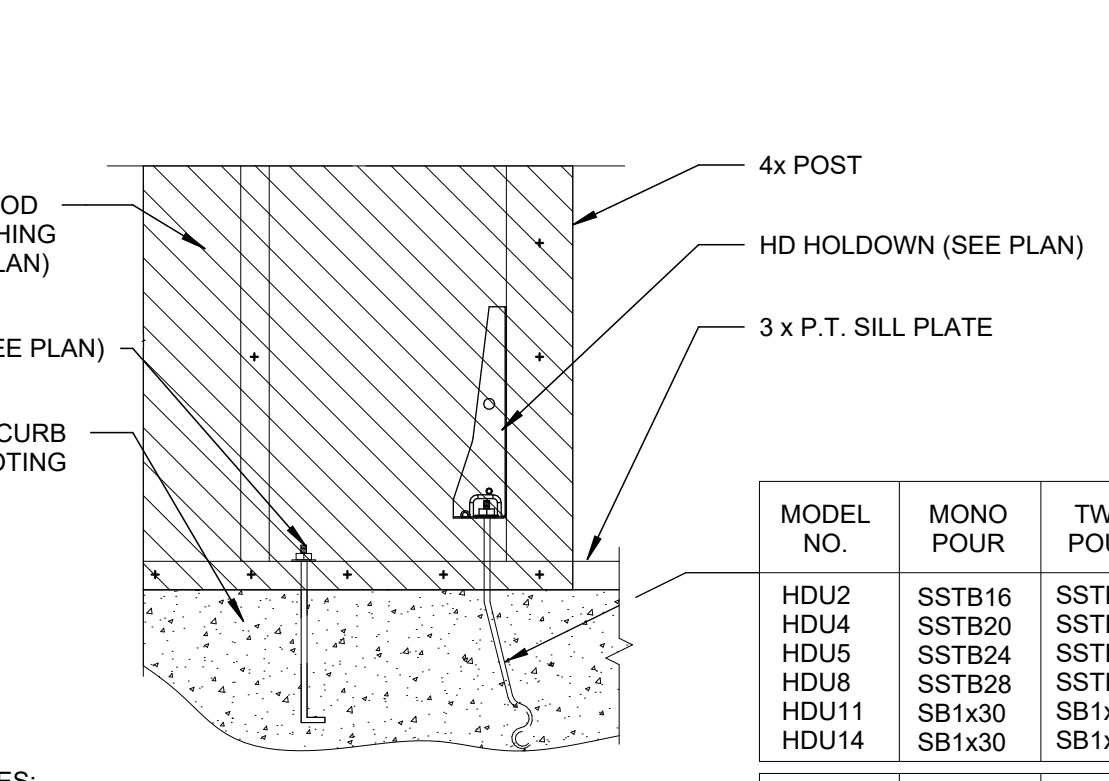


NOTES: 1. HOLDOWN HARDWARE SHALL BE SECURED IN PLACE PRIOR TO FOUNDATION INSPECTION. 2. HOLDOWN CONNECTOR BOLTS INTO WOOD FRAMING REQUIRE APPROVED PLATE WASHERS. 3. HOLDOWN CONNECTOR BOLTS SHALL BE TIGHTENED PRIOR TO COVERING THE WALL FRAMING. 4. SEE FOUNDATION PLAN FOR LOCATION AND SHEARWALL INFORMATION.

10 Typical Detail at Holdown


S-0.4 NOT TO SCALE

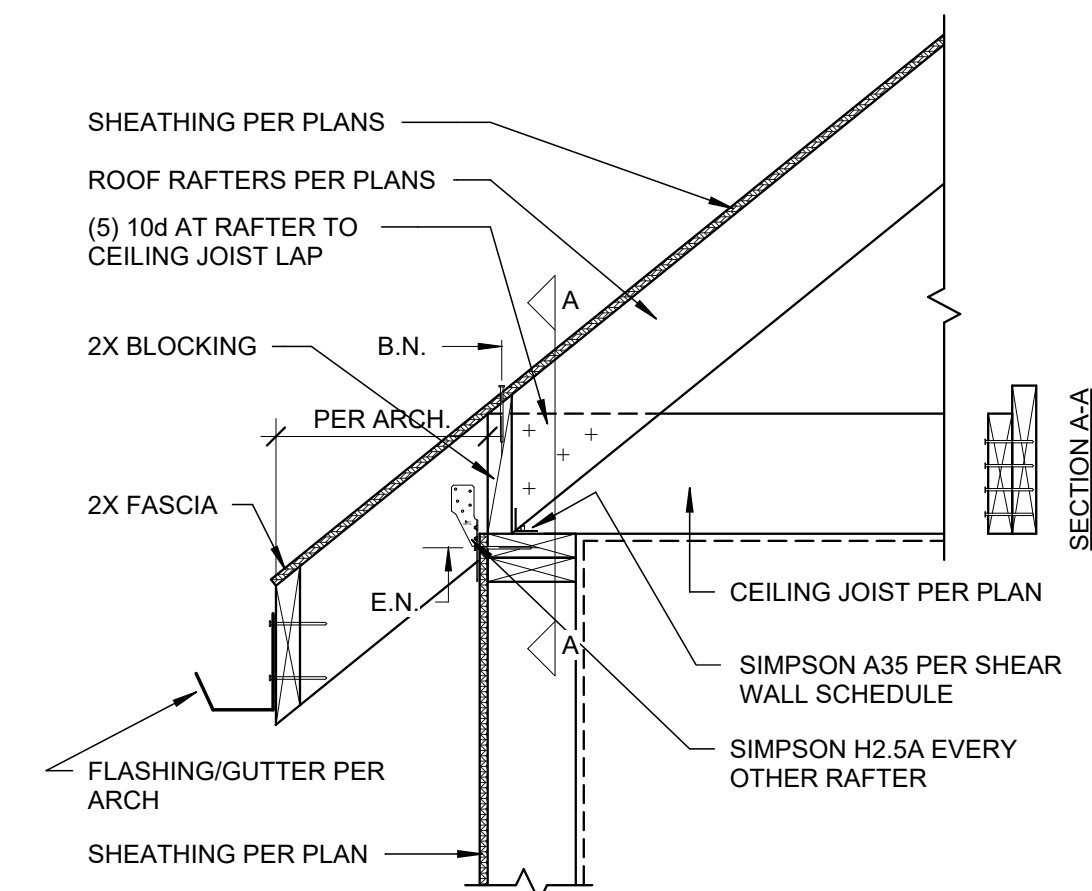


1 Typical Eave Detail
1" = 1'-0"

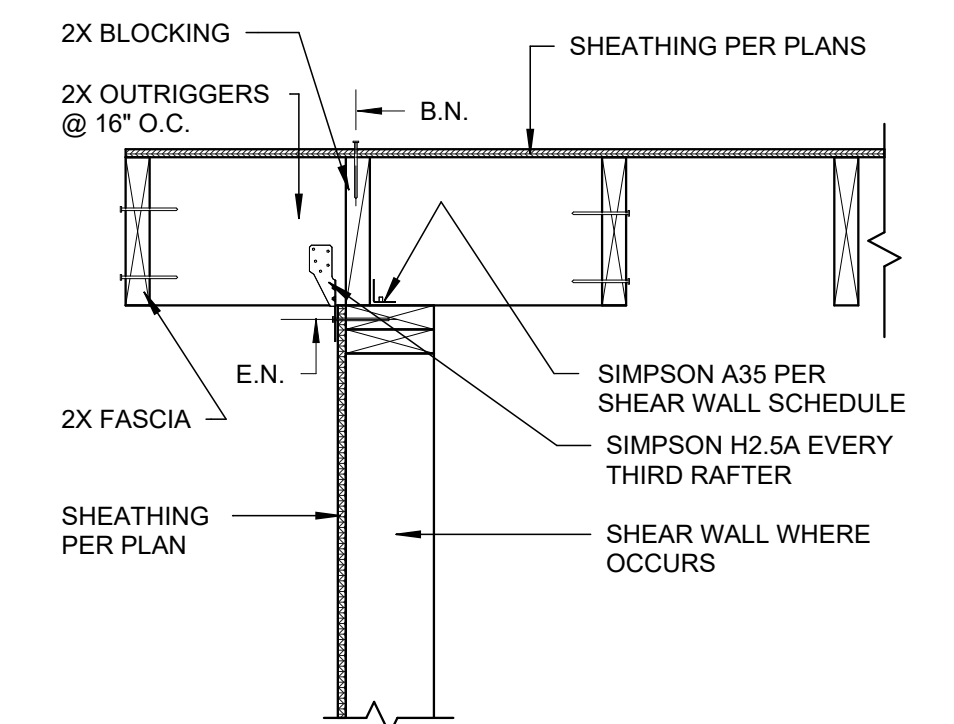


2 Typical Shear Transfer at Wall
1" = 1'-0"

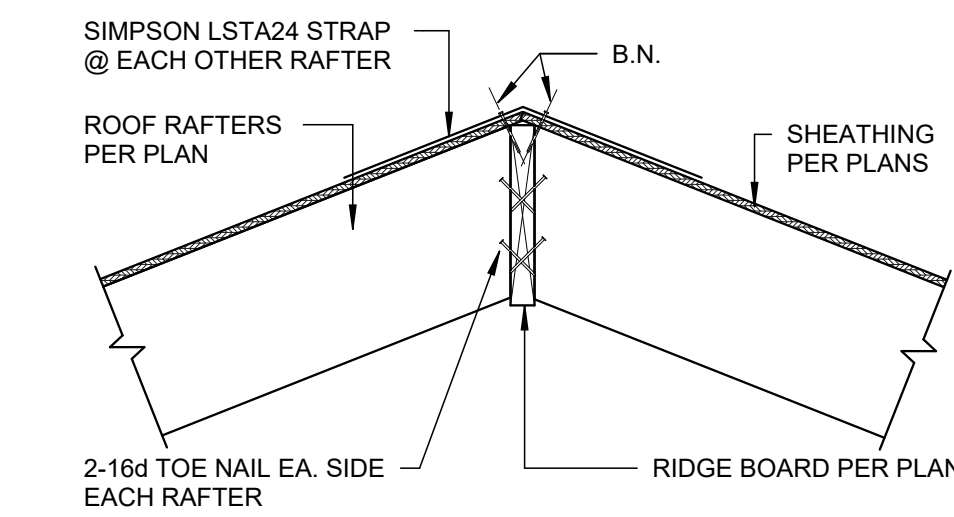


3 Typical Ridge Board Detail
1" = 1'-0"

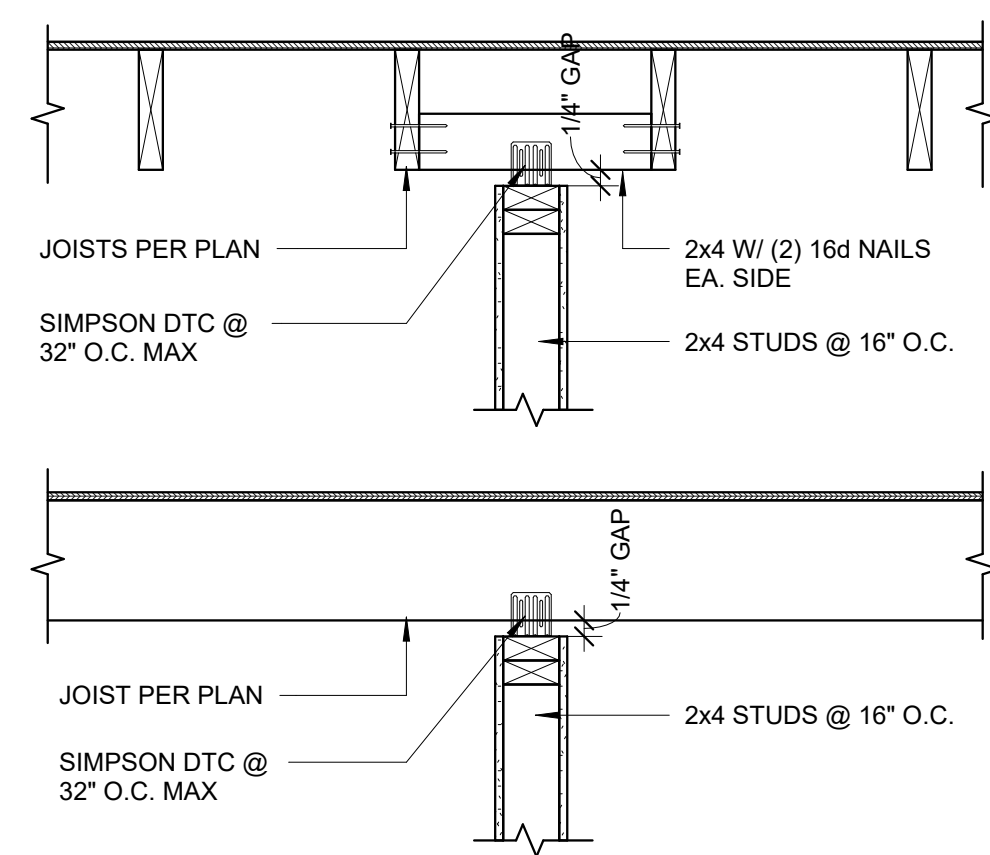


5 Typ. Non-Bearing Partition Wall Detail
1" = 1'-0"

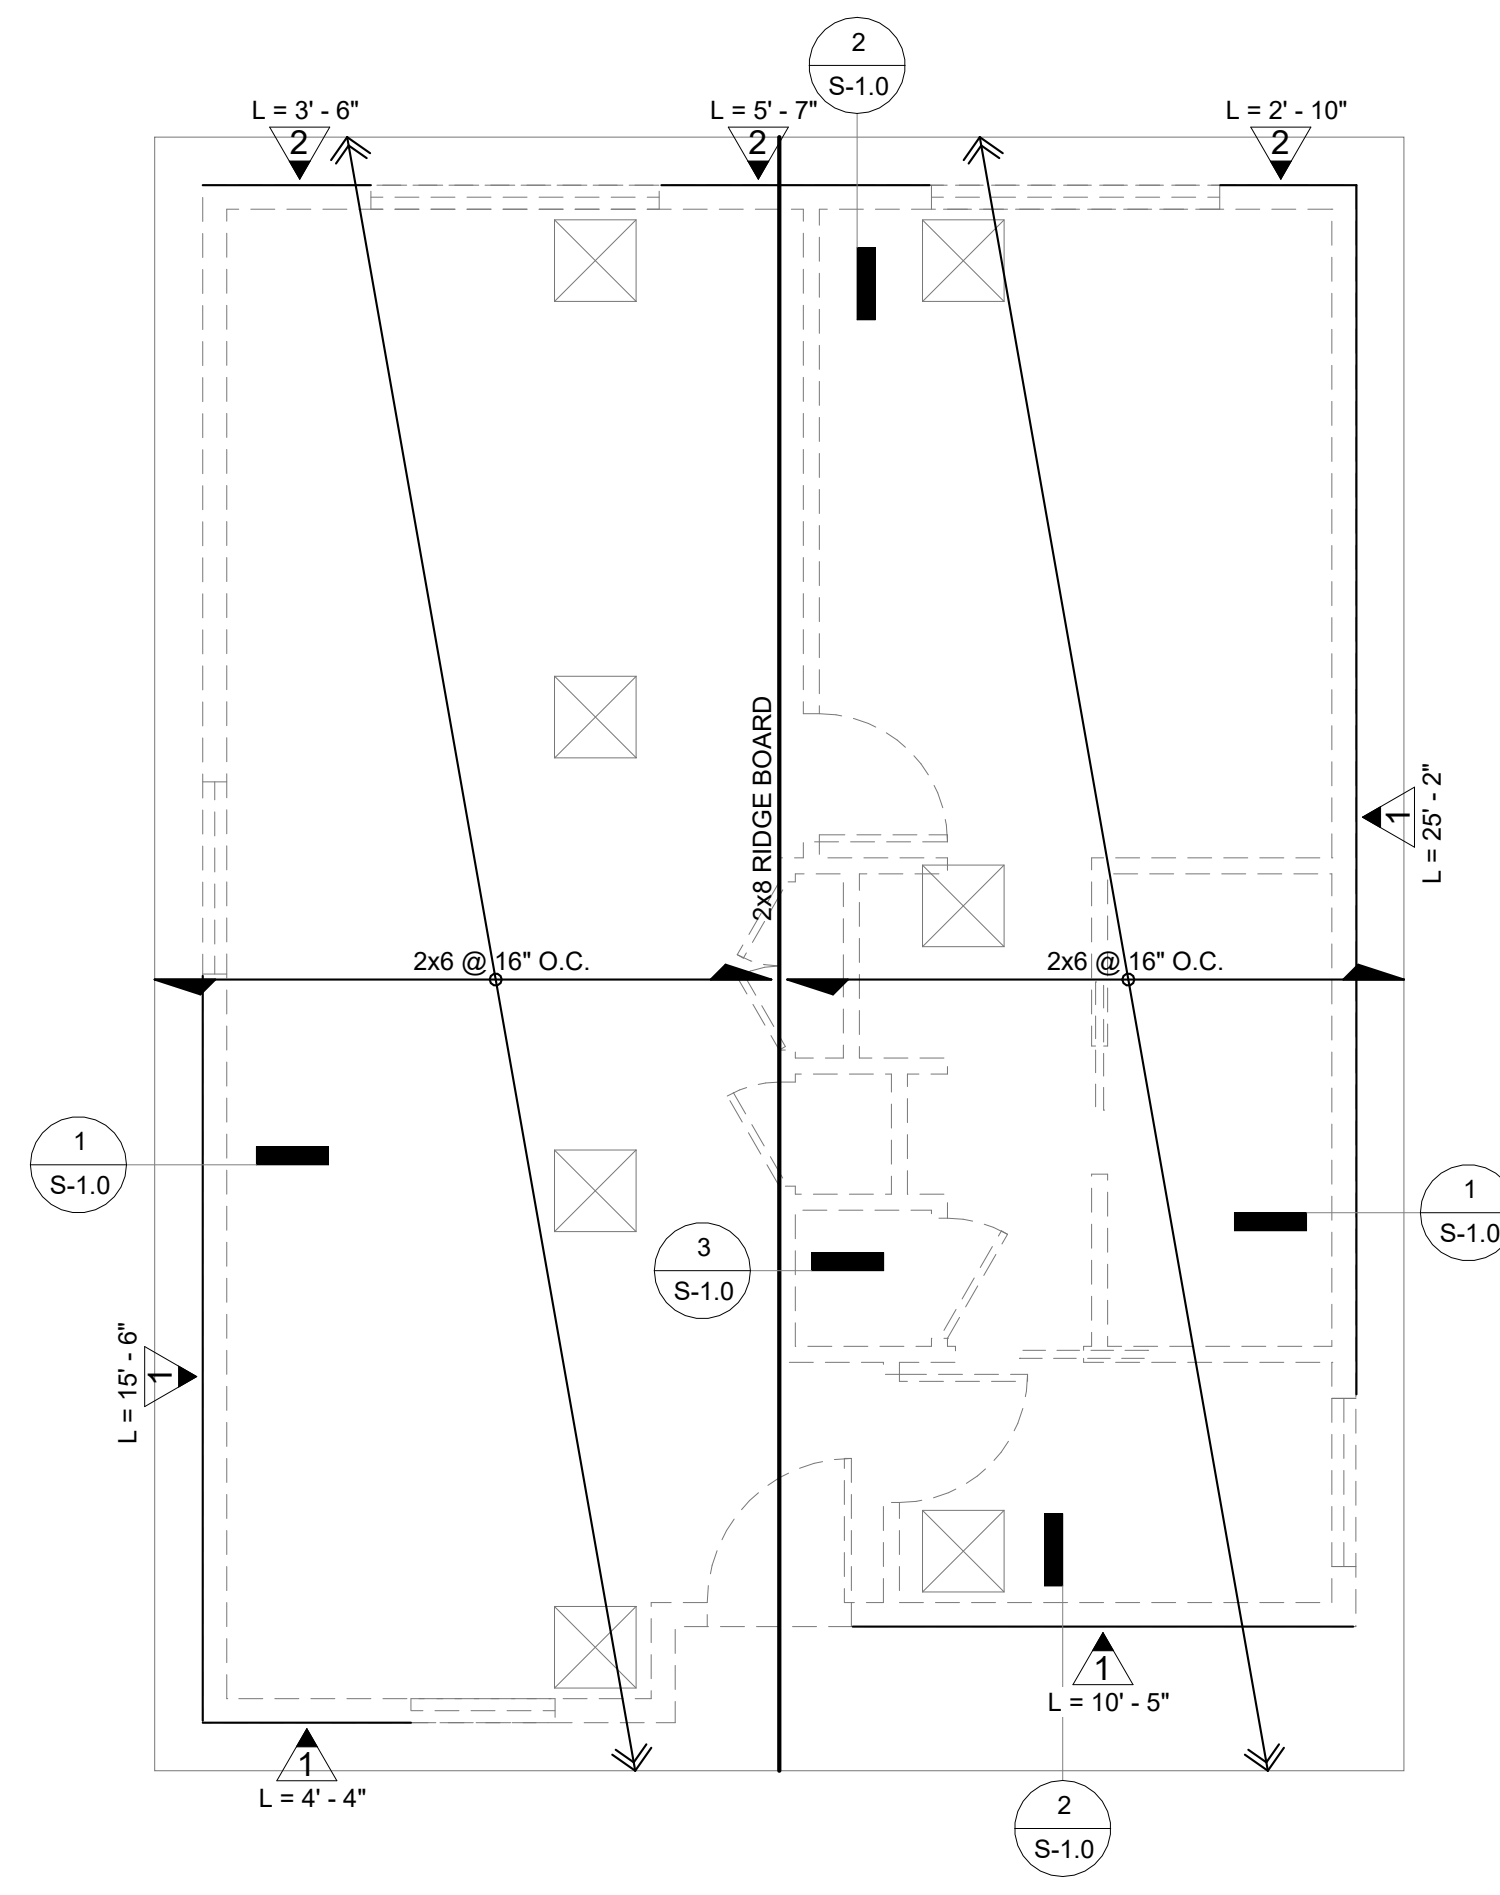


C Roof Framing Plan
1/4" = 1'-0"

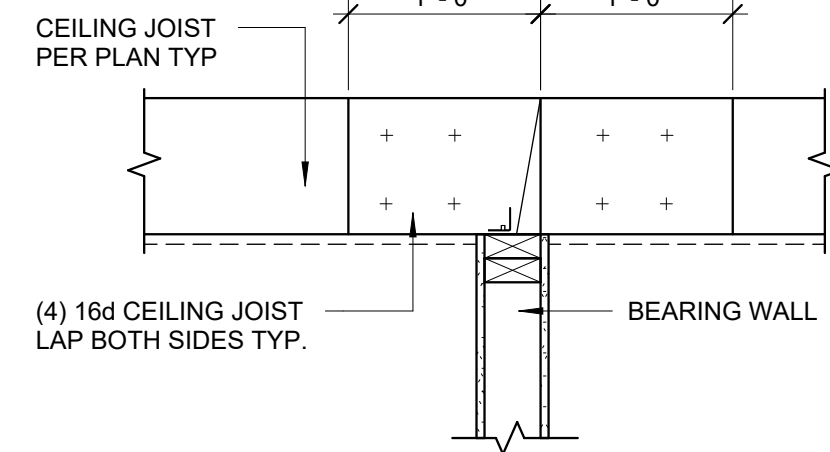


4 Bearing, Non-Shear Wall Detail
1" = 1'-0"

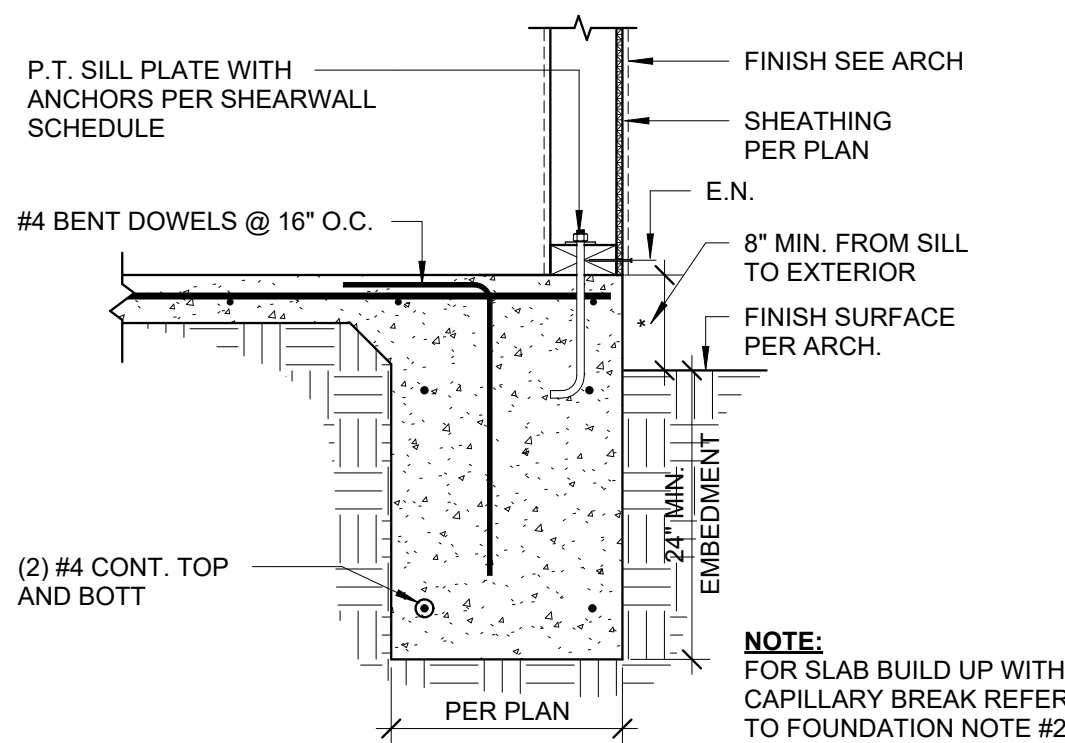

6 Typical Exterior Wall Footing Detail
3/4" = 1'-0"

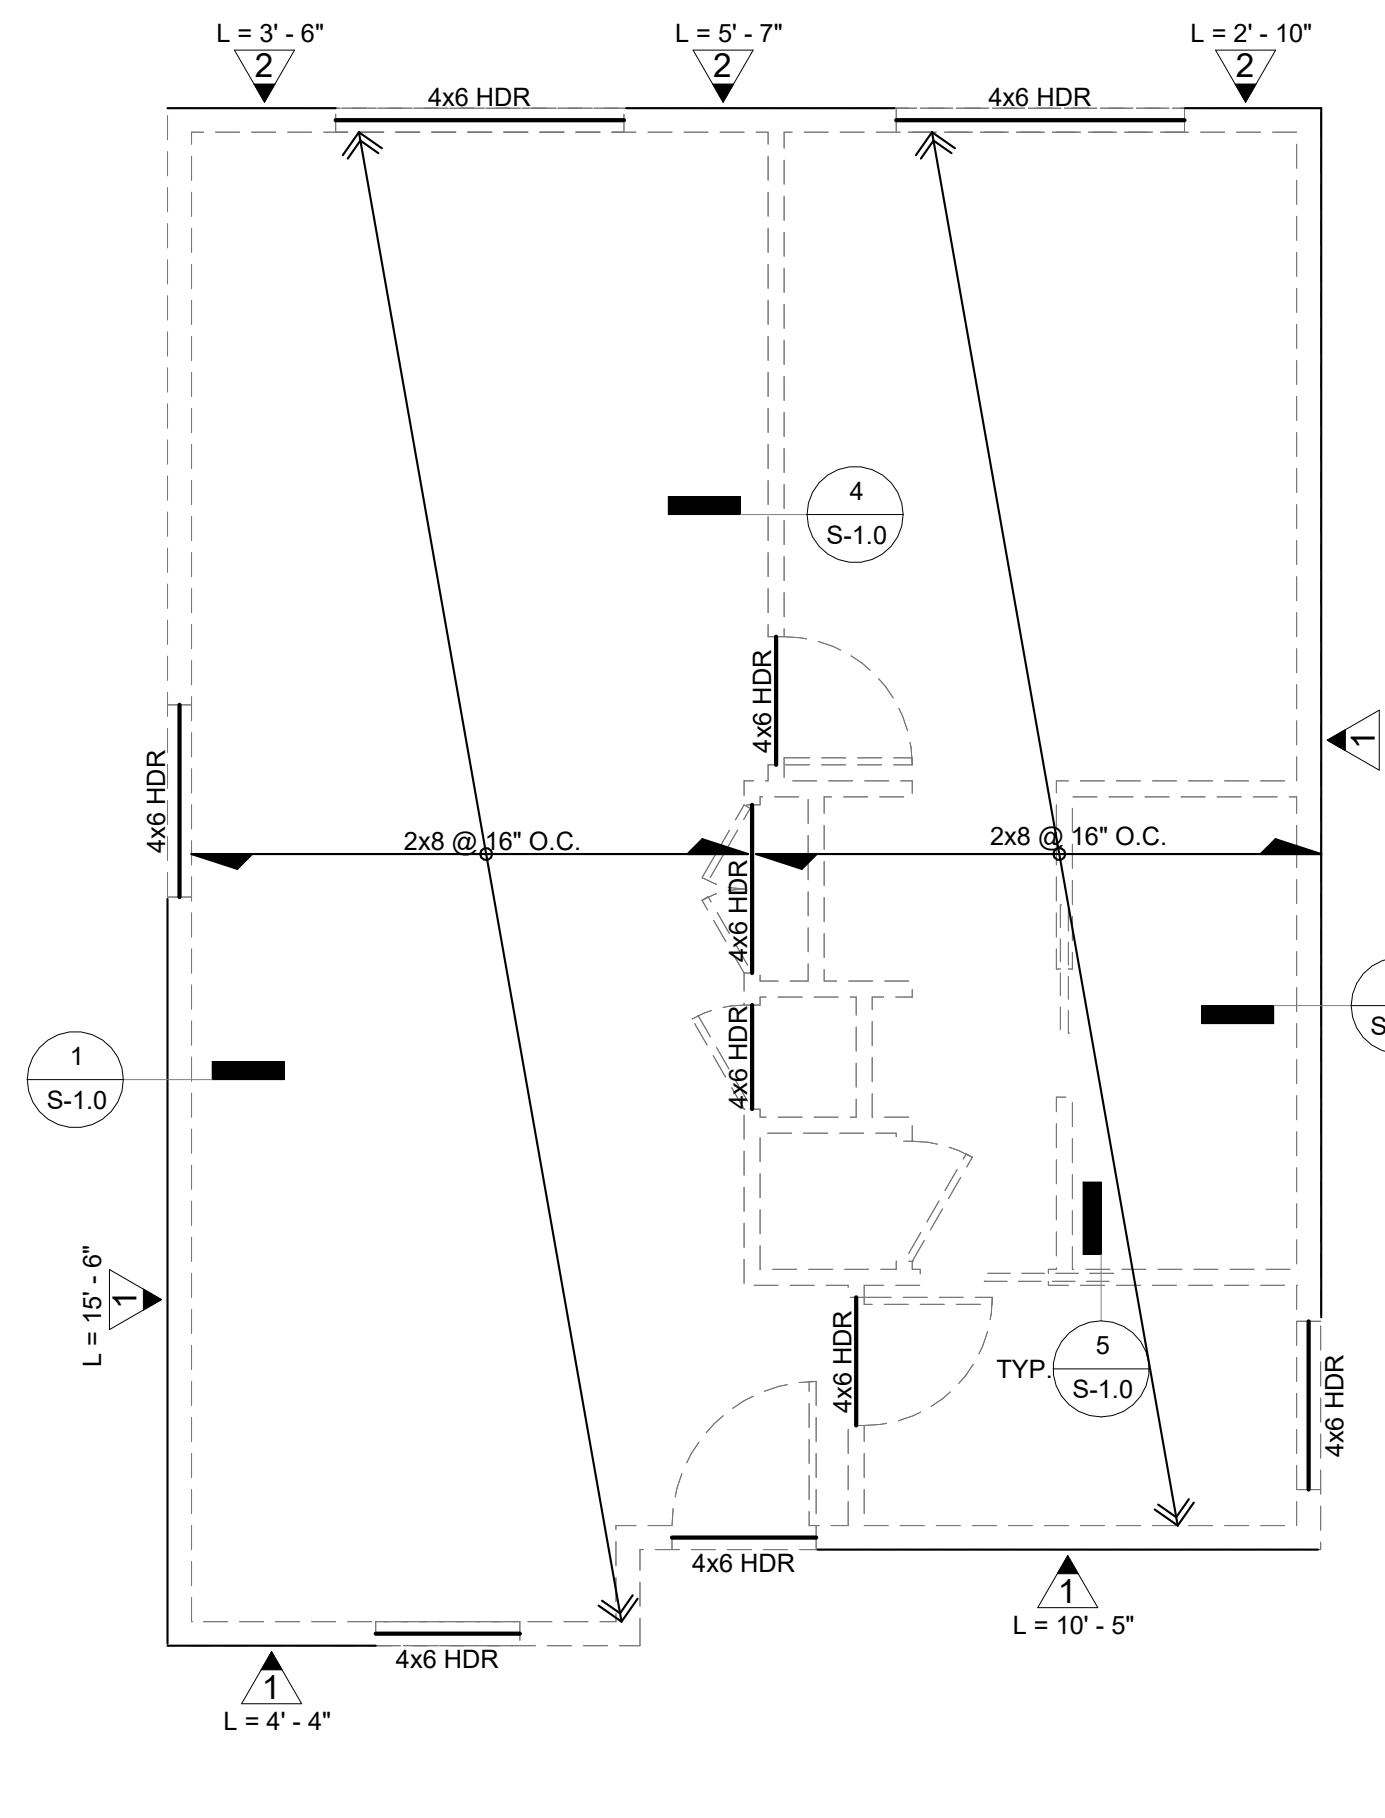

B Ceiling Framing Plan
1/4" = 1'-0"

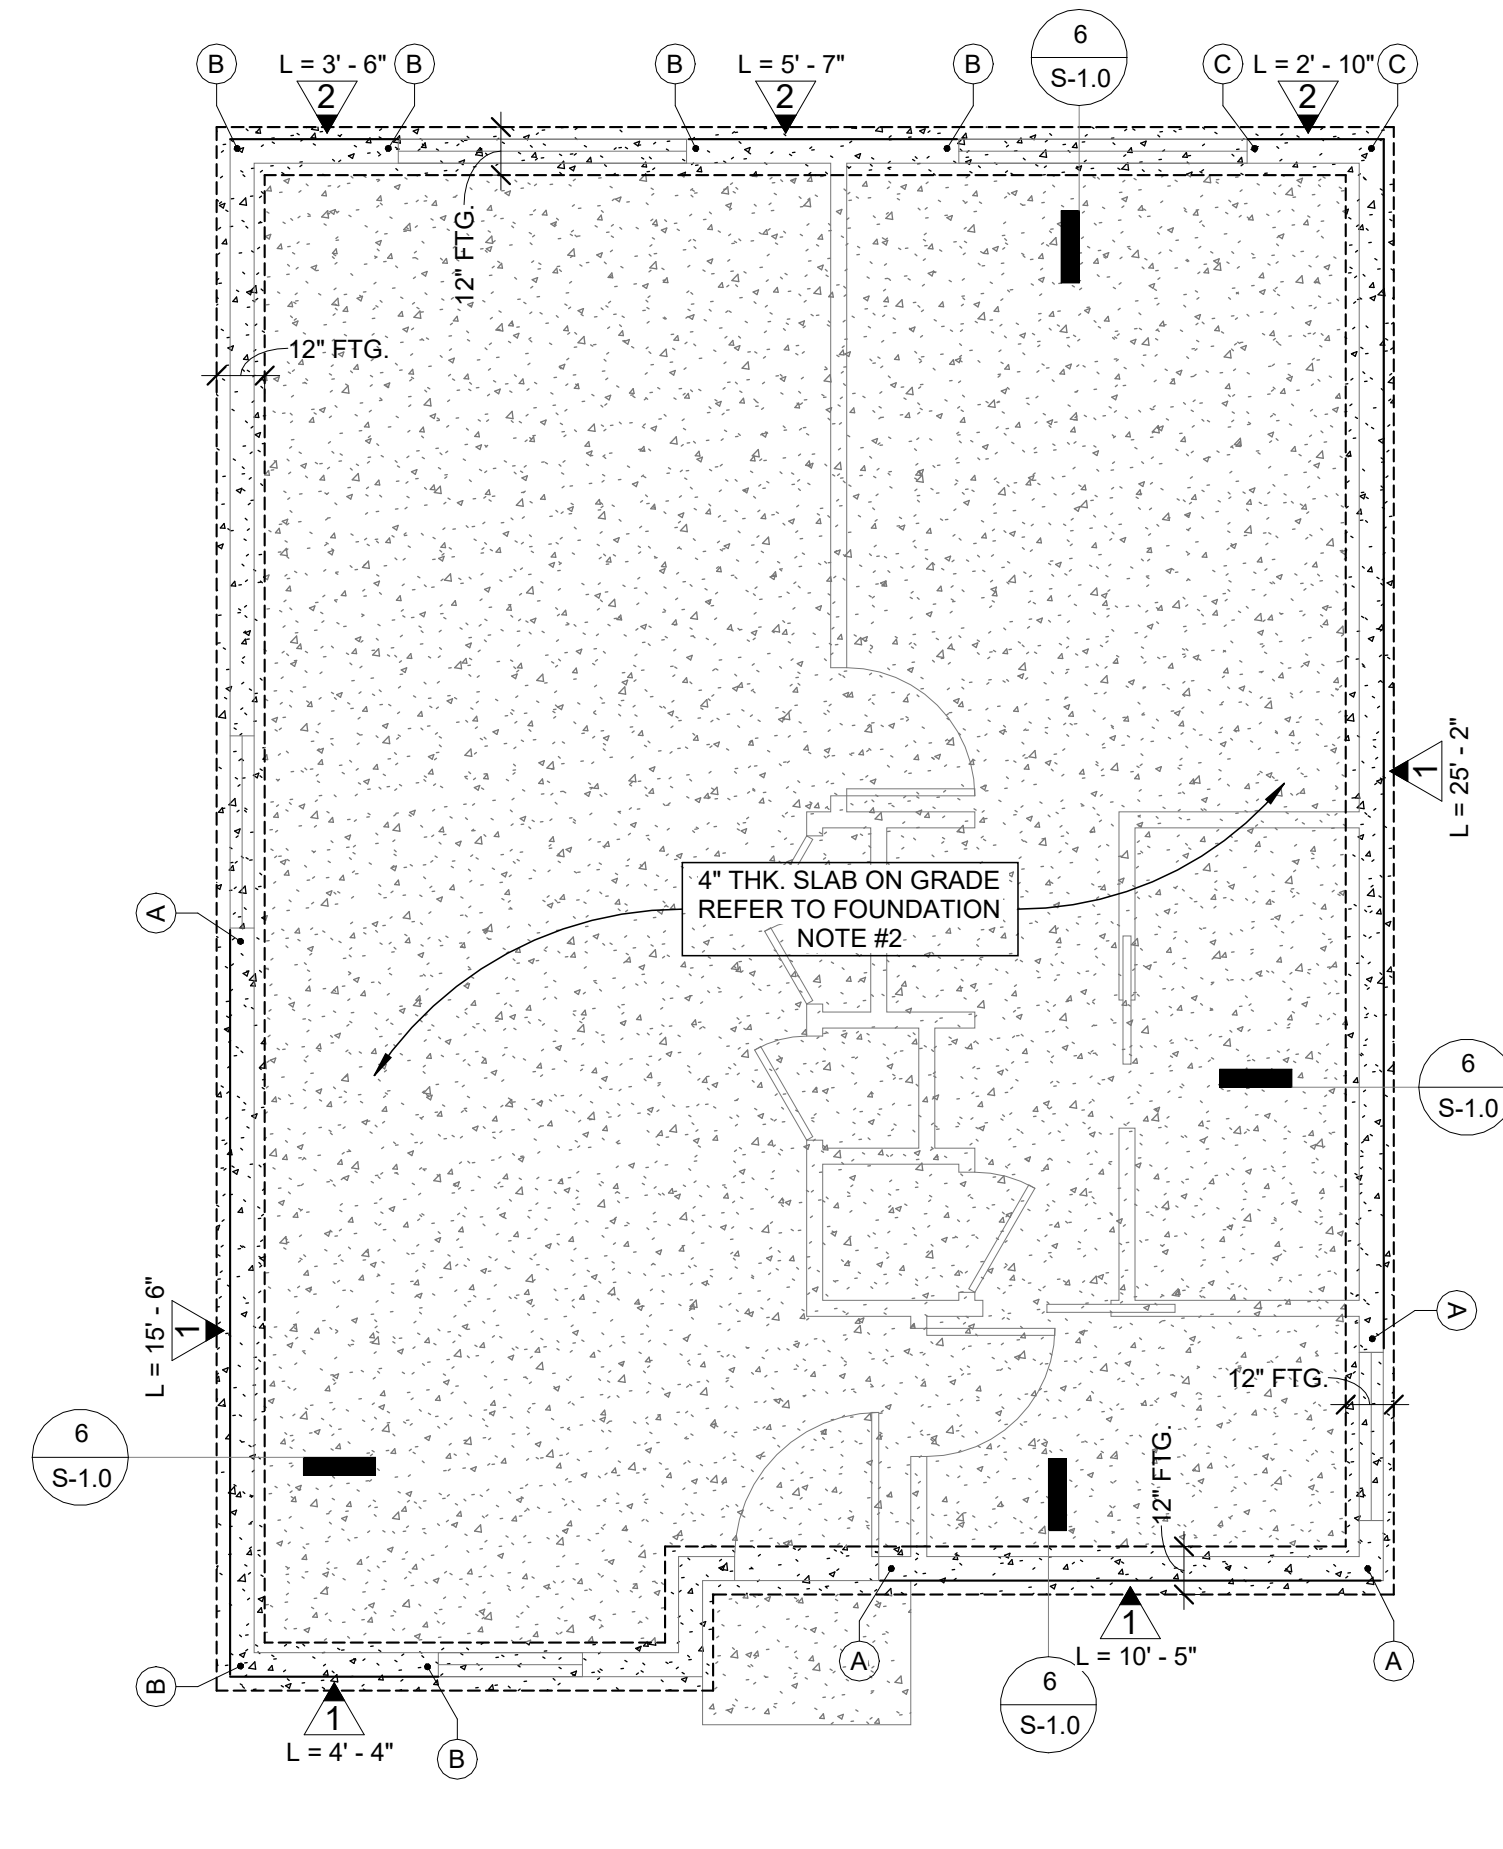

A Foundation Plan
1/4" = 1'-0"


Foundation Plan Notes

- Footings are to be founded a minimum of 2'-0" below adjacent grade.
- Slab on grade to be minimum 4" thick with #4@16" o.c. each way chaired at mid thickness. Slab to be underlain by 10 mil vapor barrier/4" crusher-run base compacted by mechanical means. Vapor barrier to be in conformance with ASTM E1643 and installed per manufacturer's recommendations with care taken to seal seams, penetrations and perimeter edges. See slab detail below.
- Control joints are required for the slab on grade at a maximum spacing of 15' on centers each way. The contractor is required to submit a plan of proposed control joints to the Architect and SAA prior to placing concrete. See Typical Details for additional information.
- Concrete curbs required along some exterior walls. Coordinate with Arch for extent and configuration of curbs. See structural detail sheets for relevant construction information where curbs required.
- Foundation sills shall be naturally durable or preservative-treated wood.
- If adverse soil conditions are encountered, a soils investigation report may be required.

Shear Wall Schedule		Sill Attachment			Capacity (ASD)	
ID	Sheathing	Concrete	Wood	Top Attachment		
1	1/2" CDX	10d@6,12	5/8"@32	SDS@16	A35@24	310 pif
2	1/2" Struct 1	10d@3,12	5/8"@24	SDS@8	A35@16	665 pif

Holdown Schedule		Post	Fasteners	Comments
ID	HD			
(A)	HDU2	4x4	(6) SDS	LARR 25720
(B)	HDU4	4x4	(10) SDS	LARR 25720
(C)	HDU5	4x4	(14) SDS	LARR 25720

Legend:

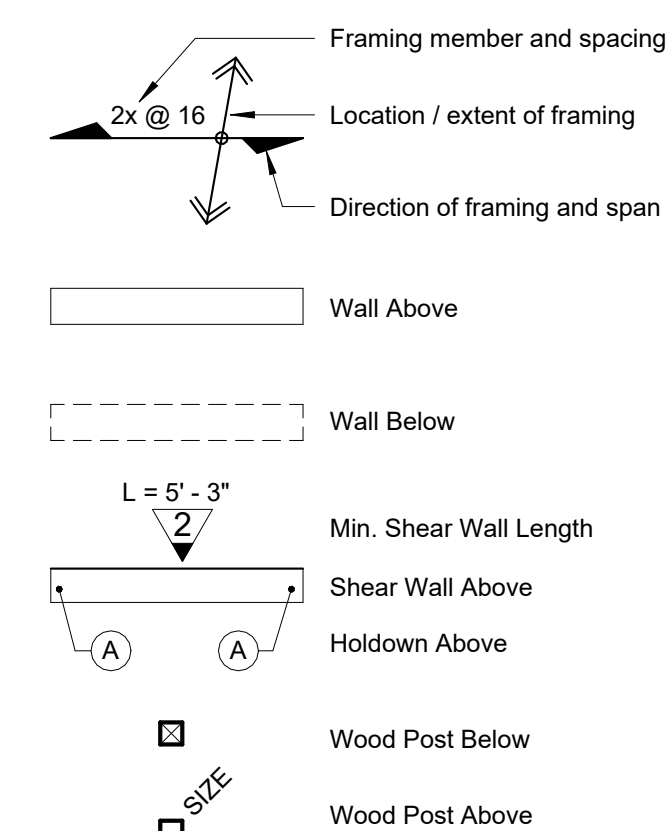

Shear Wall Notes


- All exterior walls not otherwise designated as shear wall to be sheathed per item 1 in the Shear Wall Schedule.
- Sill anchors to concrete to be A307 anchor rods with 7" embedment in foundation. If multiple pours used, specified embedment must be contained within top pour. If not, full embedment must be achieved in lower pour level. All sill anchors to have 2-1/2" square x 1/4" plate washers under nuts. Install sill anchors in centerline of sill plate.
- Sill attachment to wood to be with Simpson SDS screws 1/4" with 1-1/2" min embed into subfloor or beams/framing below subfloor [LARR 25711].
- Where sheathing nailing is less than 4" on center or where sheathing is applied to both sides of studs use 3x studs at panel edges or panel joints.
- Sill and sole plates to be 3x minimum thickness. Use pressure treated material where in contact with concrete. See Structural Lumber section of General Notes for additional information.
- Contractor responsible for maintaining copies of referenced Los Angeles Research Report and/or conditions of listing shall be made available at the job site.


Holdown Notes

- Post sizes are minimums. Coordinate with wall framing and post sizes indicated on plans.
- SDS = Simpson SDS25xxx (provide 1-1/2" min embed).
- Hold-down connector bolts to wood framing require approved plate washers. Hold-downs shall be finger tight and 1/2 wrench turn just prior to covering the wall framing. Connector bolts into wood framing require steel plate washers on the post on the opposite side of the anchorage device. Plate size shall be a minimum of 0.299 inch by 3 inches by 3 inches.
- Where double holdowns are specified at shearwall use 6x post and vertically stagger devices if necessary to avoid fasteners from fouling each other.
- Provide Simpson SB anchor bolts [LARR 25827] at all holdowns. Coordinate anchor bolt diameter with holdown hardware.
- Hold-down hardware must be secured in place prior to foundation inspection.
- Bolts, fasteners and framing hardware in contact with preservative treated lumber to be hot dipped galvanized.


Framing Plan Notes

- Roof sheathing to be 1/2" CD-X (Span Rating 32/16) with face grain perpendicular to framing direction with panel joints staggered. Nail to framing with 10d @ 6, 6, 12.
- Wall framing to be as follows unless noted otherwise:
Exterior walls = 2x4 @ 16
Interior non-bearing walls = 2x4 @ 16
Plumbing walls = 2x6 @ 16 (or 2x4 @ 16 with furring to avoid cutting structural framing)
- All diaphragm to utilize common nails or galvanized box nails.
- All shearwall nailing shall utilize hot dipped galvanized box nails.
- All bolt holes shall be drilled 1/32" to 1/16" oversized. For lag bolts provide lead hole 40% to 70% of threaded shank diameter and full diameter at smooth shank portion.
- Contractor responsible for maintaining copies of referenced Los Angeles Research Report and/or conditions of Listing at the job site.
- Roof diaphragm nailing to be inspected before covering. Face grain of plywood shall be perpendicular to supports. Floor shall have tongue and groove or blocked panel edges. Plywood spans shall conform with 2304.7

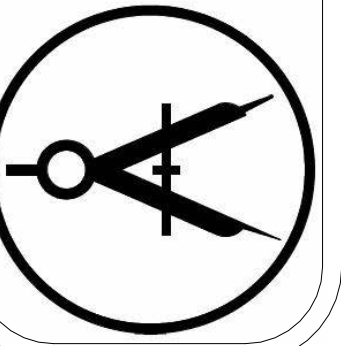


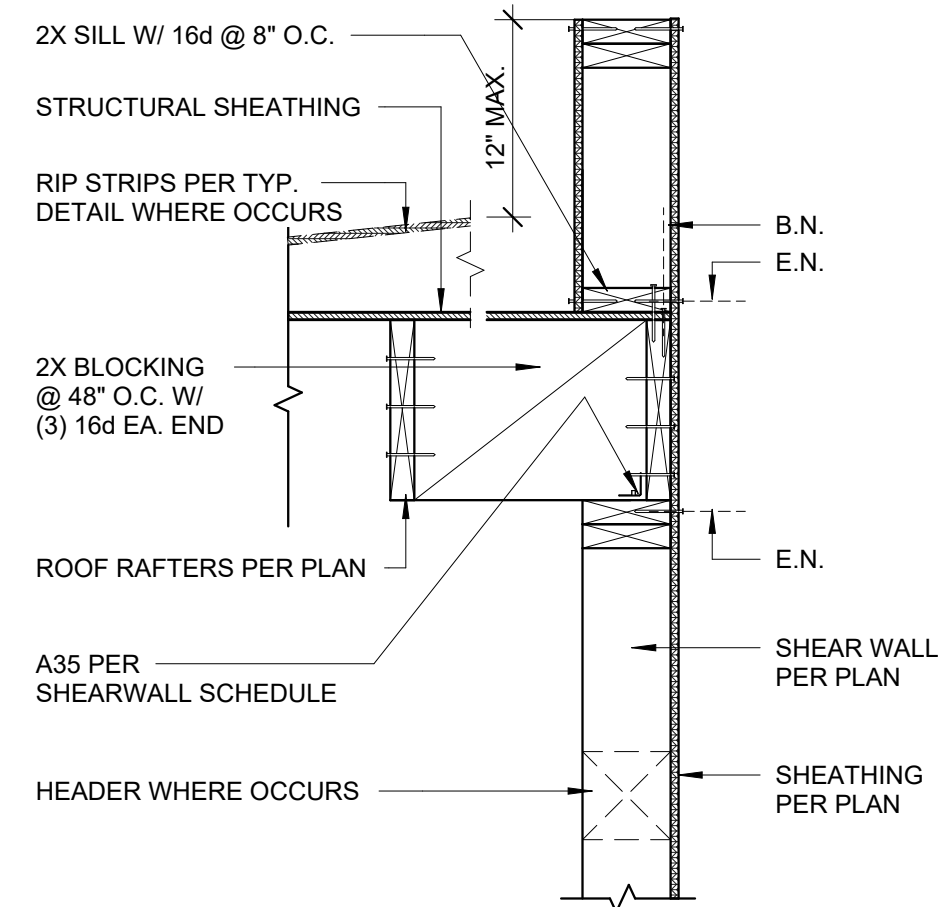


2 Roof Framing Detail (Parallel)
1" = 1'-0"

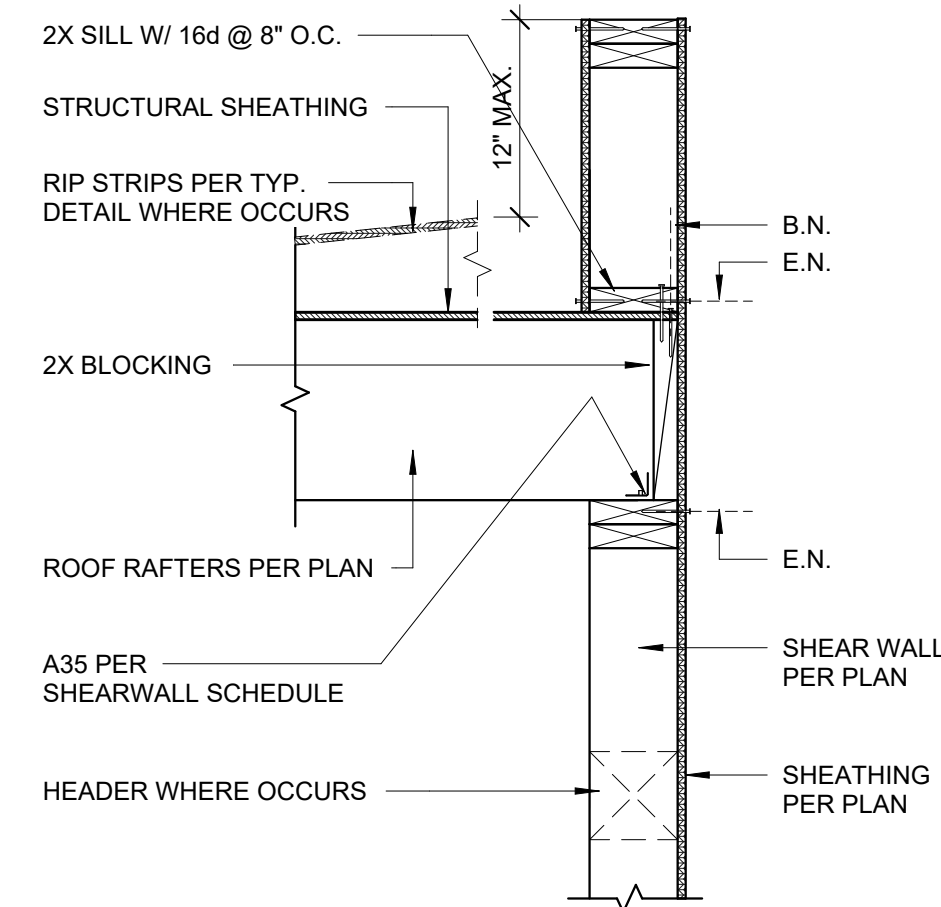


1 Roof Framing Detail (Perpend.)
1" = 1'-0"

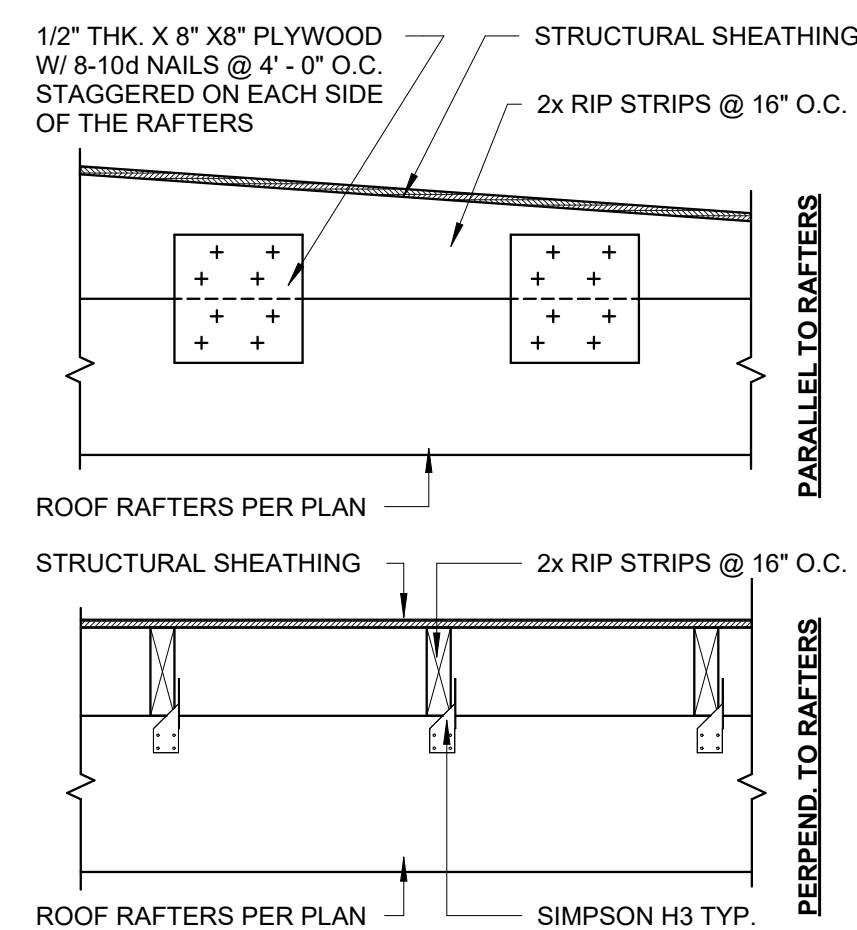


4 Typ. Rip Strips Detail
1" = 1'-0"

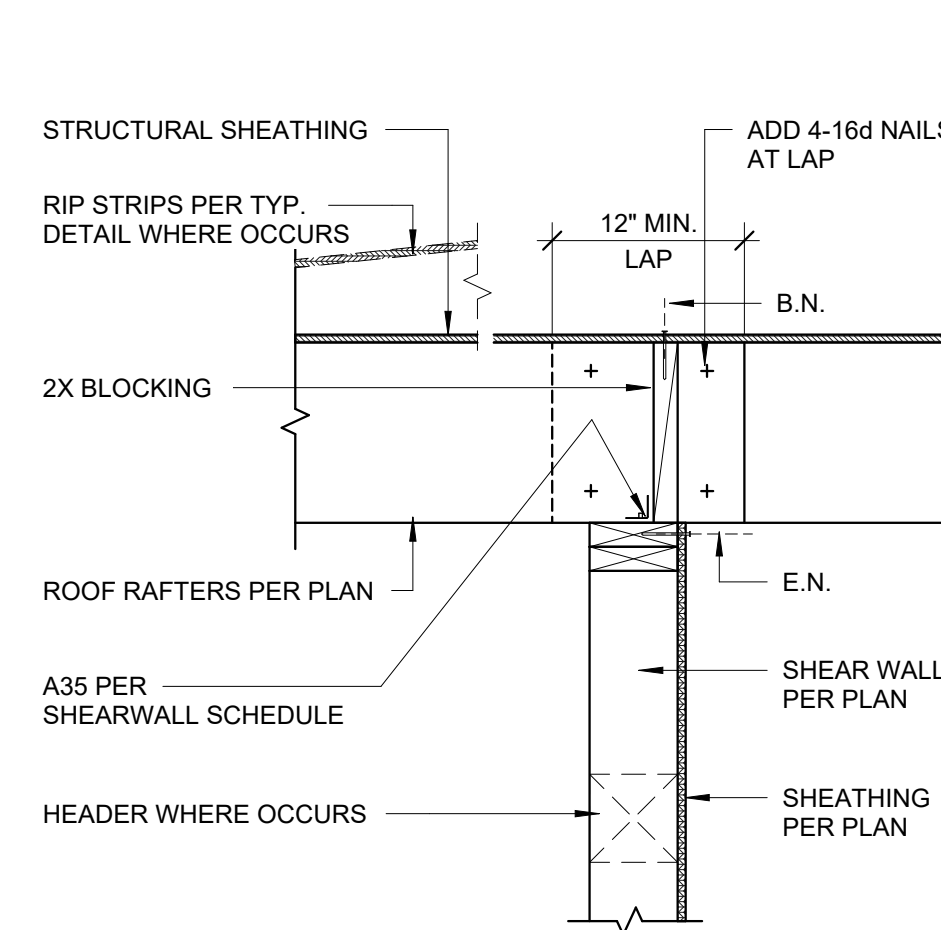


3 Roof Framing Detail (Perpend.)
1" = 1'-0"

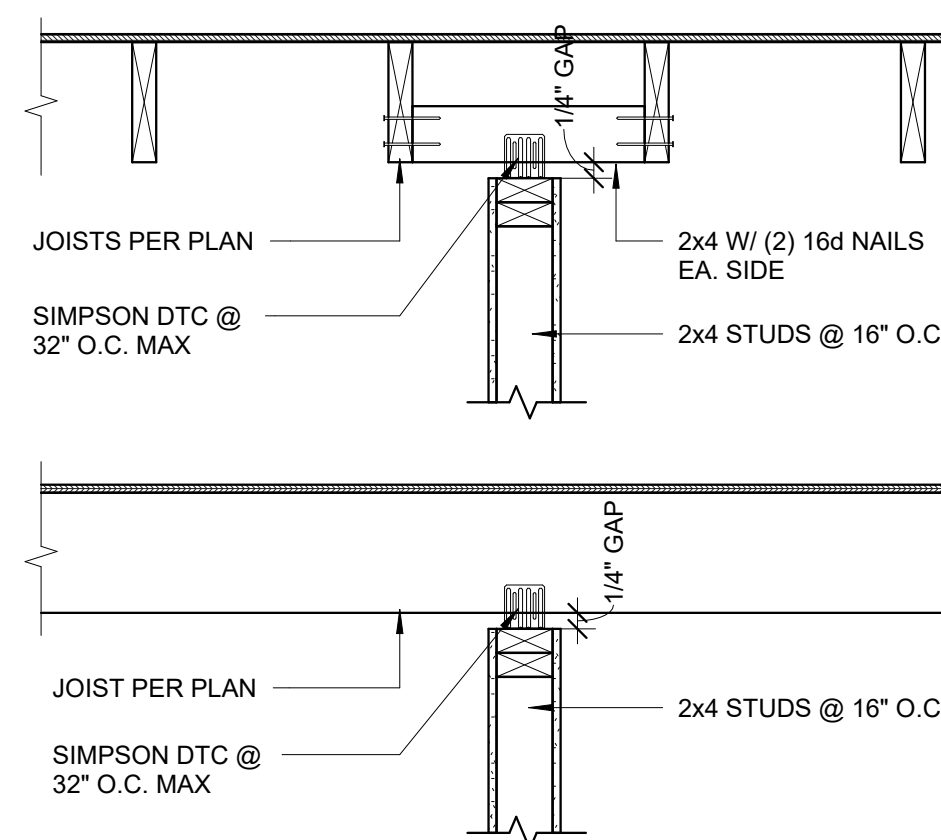


5 Typ. Non-Bearing Partition Wall Detail
1" = 1'-0"

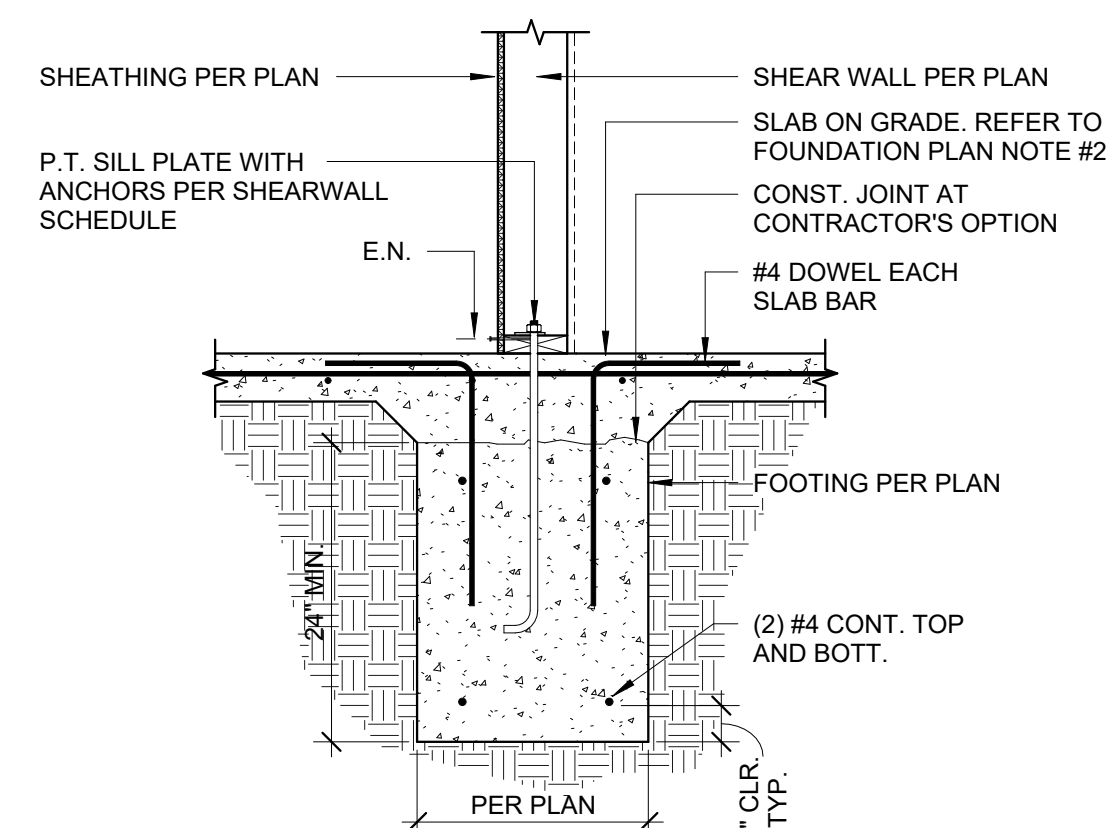


8 Typical Interior Wall Footing Detail
3/4" = 1'-0"

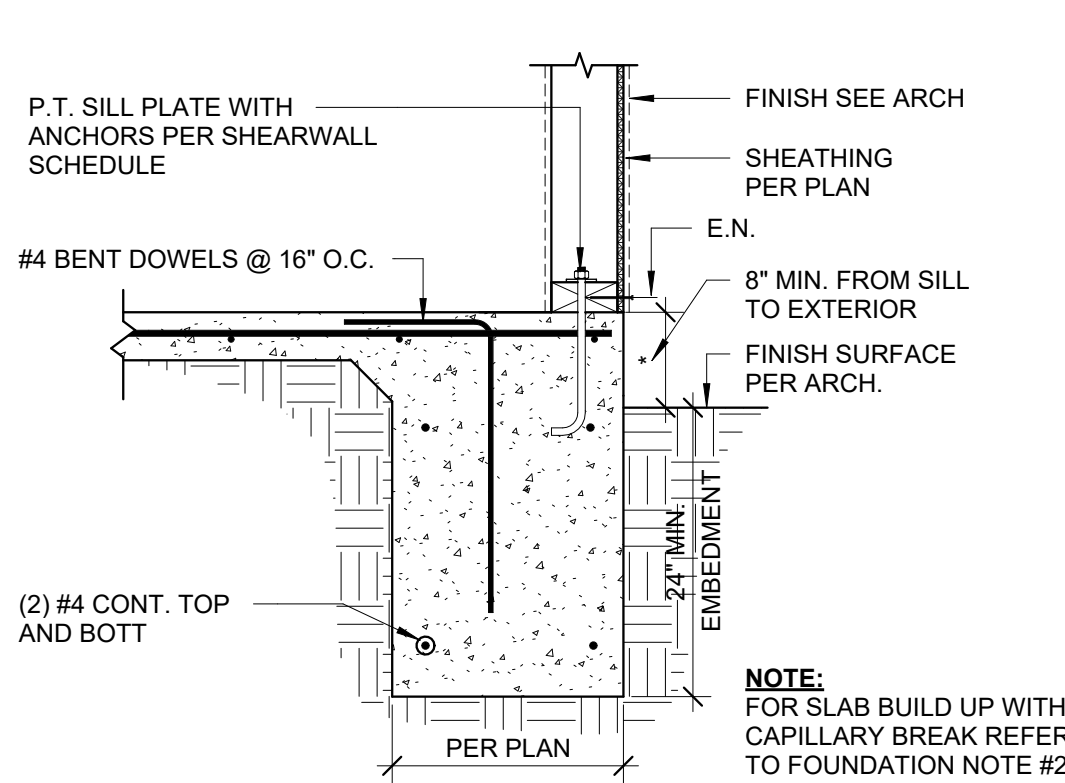

7 Typical Exterior Wall Footing Detail
3/4" = 1'-0"

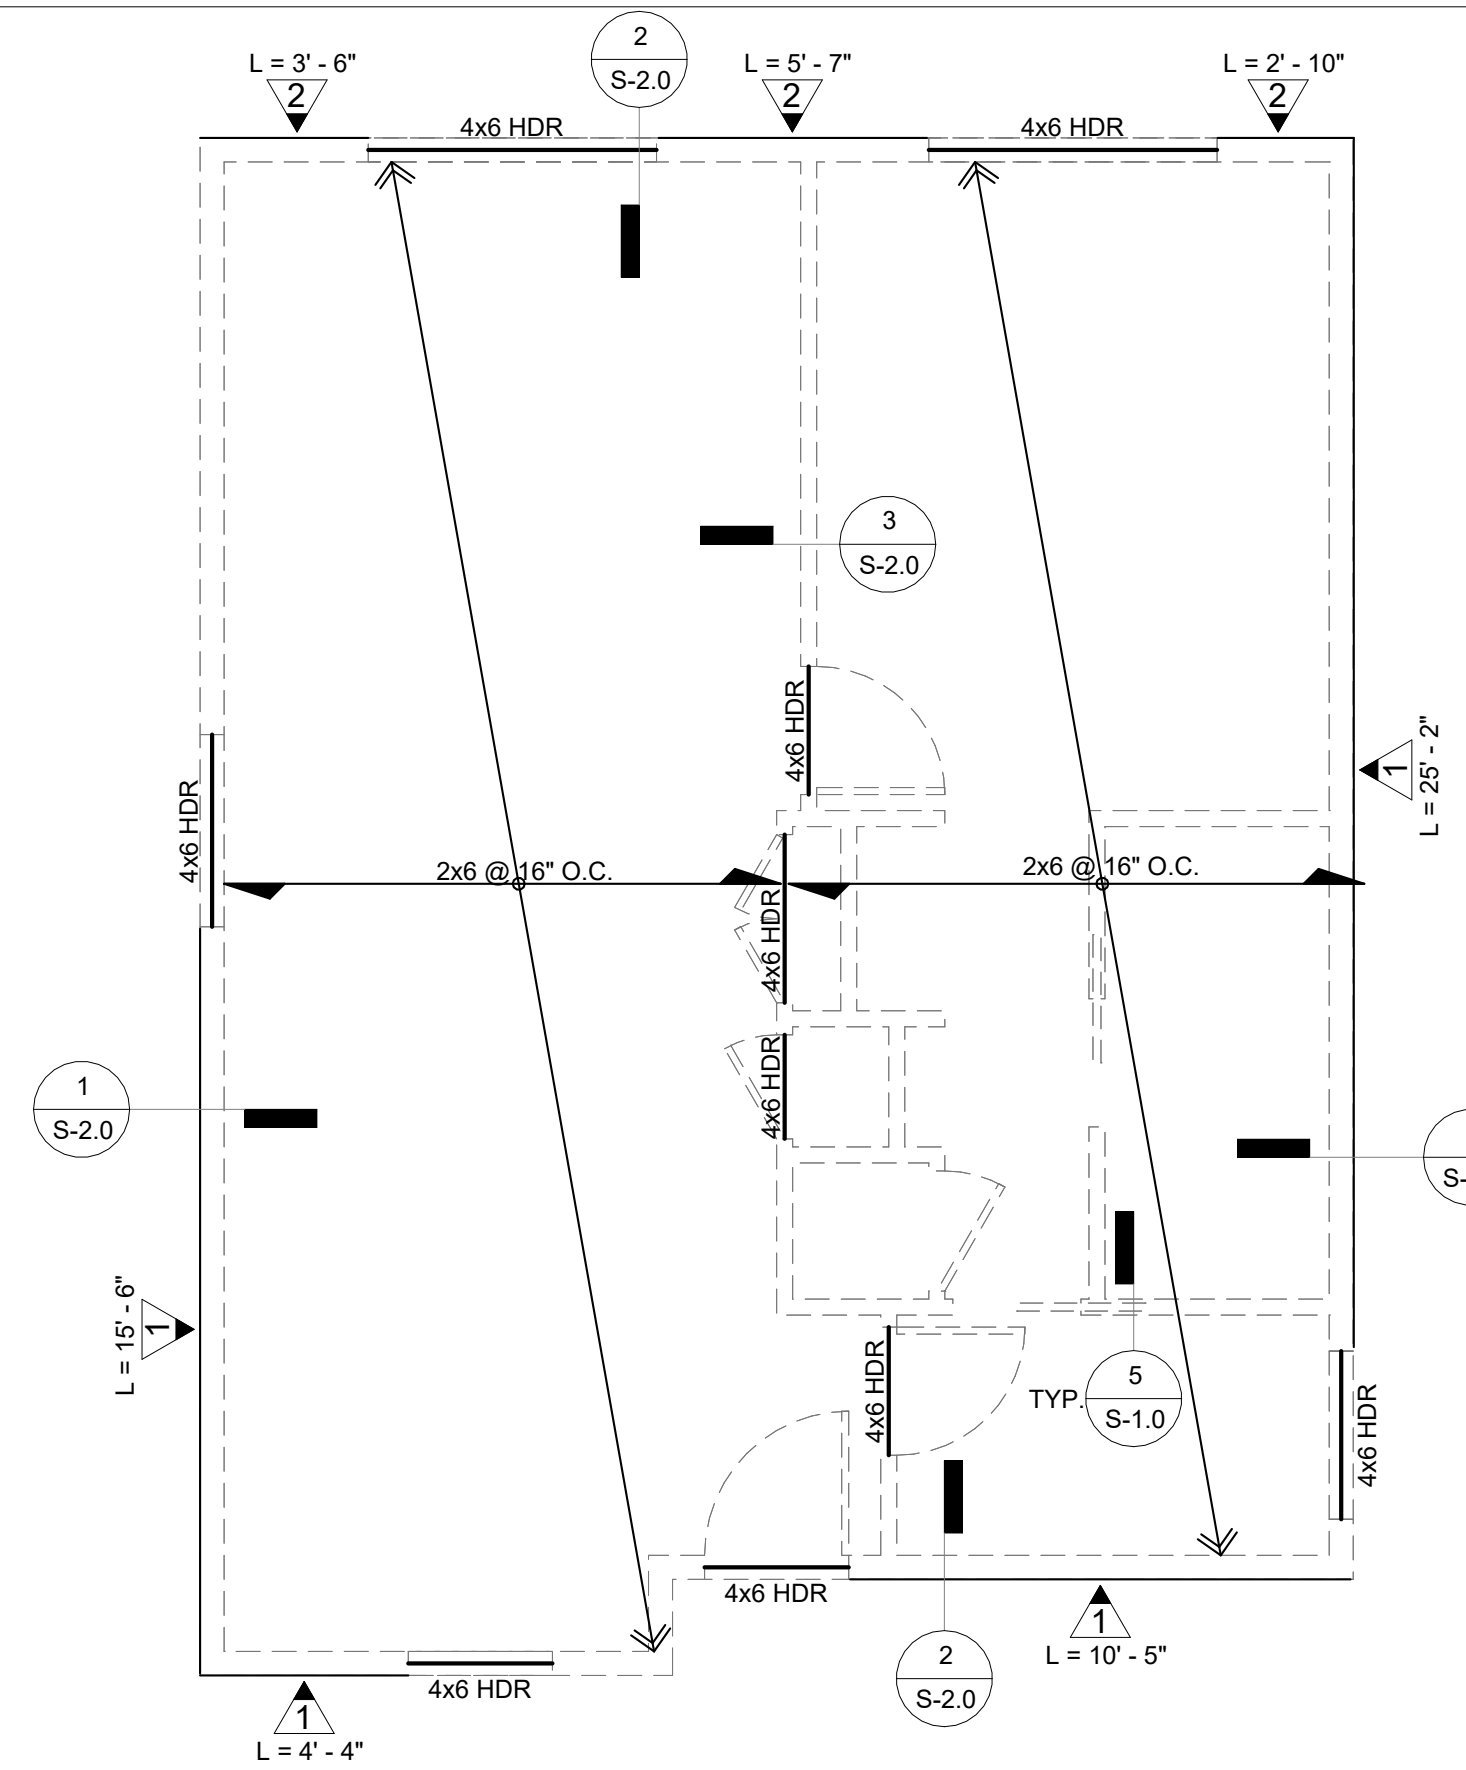

B Ceiling Framing Plan
1/4" = 1'-0"

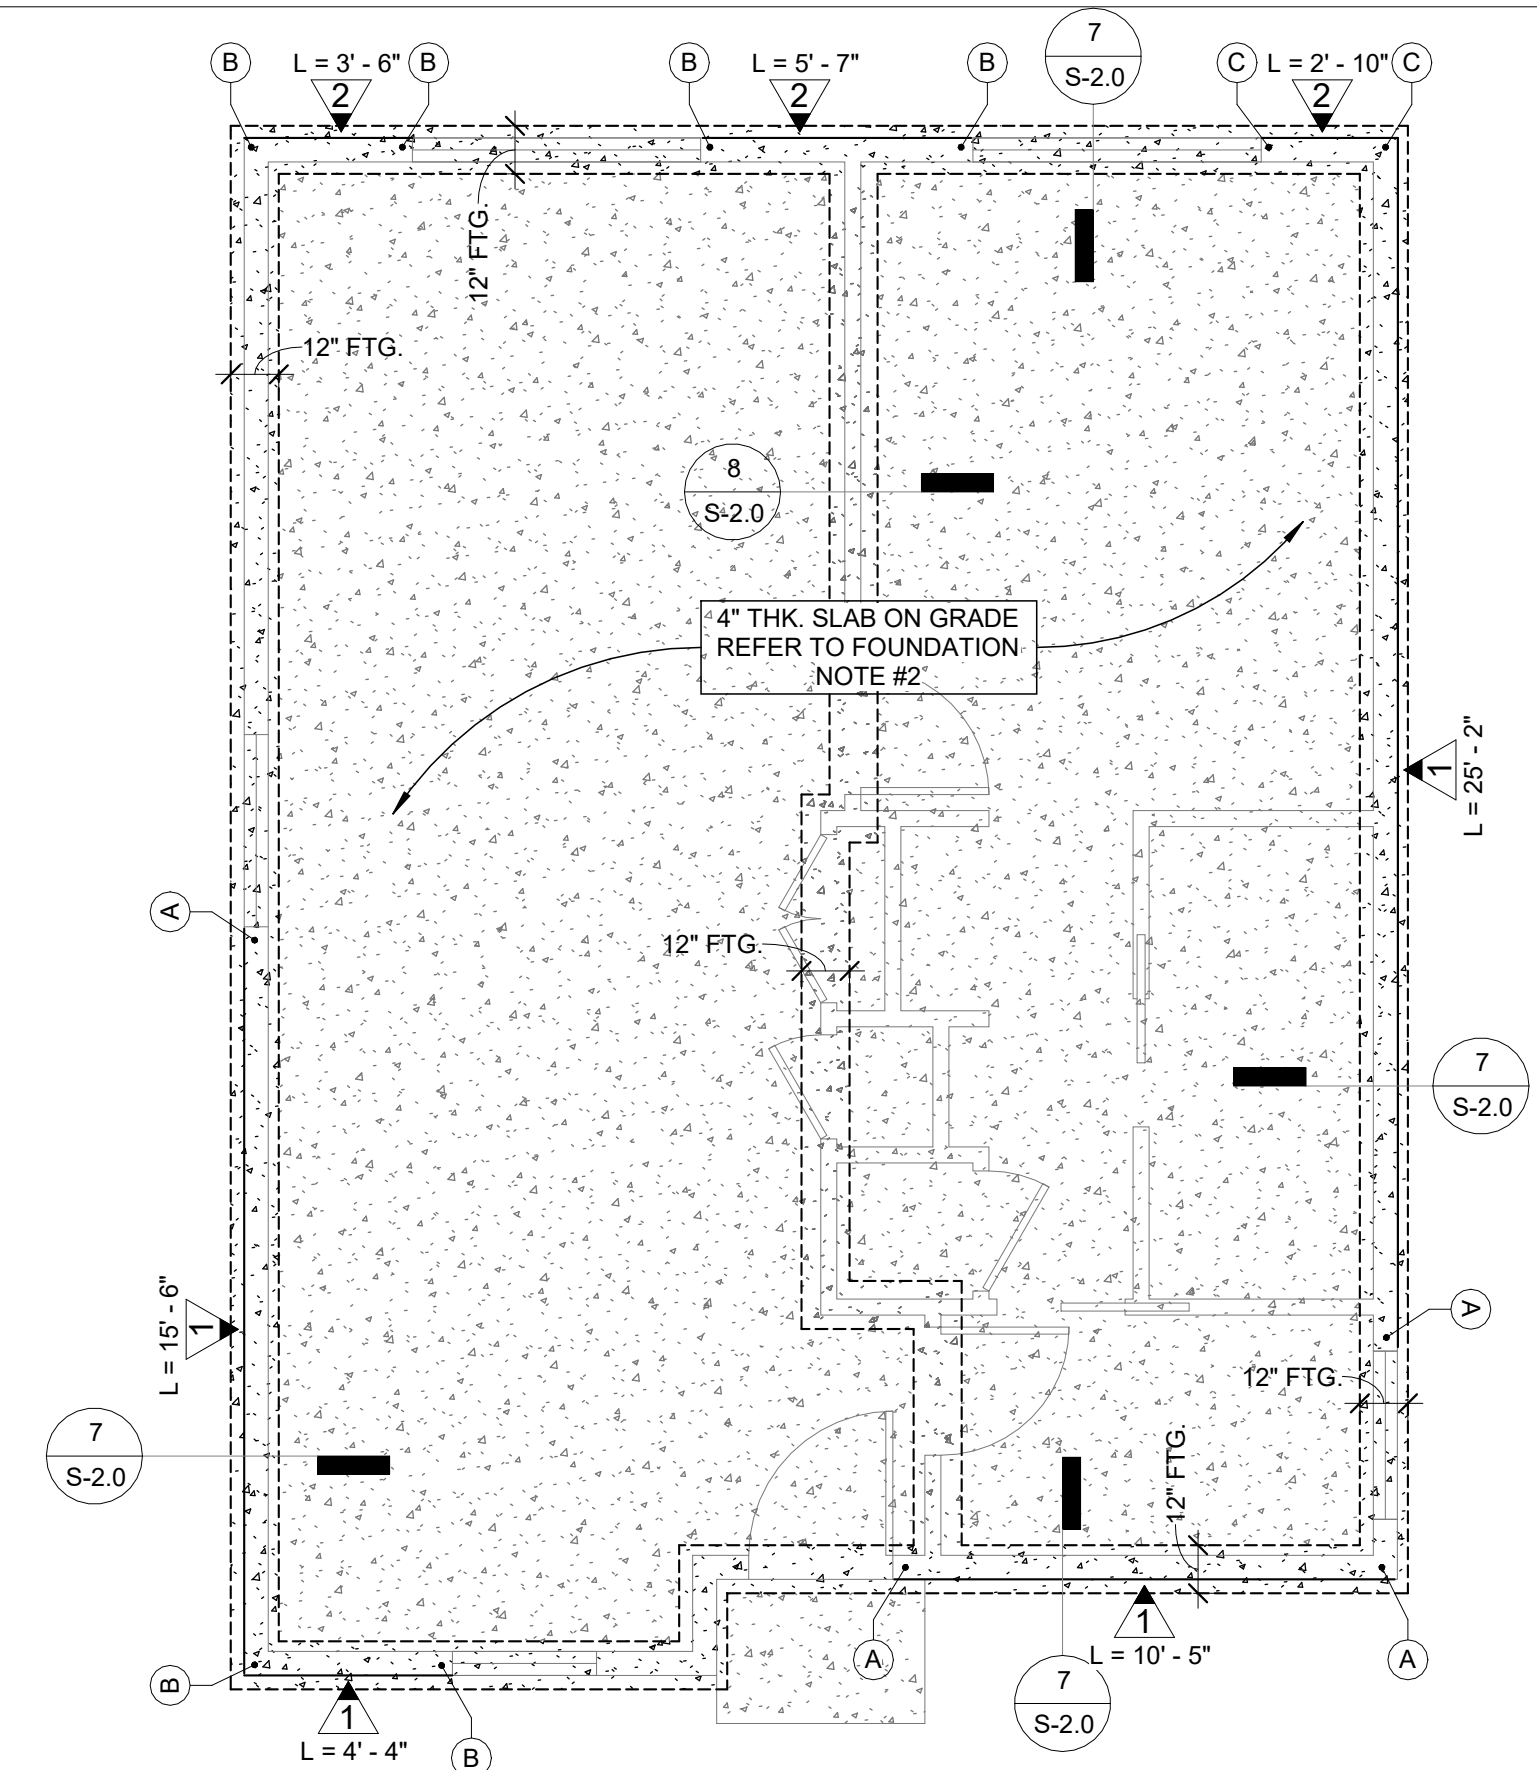

A Foundation Plan
1/4" = 1'-0"

Foundation Plan Notes

1. Footings are to be founded a minimum of 2'-0" below adjacent grade.
2. Slab on grade to be minimum 4" thick with #4@16" o.c. each way chaired at mid thickness. Slab to be underlain by 10 mil vapor barrier/4" crusher-run base compacted by mechanical means. Vapor barrier to be in conformance with ASTM E1643 and installed per manufacturer's recommendations with care taken to seal seams, penetrations and perimeter edges. See slab detail below.
3. Control joints are required for the slab on grade at a maximum spacing of 15' on centers each way. The contractor is required to submit a plan of proposed control joints to the Architect and SAA prior to placing concrete. See Typical Details for additional information.
4. Concrete curbs required along some exterior walls. Coordinate with Arch for extent and configuration of curbs. See structural detail sheets for relevant construction information where curbs required.
5. Foundation sills shall be naturally durable or preservative-treated wood.
6. If adverse soil conditions are encountered, a soils investigation report may be required.

Shear Wall Notes

1. All exterior walls not otherwise designated as shear wall to be sheathed per item 1 in the Shear Wall Schedule.
2. Sill attachment to concrete to be A307 anchor rods with 7" embedment in foundation. If multiple pours used, specified embedment must be contained within top pour. If not, full embedment must be achieved in lower pour level. All sill anchors to have 2-1/2" square x 1/4" plate washers under nuts. Install sill anchors in centerline of sill plate.
3. Sill attachment to wood to be with Simpson SDS screws 1/4" with 1-1/2" min embed into subfloor or beams/framing below subfloor [LARR 25711].
4. Where sheathing nailing is less than 4" on center or where sheathing is applied to both sides of studs use 3x studs at panel edges or panel joints.
5. Sill and sole plates to be 3x minimum thickness. Use pressure treated material where in contact with concrete. See Structural Lumber section of General Notes for additional information.
6. Contractor responsible for maintaining copies of referenced Los Angeles Research Report and/or conditions of listing shall be made available at the job site.


Holdown Notes

1. Post sizes are minimums. Coordinate with wall framing and post sizes indicated on plans.
2. SDS = Simpson SDS25xxx (provide 1-1/2" min embed).
3. Hold-down connector bolts into wood framing require approved plate washers. Hold-downs shall be finger tight and 1/2 french turn just prior to covering the wall framing. Connector bolts into wood framing require steel plate washers on the post on the opposite side of the anchorage device. Plate size shall be a minimum of 0.299 inch by 3 inches by 3 inches.
4. Where double holdowns are specified at shearwall use 6x post and vertically stagger devices if necessary to avoid fasteners from fouling each other.
5. Provide Simpson SB anchor bolts [LARR 25827] at all holdowns. Coordinate anchor bolt diameter with holdown hardware.
6. Hold-down hardware must be secured in place prior to foundation inspection.
7. Bolts, fasteners and framing hardware in contact with preservative treated lumber to be hot dipped galvanized.

Shear Wall Schedule						
Sill Attachment						
ID	Sheathing	Nailing	Concrete	Wood	Top Attachment	Capacity (ASD)
1	1/2" CDX	10d@6,12	5/8"@32	SDS@16	A35@24	310 pif
2	1/2" Struct 1	10d@3,12	5/8"@24	SDS@8	A35@16	665 pif

Holdown Schedule					
ID	HD	Post	Fasteners	Comments	
(A)	HDU2	4x4	(6) SDS	LARR 25720	
(B)	HDU4	4x4	(10) SDS	LARR 25720	
(C)	HDU5	4x4	(14) SDS	LARR 25720	

Legend:

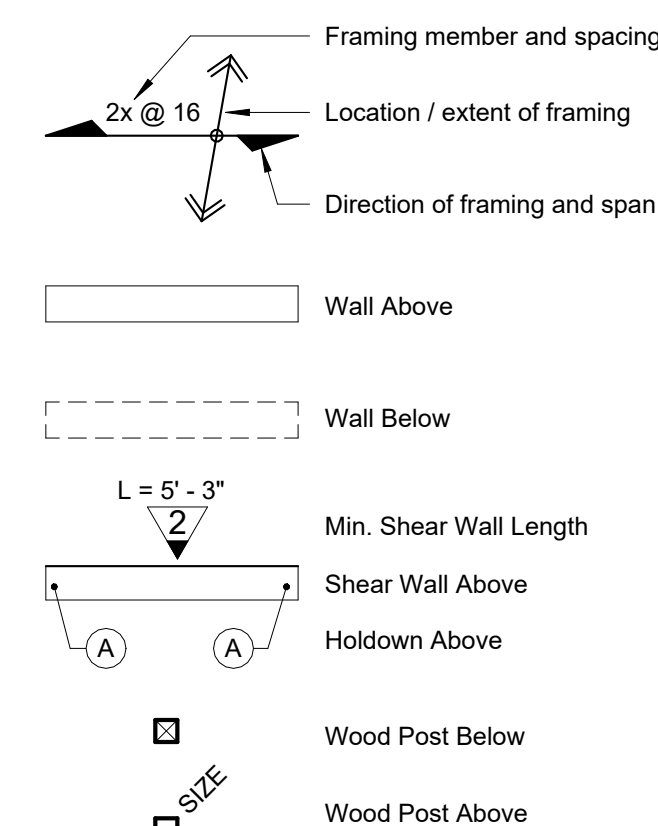

Framing Plan Notes

1. Roof sheathing to be 1/2" CD-X (Span Rating 32/16) with face grain perpendicular to framing direction with panel joints staggered. Nail to framing with 10d @ 6, 6, 12.
2. Wall framing to be as follows unless noted otherwise:
Exterior walls = 2x4 @ 16
Interior non-bearing walls = 2x4 @ 16
Plumbing walls = 2x6 @ 16 (or 2x4 @ 16 with furring to avoid cutting structural framing)
3. All diaphragm to utilize common nails or galvanized box nails.
4. All shearwall nailing shall utilize hot dipped galvanized box nails.
5. All bolt holes shall be drilled 1/32" to 1/6" oversized. For lag bolts provide lead hole 40% to 70% of threaded shank diameter and full diameter at smooth shank portion.
6. Contractor responsible for maintaining copies of referenced Los Angeles Research Report and/or conditions of Listing at the job site.
7. Roof diaphragm nailing to be inspected before covering. Face grain of plywood shall be perpendicular to supports. Floor shall have tongue and groove or blocked panel edges. Plywood spans shall conform with 2304.7

